


For Vent Wiring or controller/thermostat connections, see literature packet or go to [www.bardhvac.com](http://www.bardhvac.com)

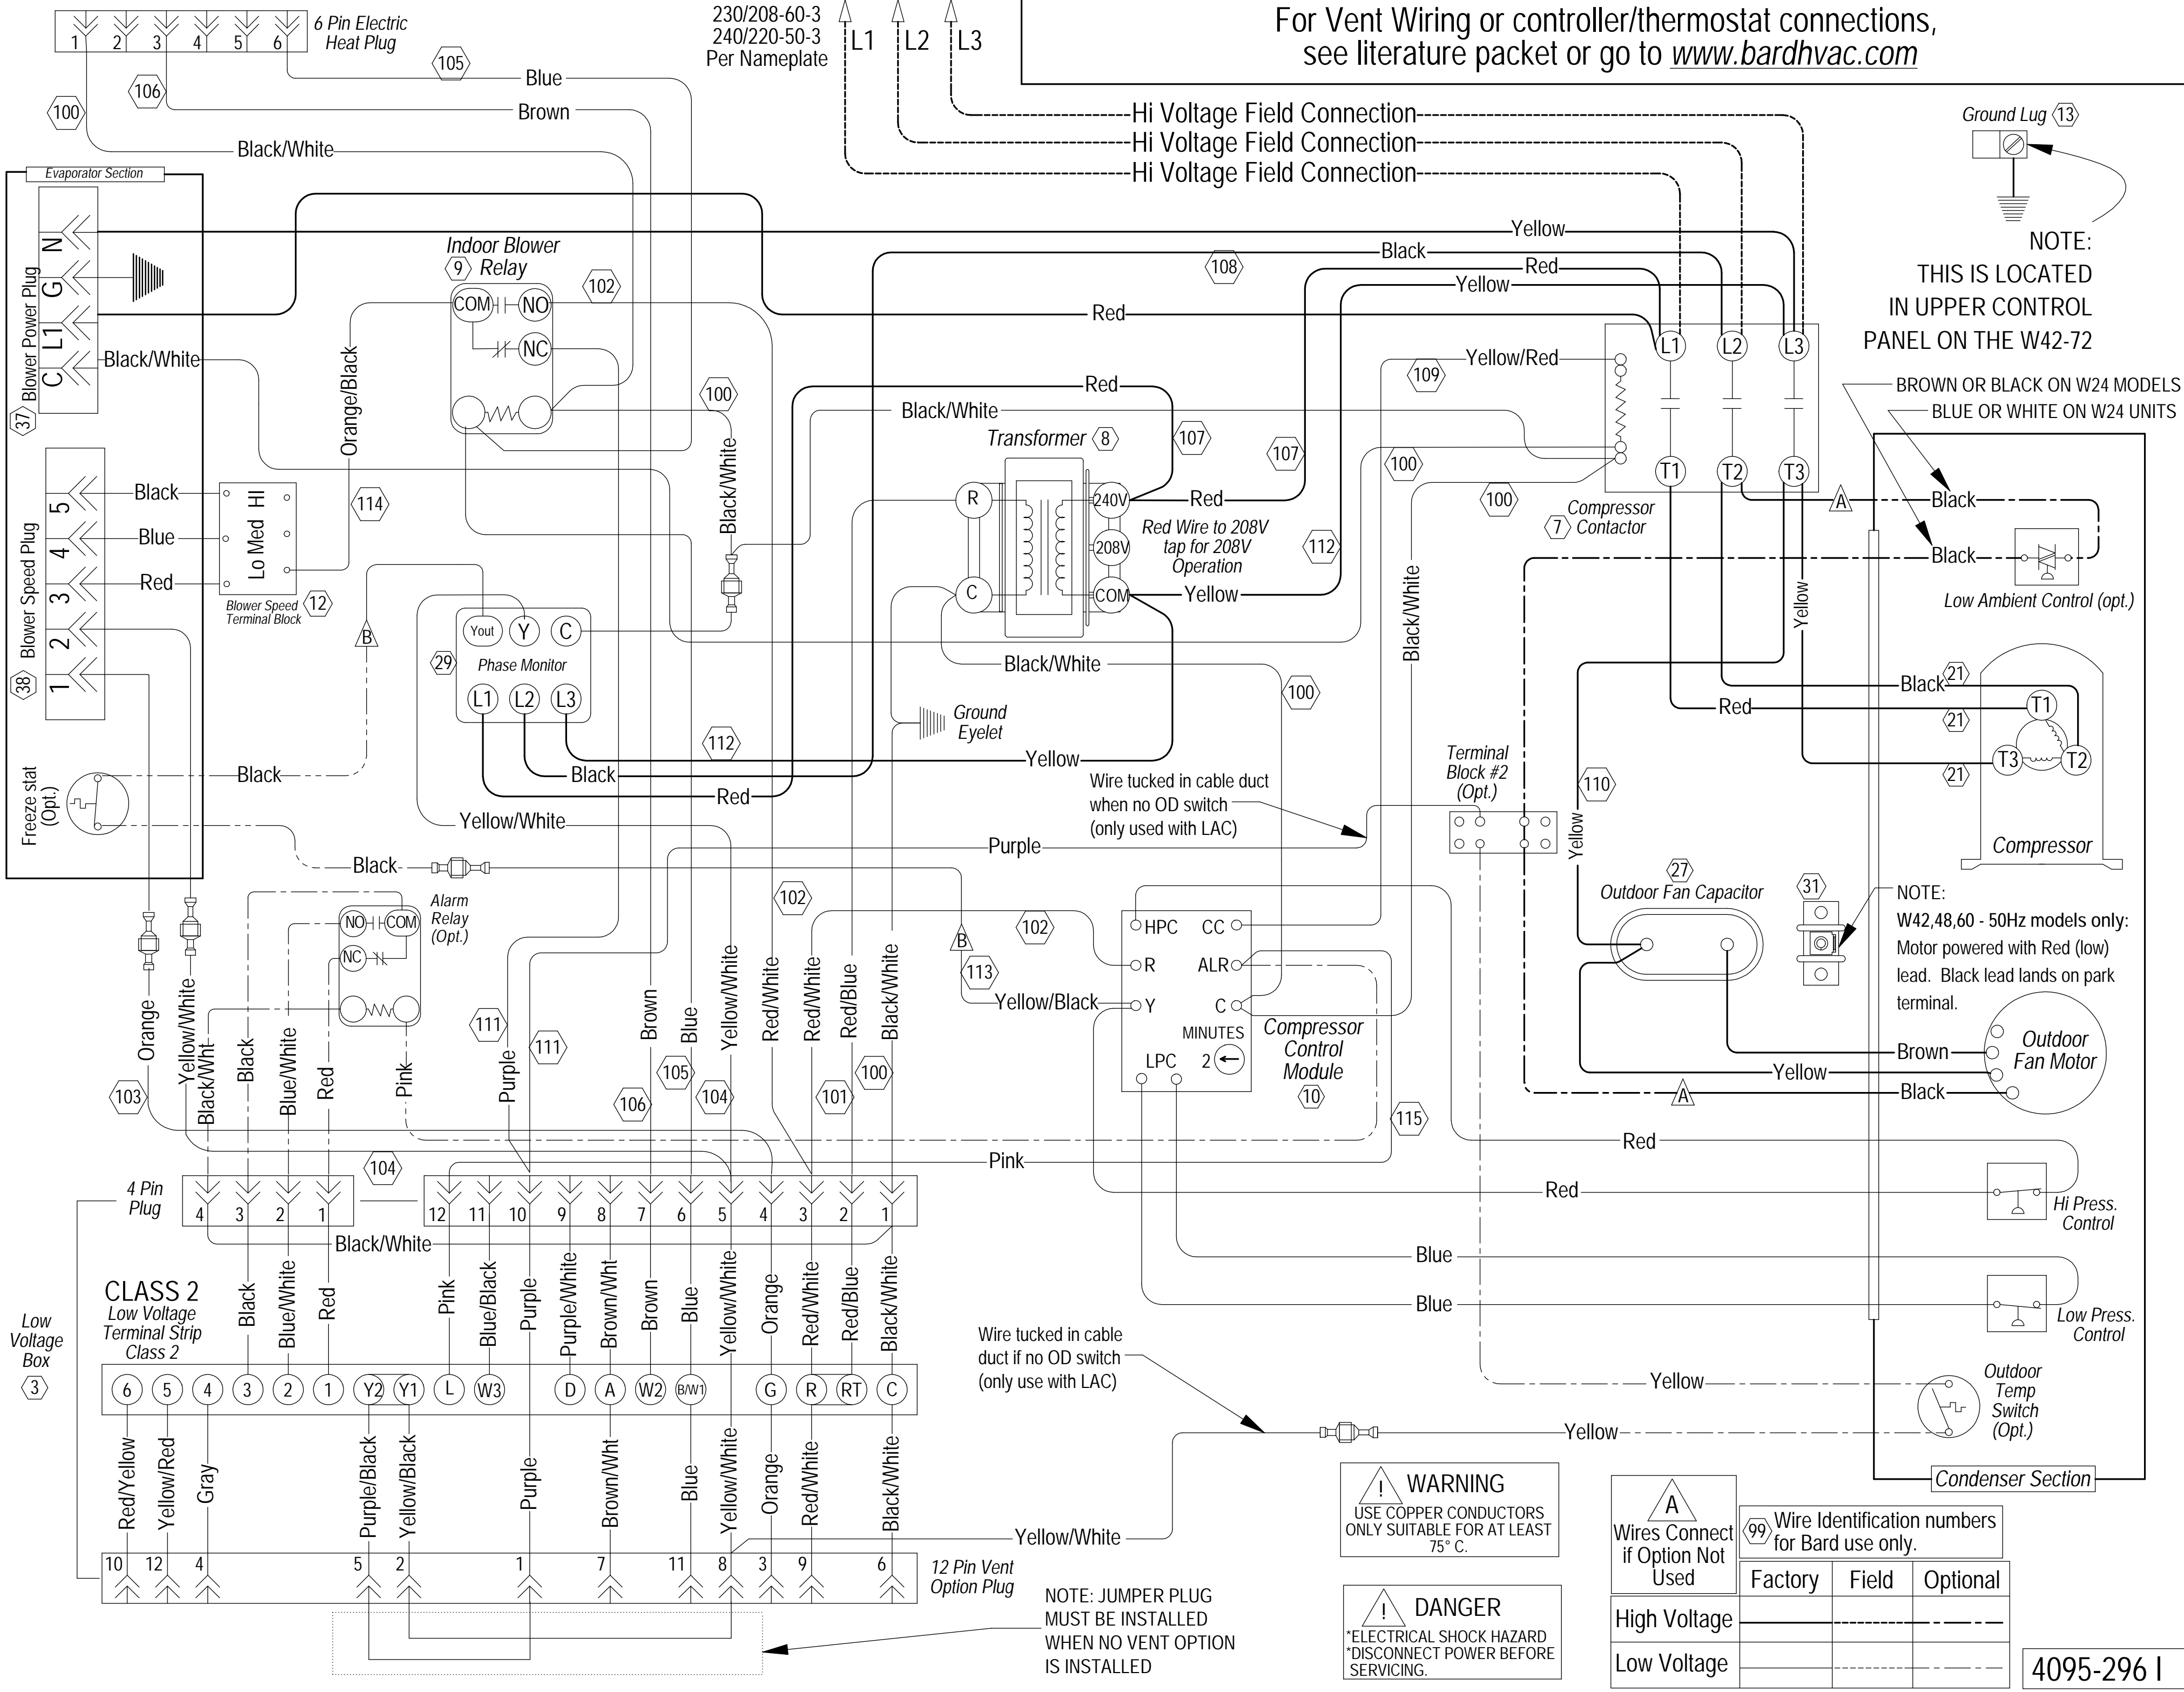

230/208-60-3  
240/220-50-3  
Per Nameplate

NOTE:  
THIS IS LOCATED  
IN UPPER CONTROL  
PANEL ON THE W42-72

BROWN OR BLACK ON W24 MODELS  
BLUE OR WHITE ON W24 UNITS

NOTE:  
W42,48,60 - 50Hz models only:  
Motor powered with Red (low)  
lead. Black lead lands on park  
terminal.

**WARNING**  
USE COPPER CONDUCTORS  
ONLY SUITABLE FOR AT LEAST  
75° C.

**DANGER**  
\*ELECTRICAL SHOCK HAZARD  
\*DISCONNECT POWER BEFORE  
SERVICING.

Wires Connect if Option Not Used	Wire Identification numbers for Bard use only.		
	Factory	Field	Optional
High Voltage			
Low Voltage			

4095-296 I

NOTE: JUMPER PLUG  
MUST BE INSTALLED  
WHEN NO VENT OPTION  
IS INSTALLED

Wire tucked in cable duct  
if no OD switch  
(only use with LAC)

Wire tucked in cable duct  
when no OD switch  
(only used with LAC)