


For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

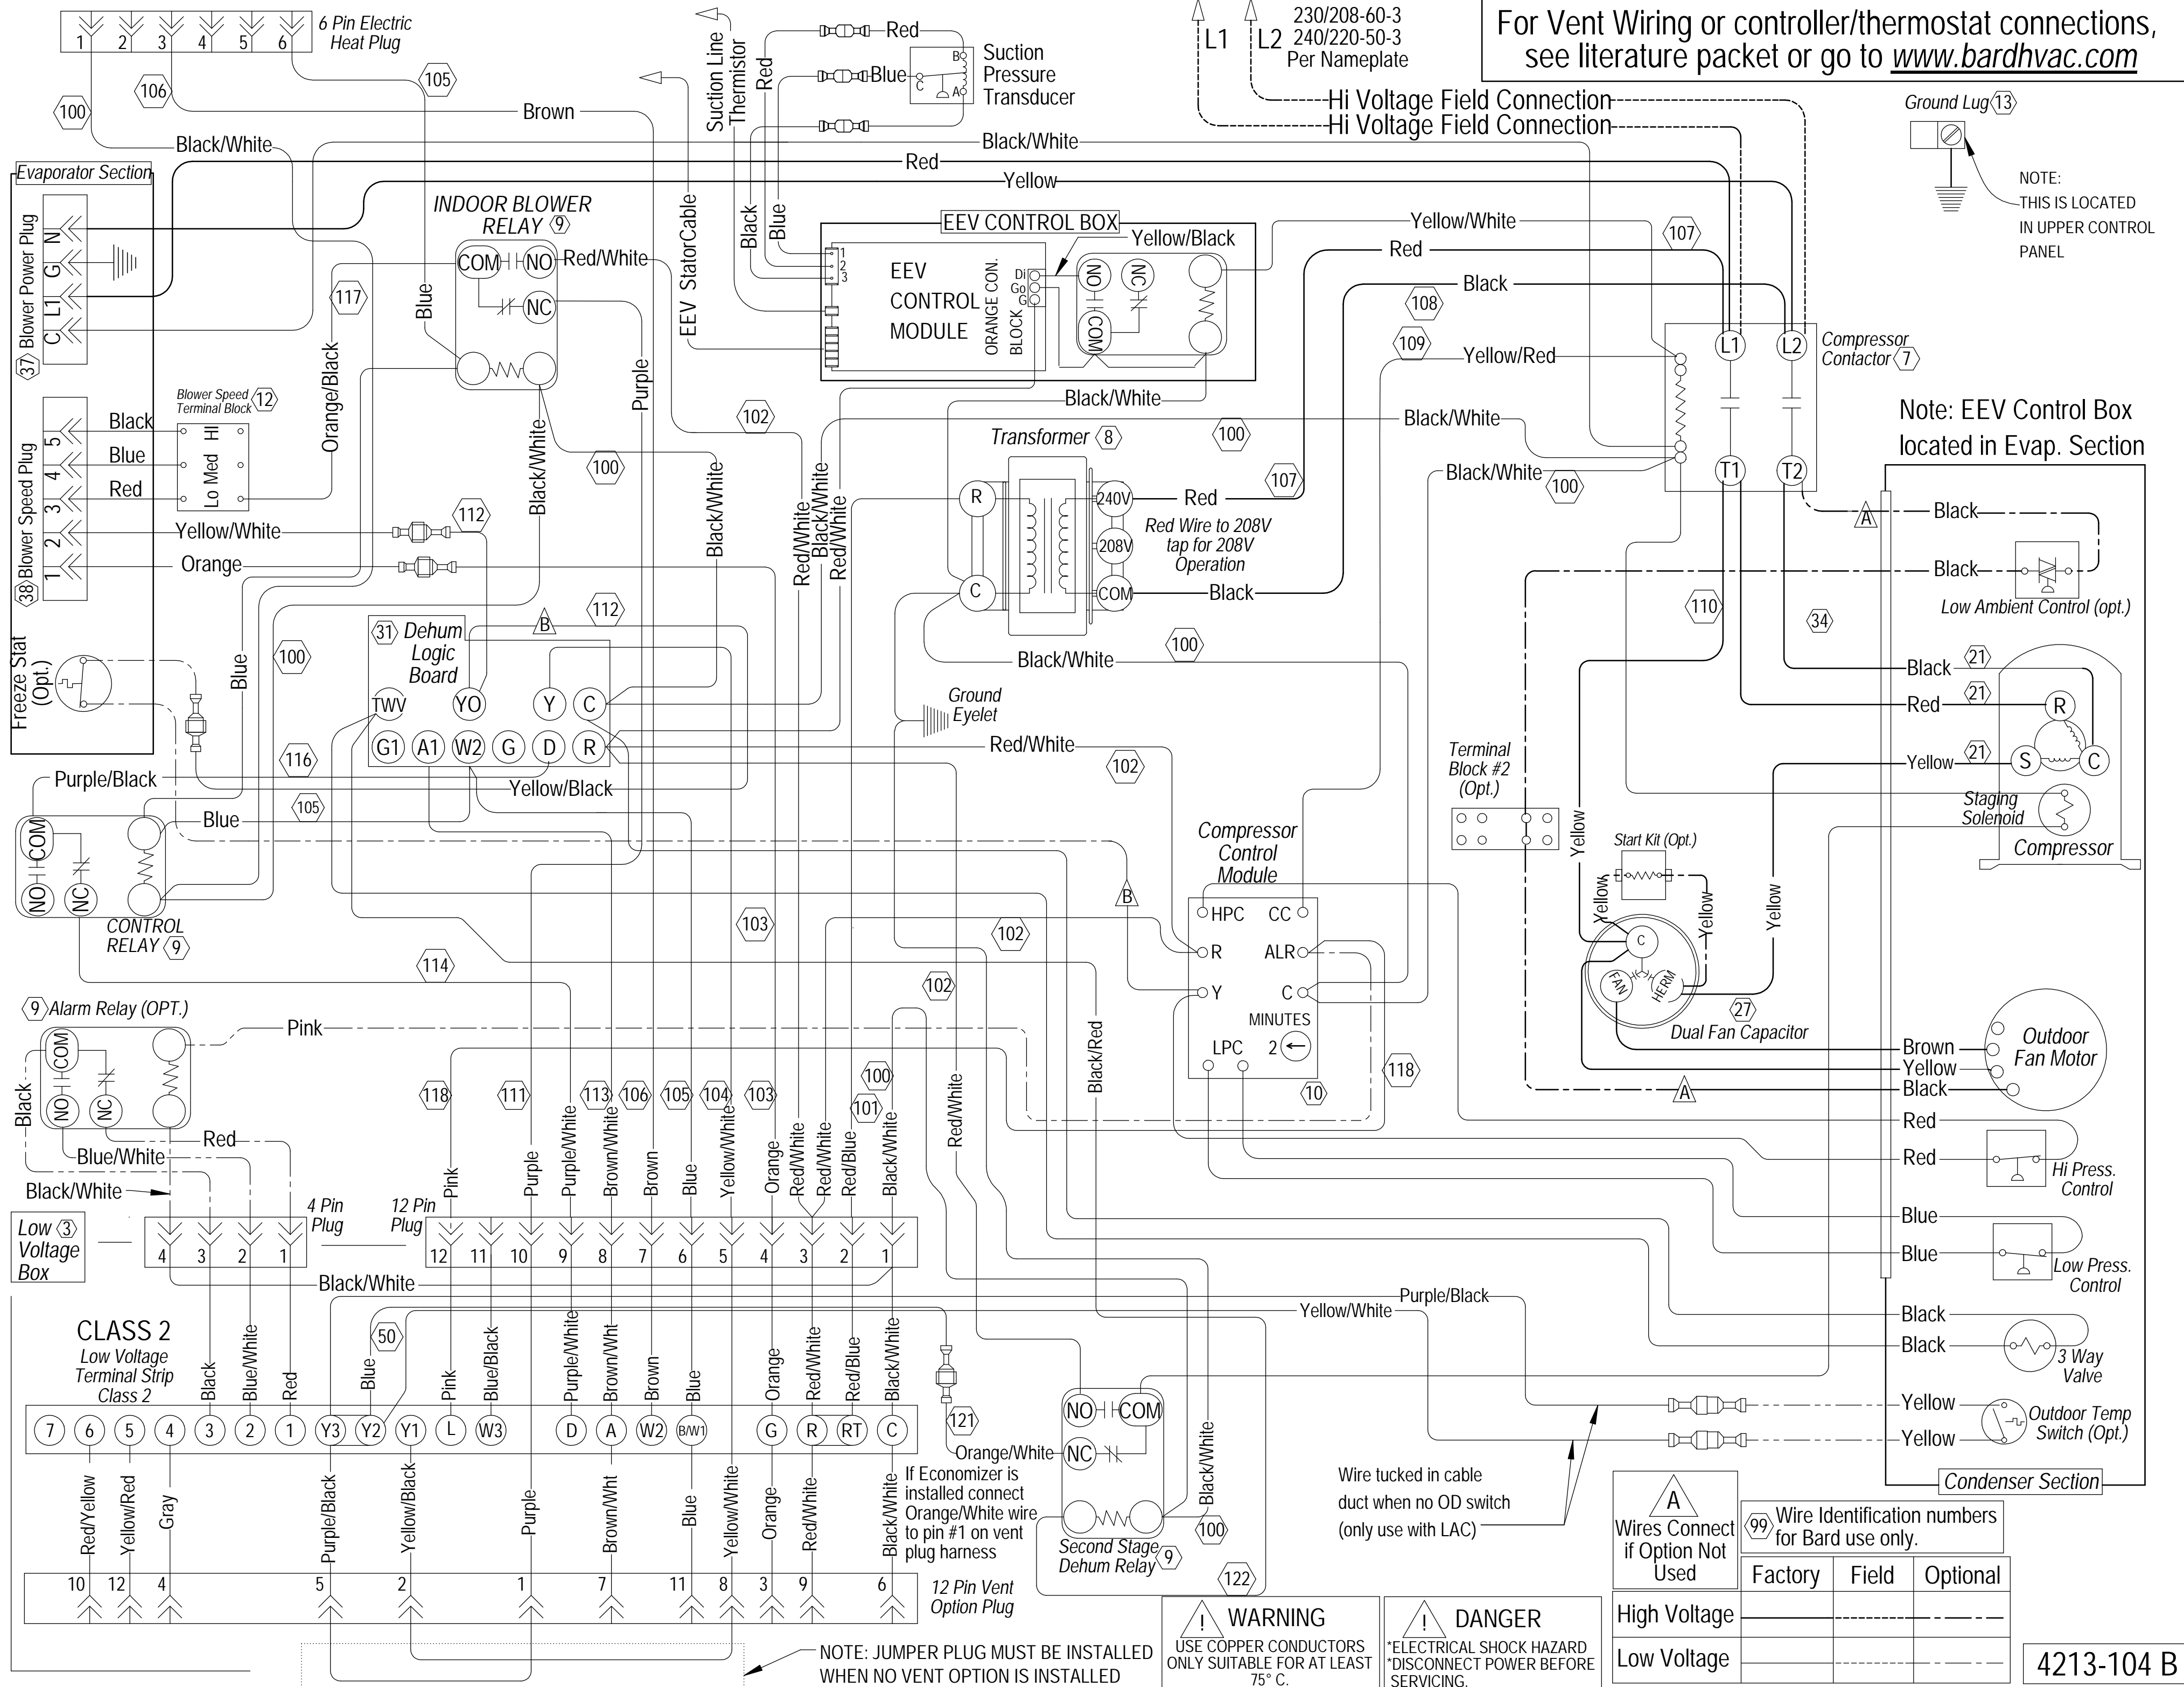

Wires Connect if Option Not Used	Wire Identification numbers for Bard use only.		
	Factory	Field	Optional
High Voltage			
Low Voltage			