

---

# INSTALLATION INSTRUCTIONS

---

## Drain Connection Kit 8620-160

---

This drain connection kit is designed for use on the following wall mount heat pump models:


W26H, W31H, W38H, W43H, W49H, W61H  
C24H, C30H, C36H, C42H, C48H, C60H

The kit contains a drain connection that will be attached to the bottom of the unit base. This connection will serve as the drain fitting for the outdoor coil to provide a piping connection for draining condensate water from the outdoor coil.

1. Using the screws provided, attach the fitting to the bottom of the unit as shown in Figure 1.
2. The condenser and evaporator drains can be connected together and run to a single drain.

Refer to page 2 for recommended drain connection.

FIGURE 1

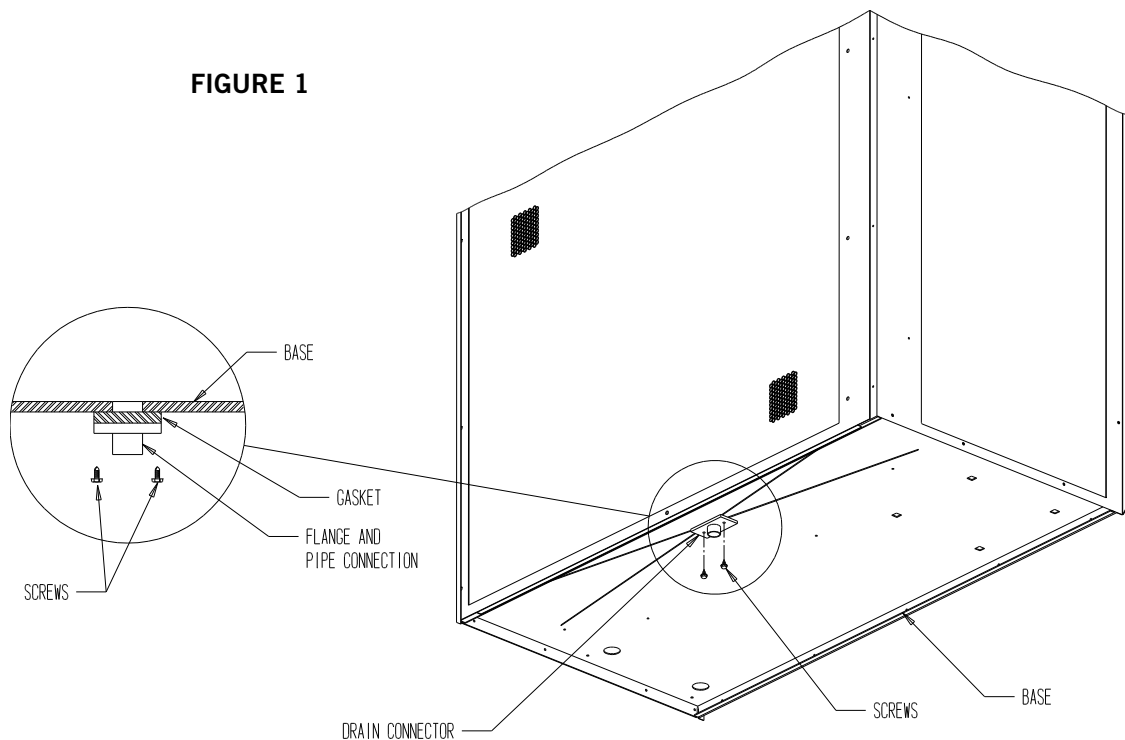

MIS-1277




Bard Manufacturing Company, Inc.  
Bryan, Ohio 43506  
[www.bardhvac.com](http://www.bardhvac.com)

Manual: 7960-432A  
Supersedes: 7960-432  
Date: 3-12-15

The recommended drain connection is that the condenser drain be routed to the evaporator drain hose and connected with a tee as shown in Figure 2. If this drain is to be connected to an existing drain system, it must be an open or vented type.

**FIGURE 2**

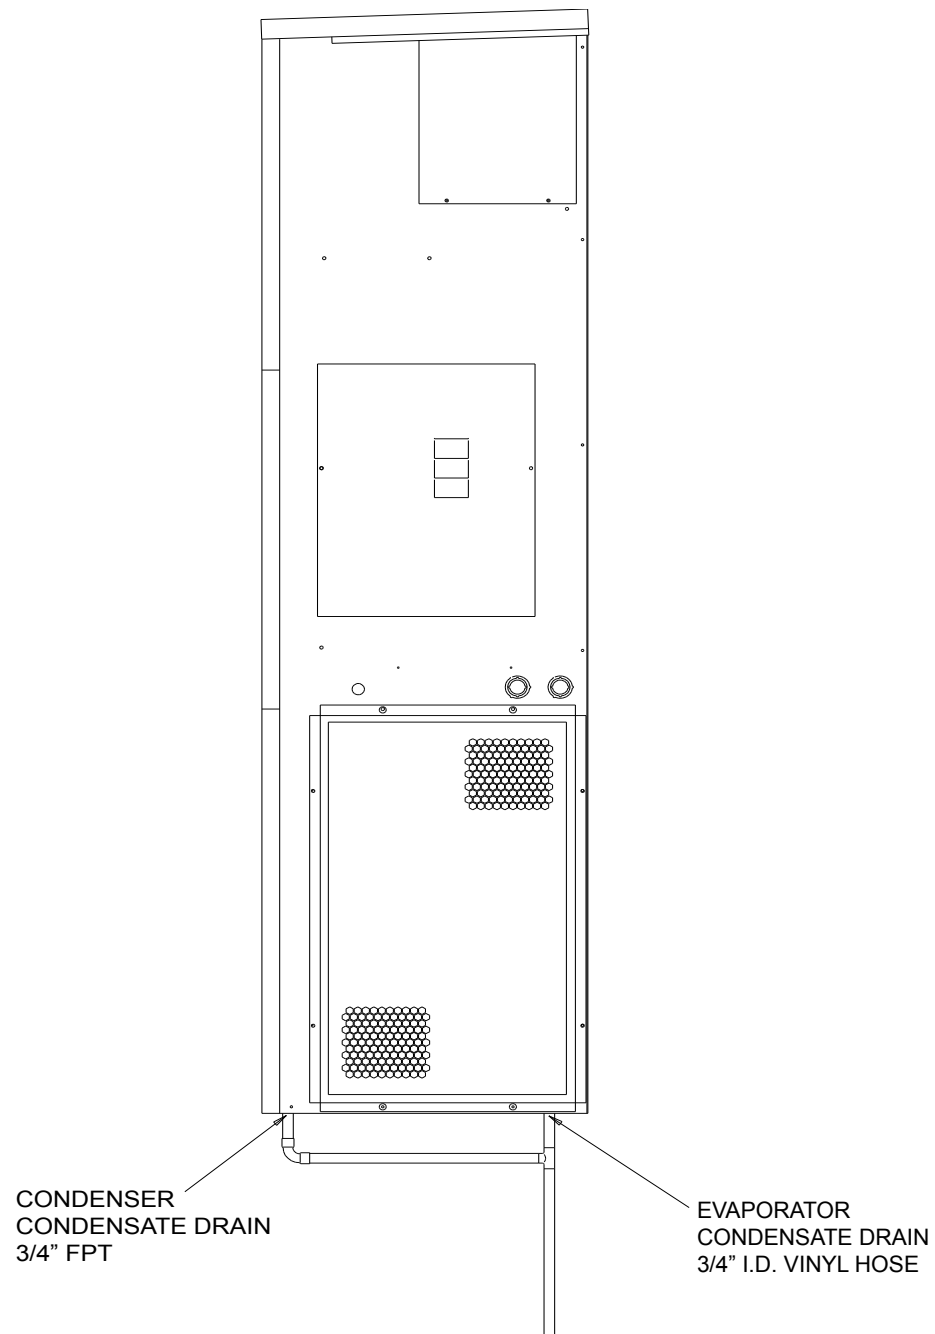

**MIS-1278**