


RG 14F1022 - 8404-011
 T874C1000 8403-014

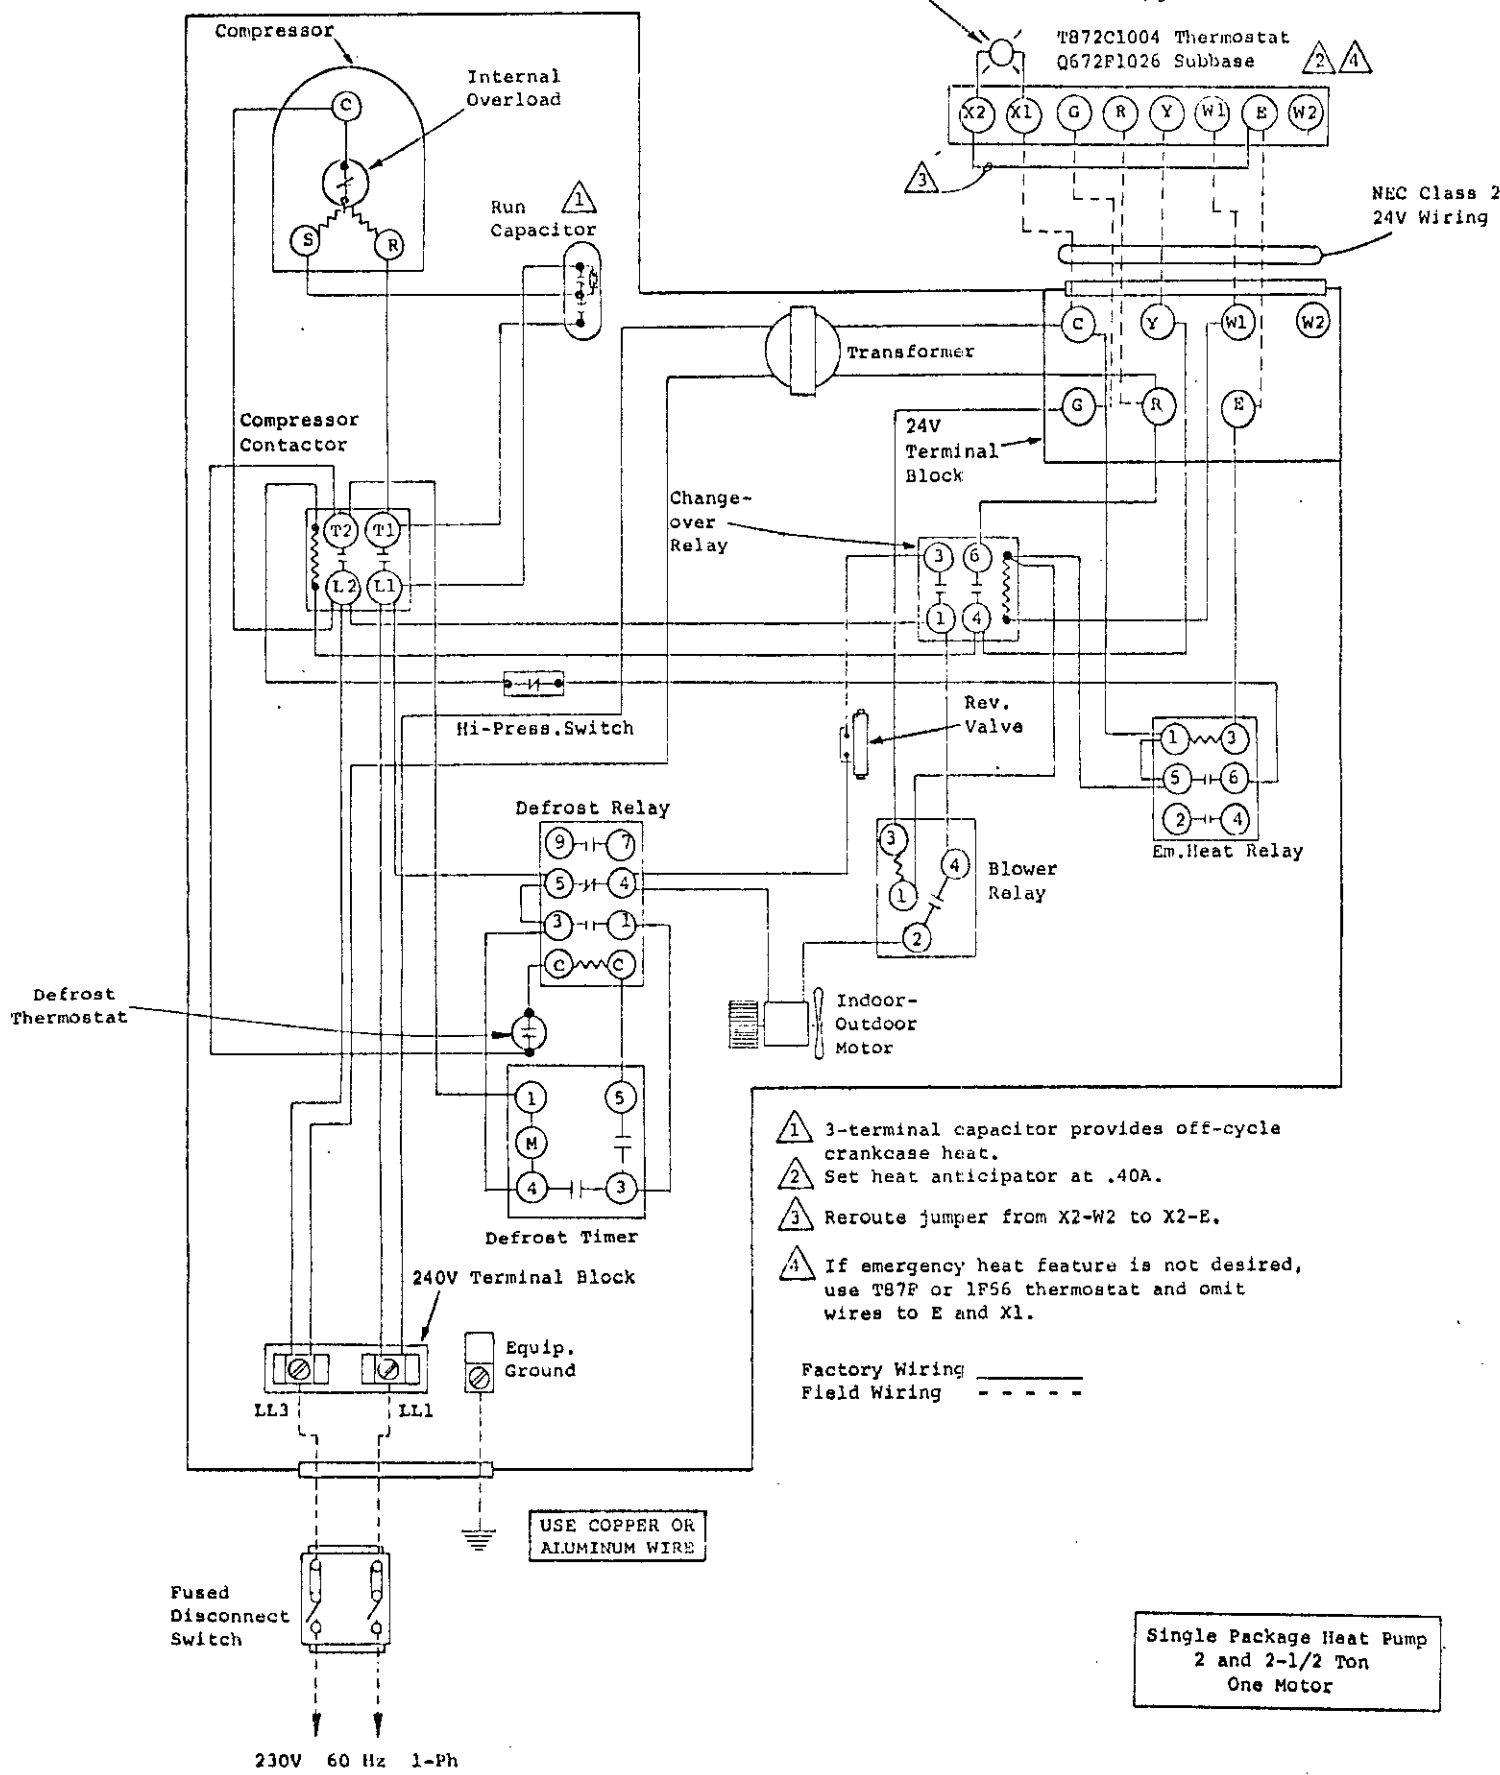

- 1 3-terminal capacitor provides off-cycle crankcase heat.
- 2 Set heat anticipator at .40A.
- 3 Reroute jumper from X2-W2 to X2-E.
- 4 If emergency heat feature is not desired, use T87F or 1F56 thermostat and omit wires to E and X1.

Factory Wiring _____
 Field Wiring - - - - -

Single Package Heat Pump
 2 and 2-1/2 Ton
 One Motor