


Use 8403-012 (T872R1164) thermostat and 8404-007 (Q672L1185) subbase combination or 8403-015 (T872N1036) thermostat and 8404-008 (Q672F1299) subbase combination. Consult installation manual for further details.

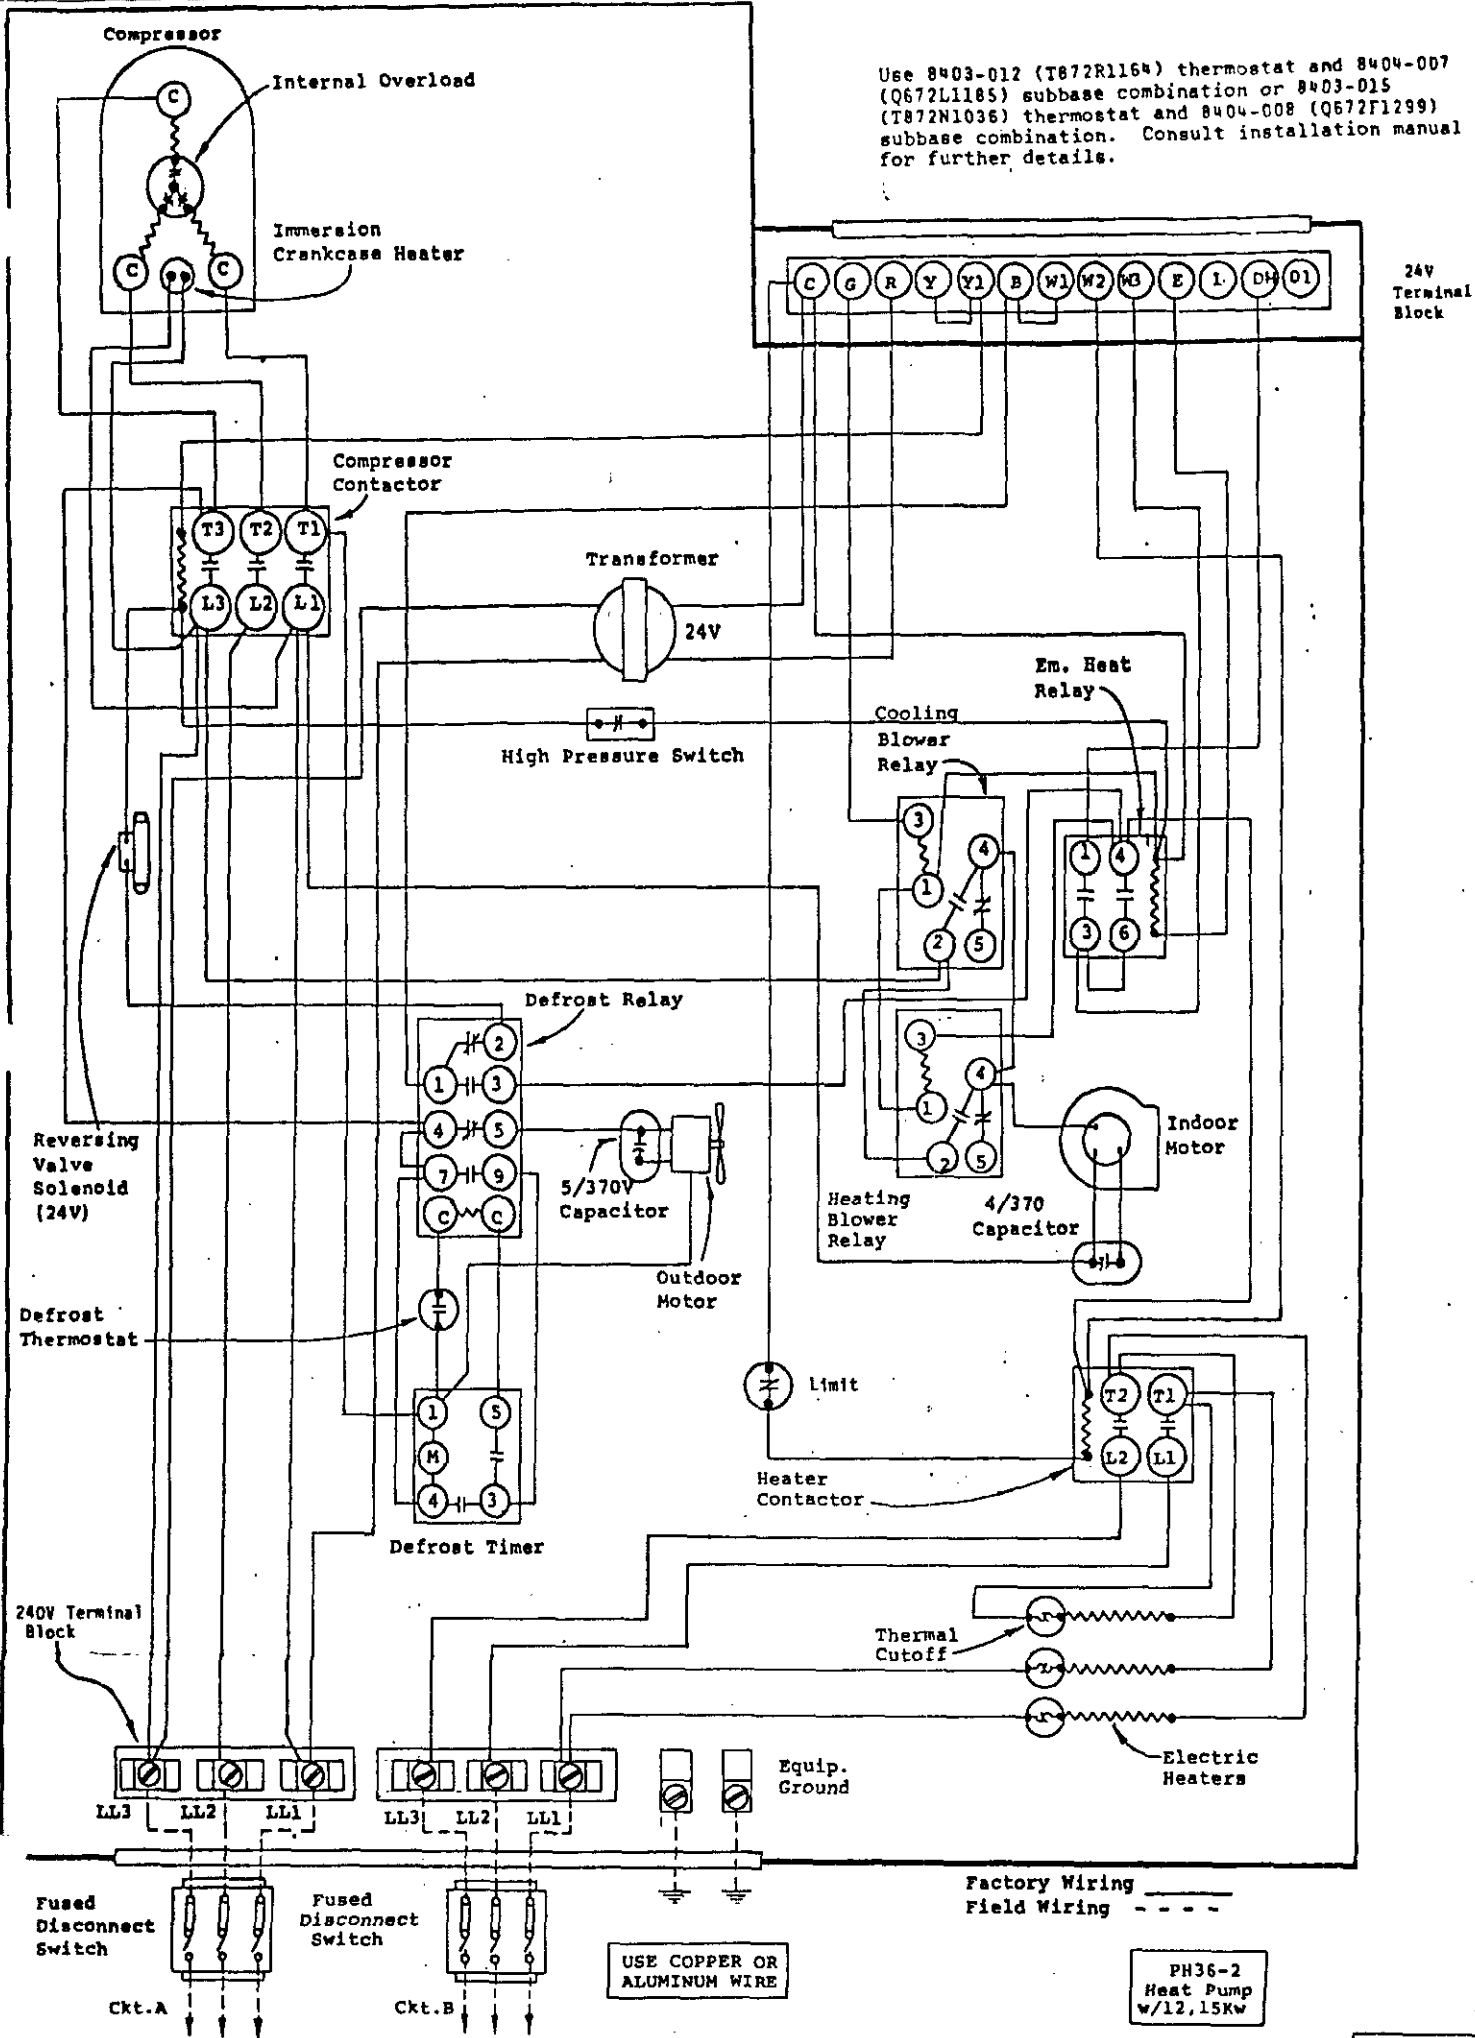

24V Terminal Block

Reversing Valve Solenoid (24V)

Defrost Thermostat

240V Terminal Block

LL3 LL2 LL1

LL3 LL2 LL1

Equip. Ground

Fused Disconnect Switch

Fused Disconnect Switch

Ckt. A

Ckt. B

USE COPPER OR ALUMINUM WIRE

Factory Wiring ———  
Field Wiring - - - -

PH36-2 Heat Pump w/12, 15kw