


Use 8403-012 (T872R1164) thermostat and 8404-007 (Q672L1185) subbase combination or 8403-015 (T872N1036) thermostat and 8404-008 (Q672F1299) subbase combination. Consult installation manual for further details.

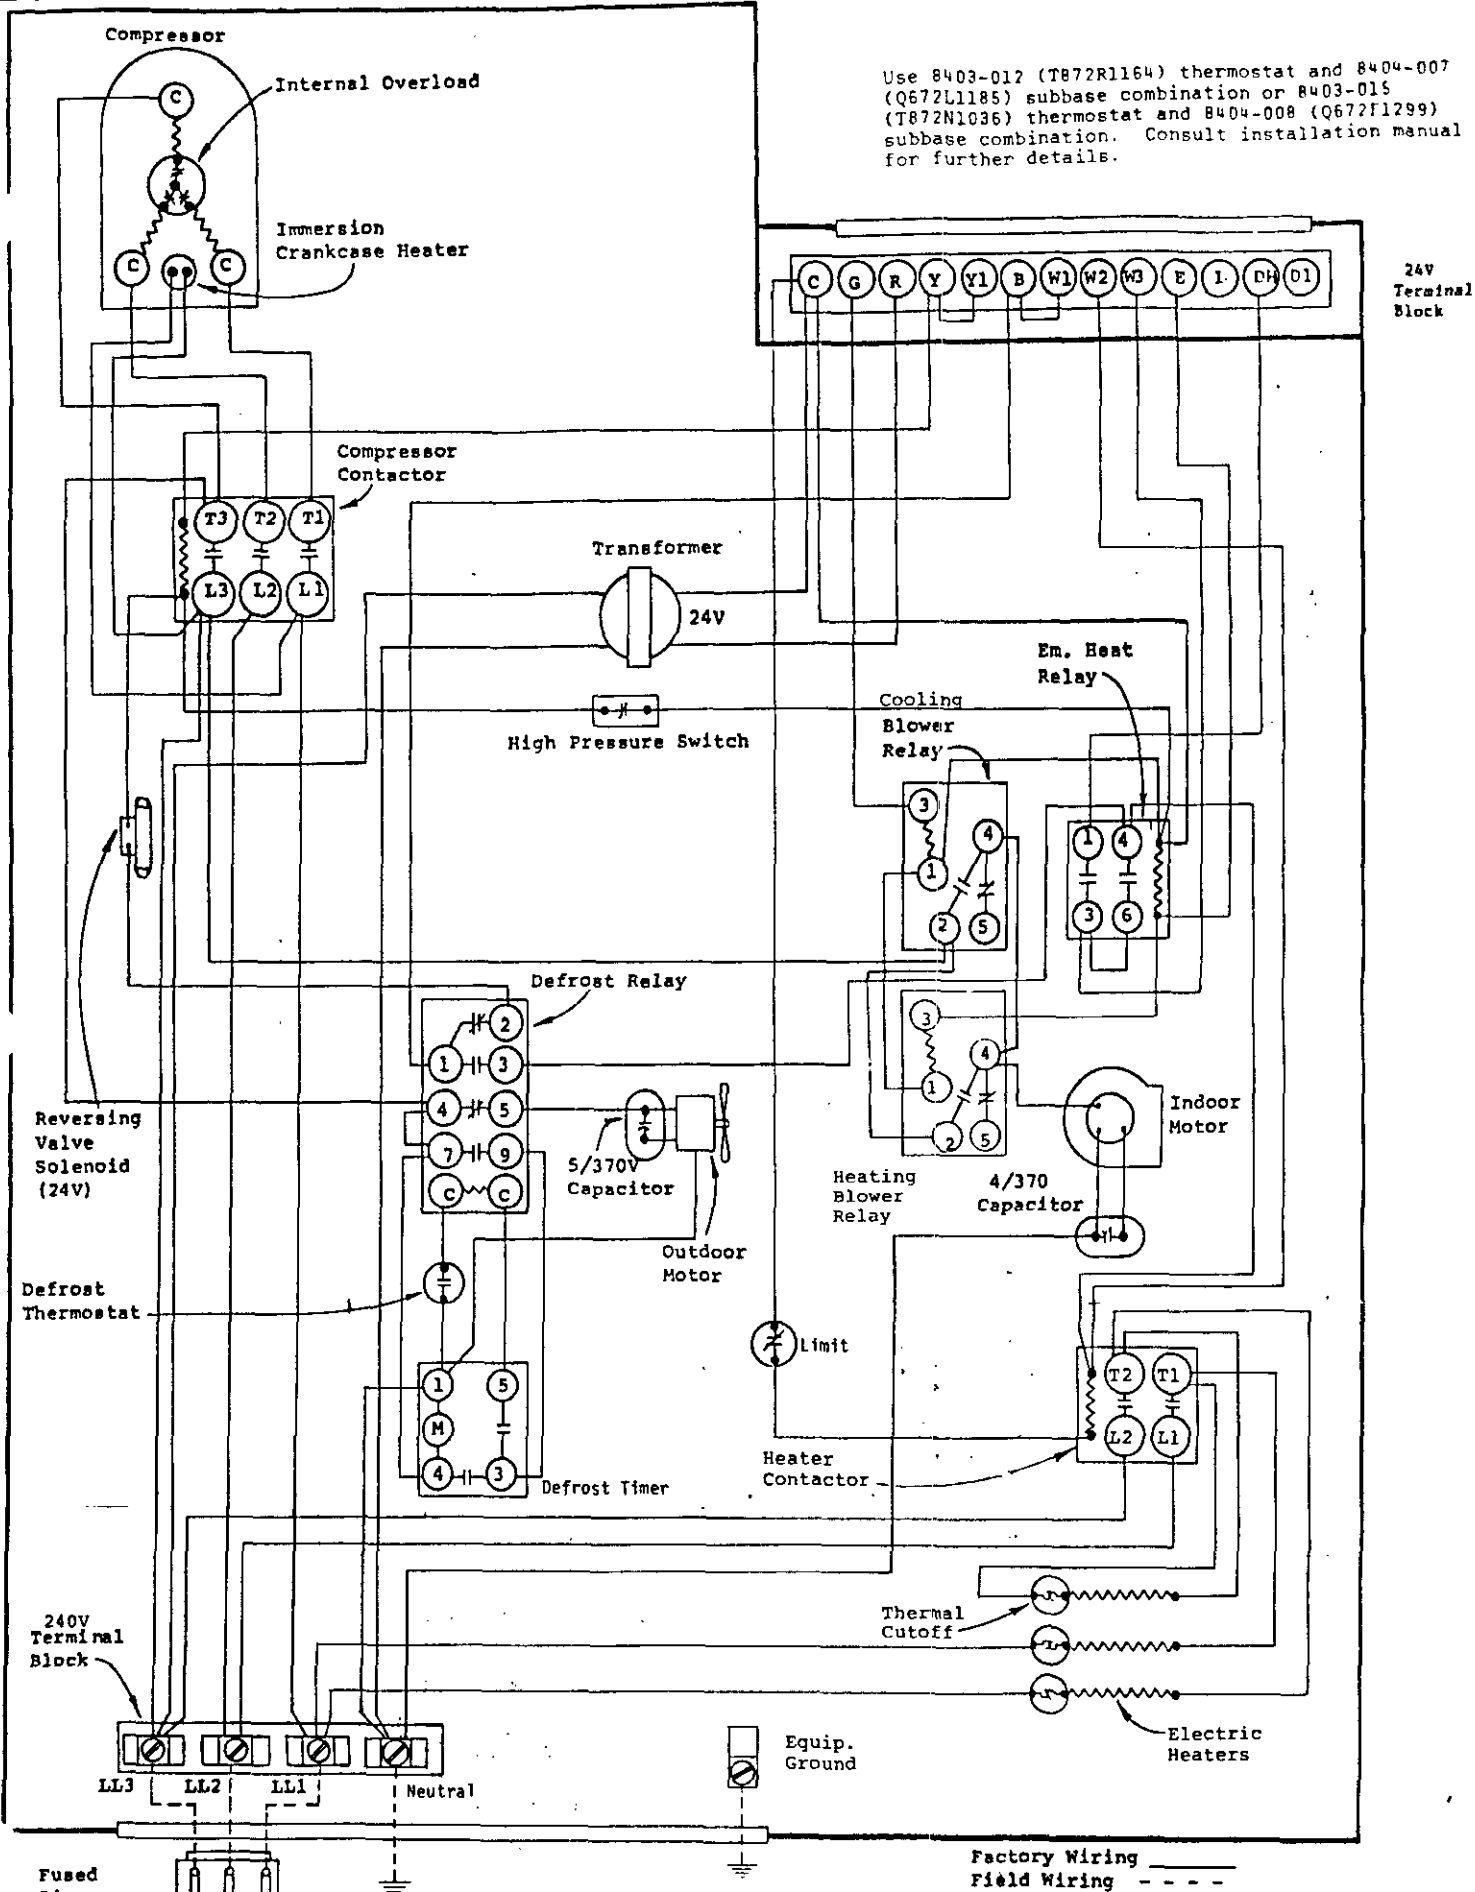

24V Terminal Block

Reversing Valve Solenoid (24V)
Defrost Thermostat

24V Terminal Block

LL3 LL2 LL1 Neutral

Fused Disconnect Switch

USE COPPER OR ALUMINUM WIRE

PH36-2 Heat Pump w/6.75,9,11.25 kw