


PH36-2 (Q672L1185) subbase combination or R-03-015 (T872N1036) thermostat and R404-008 (Q672F1299) subbase combination. Consult installation manual for further details.

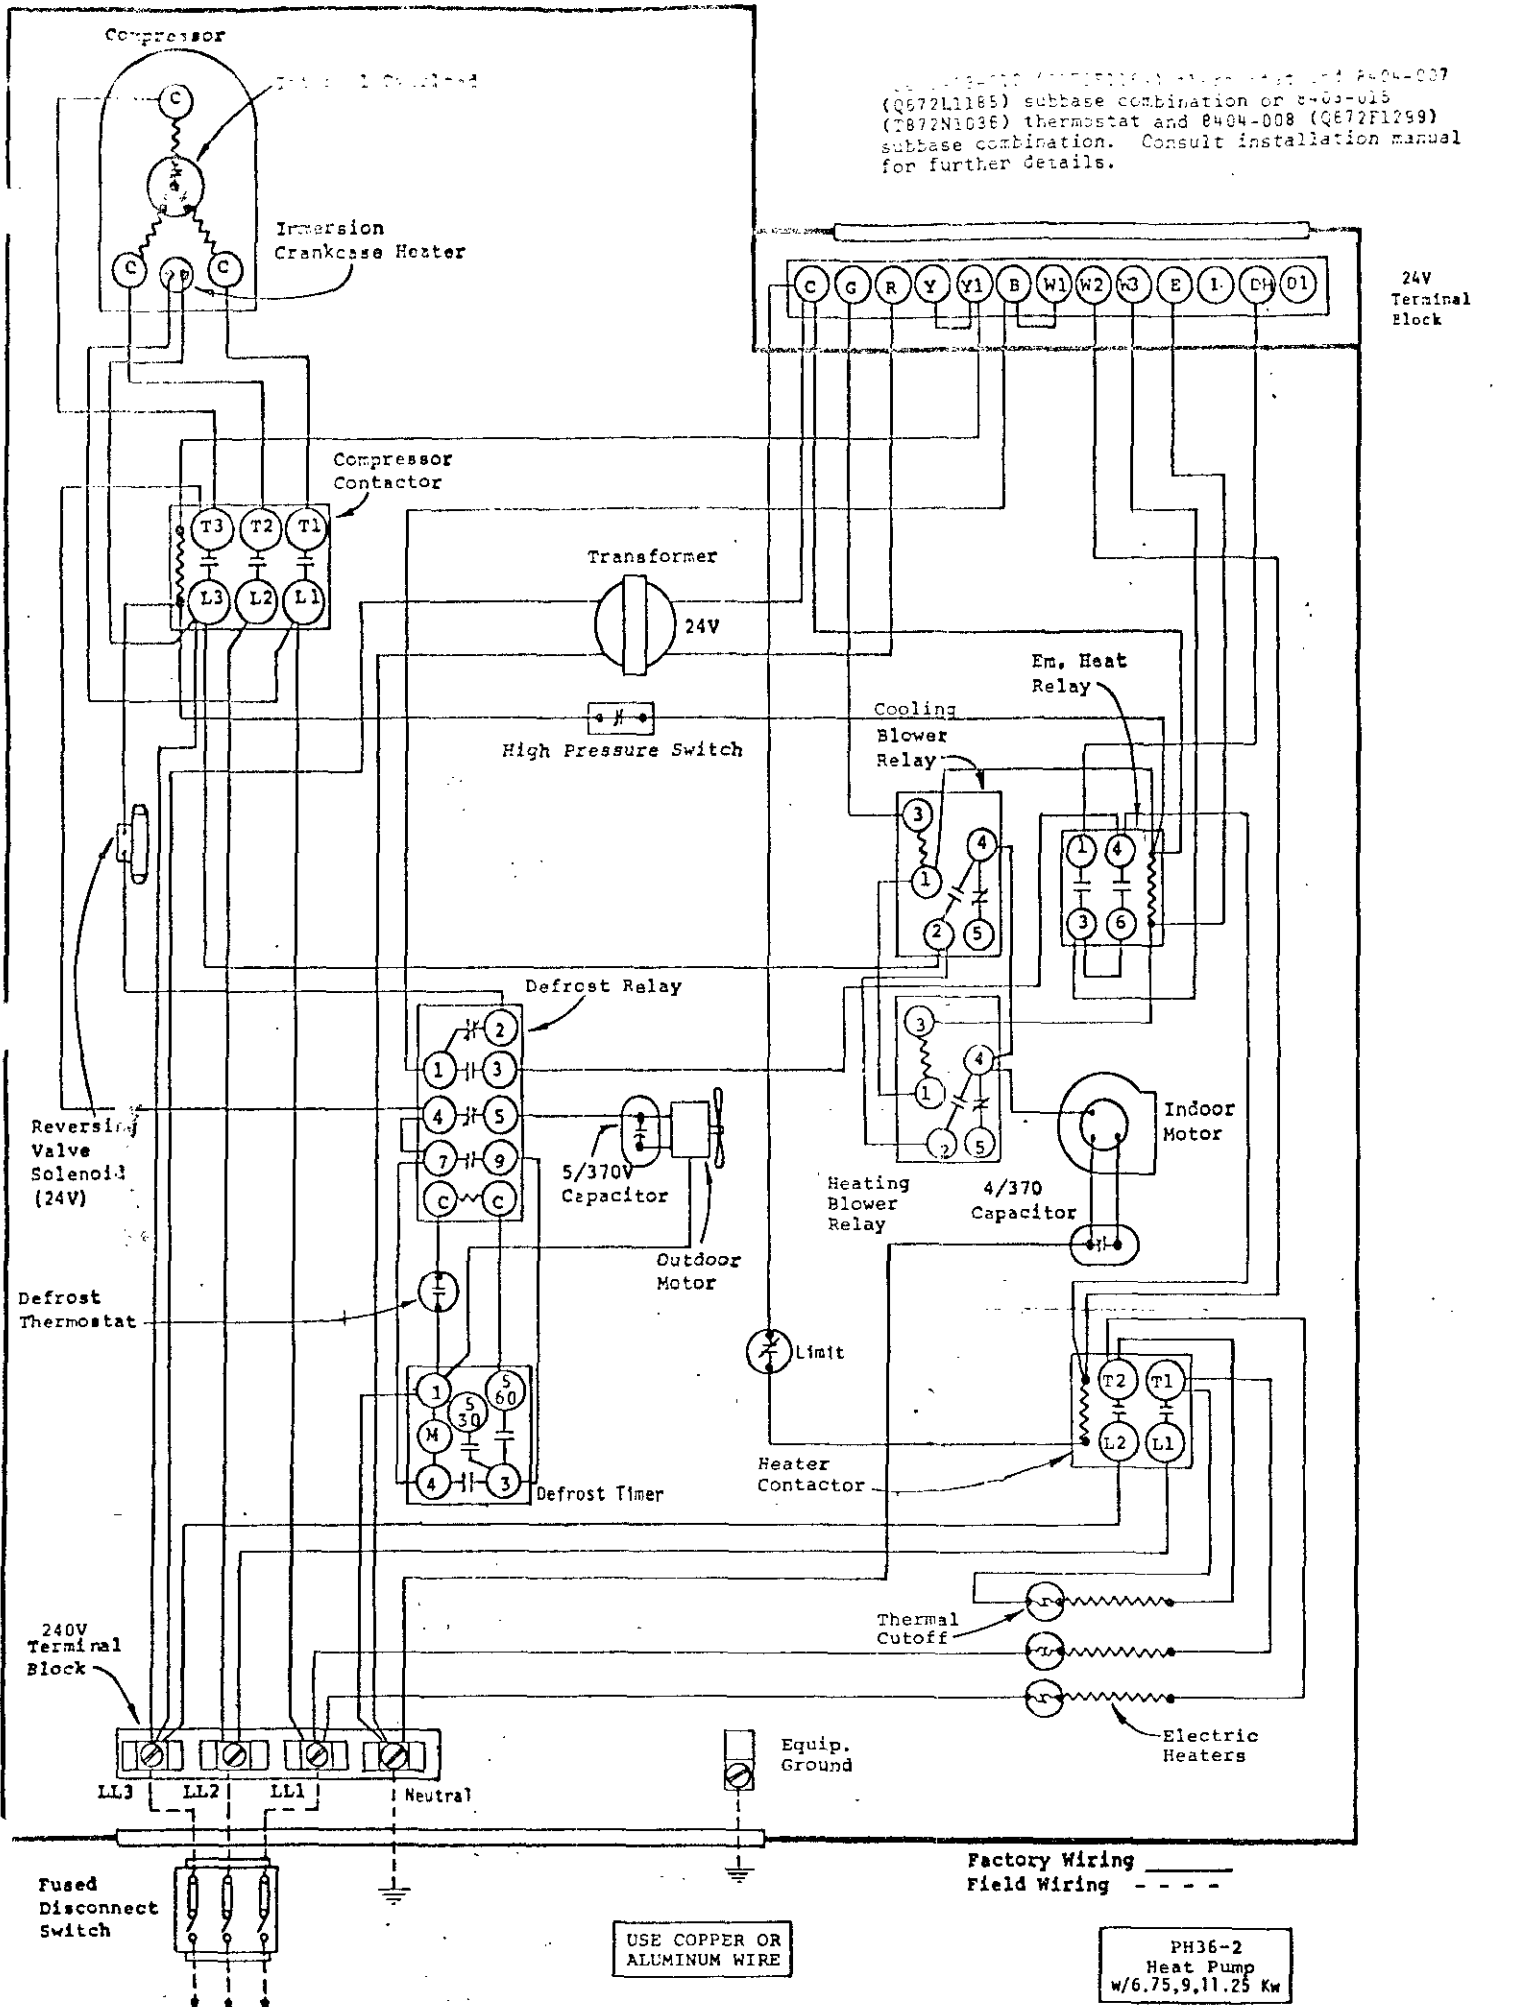

24V Terminal Block

Reversing Valve Solenoid (24V)

Defrost Thermostat

240V Terminal Block

Fused Disconnect Switch

LL3 LL2 LL1 Neutral

USE COPPER OR ALUMINUM WIRE

PH36-2 Heat Pump w/6.75,9,11.25 Kw