

Emergency Signal Light

T872C1004 Thermostat  
Q672F1026 Subbase

NEC Class 2  
24V Wiring

24V  
Terminal Block

Compressor

Immersion  
Crankcase  
Heater

Internal  
Overload

Transformer

Hi-Press.Sw.

Compressor  
Contactor

Changeover  
Relay

Outdoor  
Motor

10/370  
Capacitor

Defrost  
Thermo-  
stat

Defrost  
Relay

Reversing  
Valve

Em. Heat  
Relay

Blower  
Relay

6/370  
Capacitor

Indoor  
Motor

Equip.  
Ground

LL3 LL2 LL1 Neut.

4 3  
M 1  
Timer

1 Reroute jumper from X2-W2 to X2-E.

2 Set heat anticipators at .40A


USE COPPER OR  
ALUMINUM WIRE

415/380-50-3

Single Package  
Heat Pump  
4 and 5 Ton

Factory Wiring \_\_\_\_\_  
Field Wiring - - - - -

4006-610C

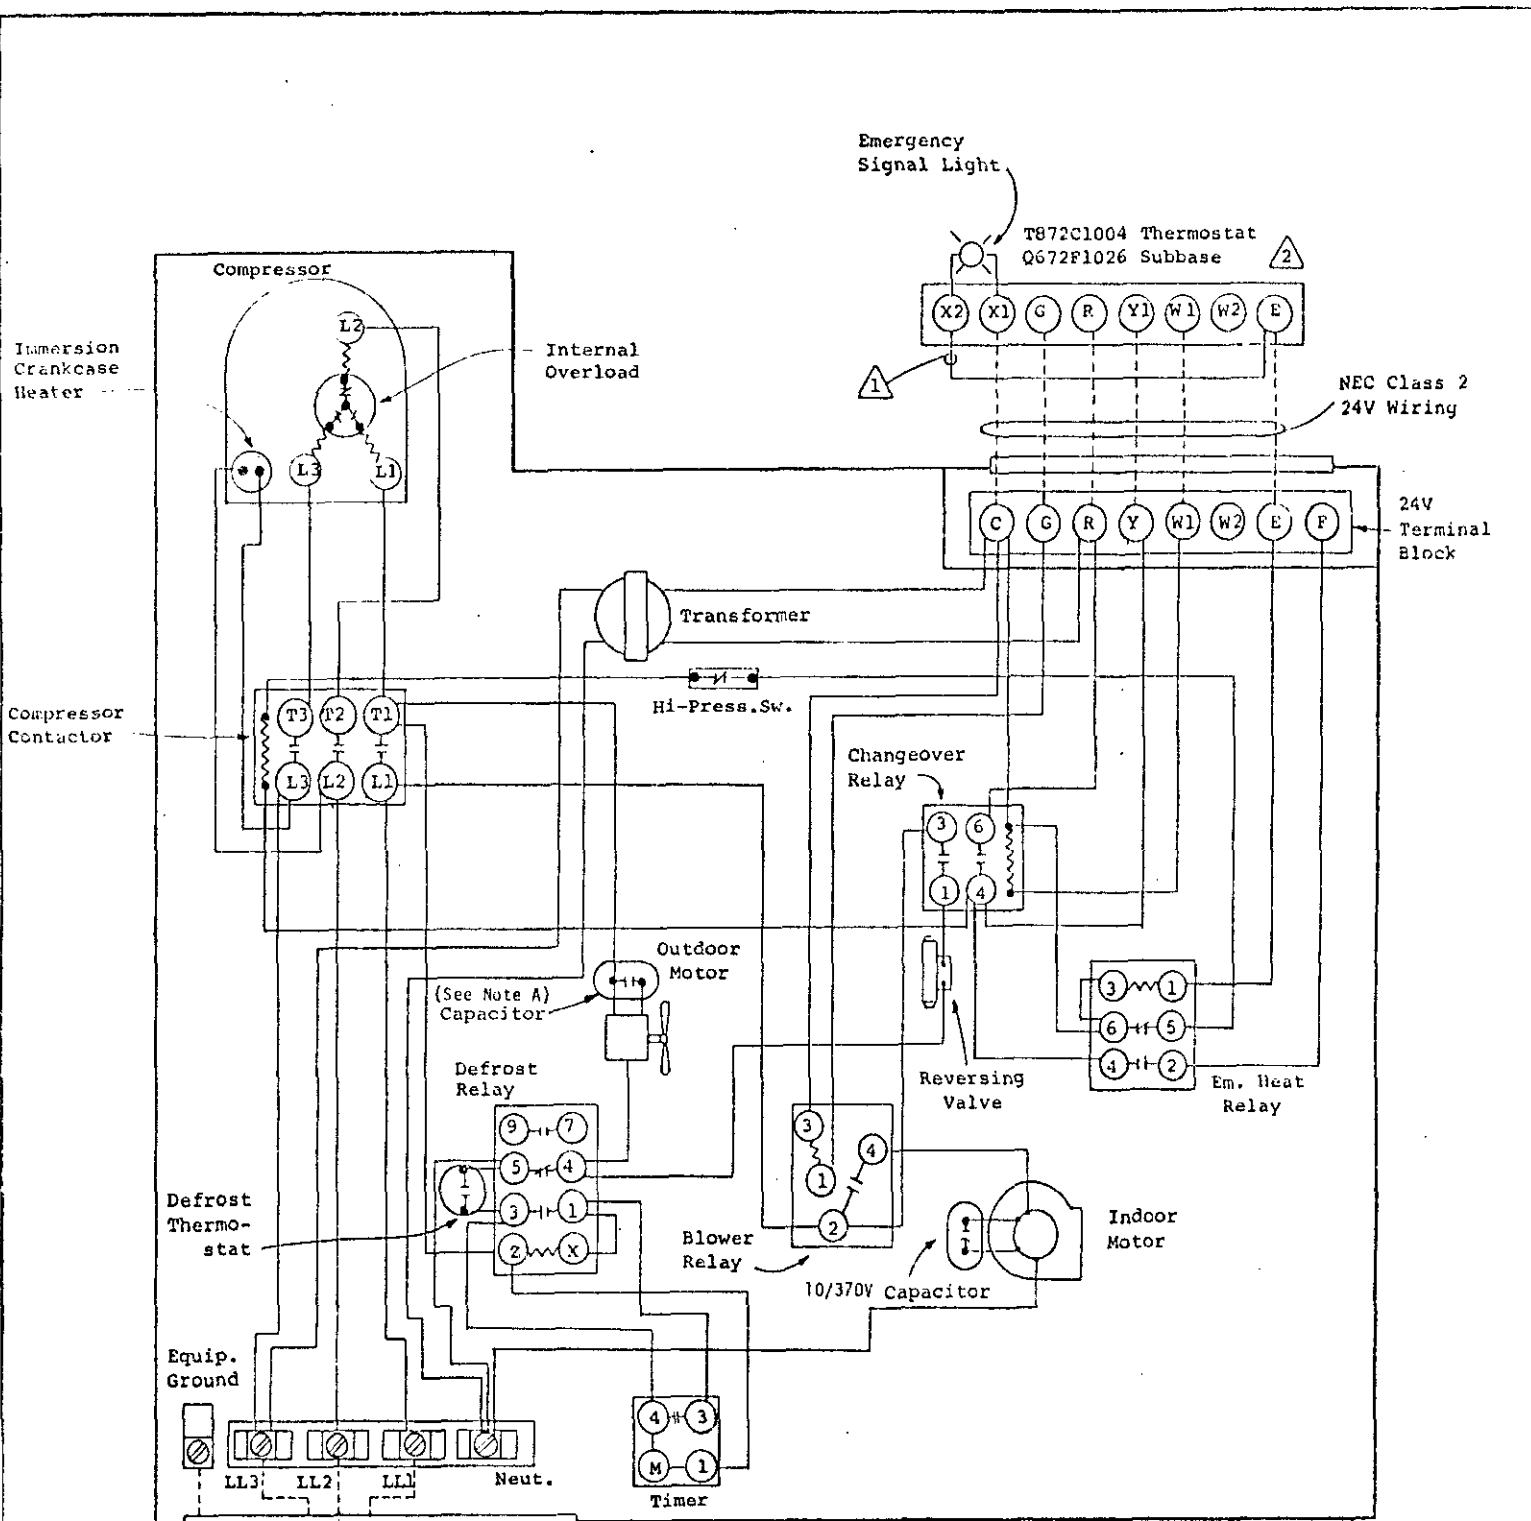

USE COPPER OR ALUMINUM WIRE


#15/380-50-3

- ⚠ Reroute jumper from X2-W2 to X2-E.
- ⚠ Set heat anticipators at .40A

NOTE A: 4 Ton Capacitor - 15/370V  
5 Ton Capacitor - 7½/370V

Single Package Heat Pump 4 and 5 Ton

Factory Wiring ———  
Field Wiring - - - - -

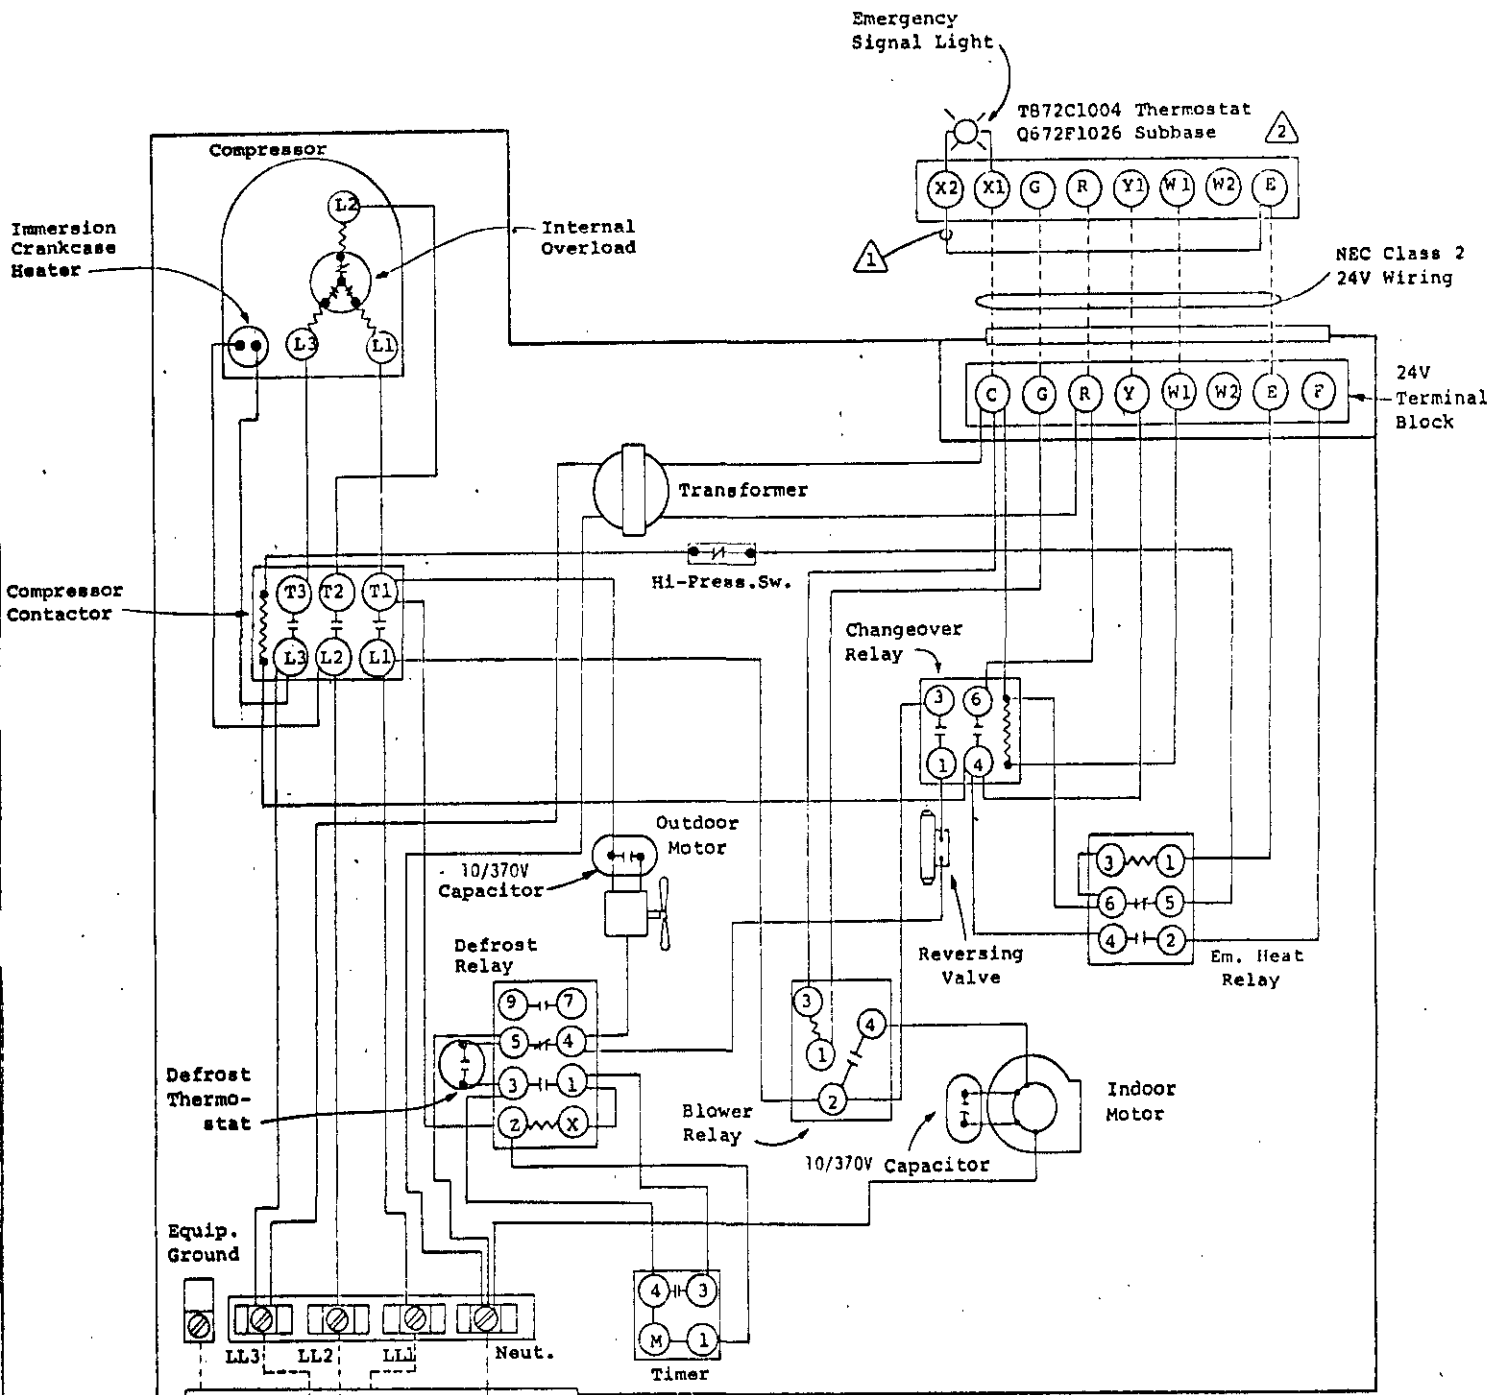


- ⚠ 1 Reroute jumper from X2-W2 to X2-E.
- ⚠ 2 Set heat anticipators at .40A

USE COPPER OR ALUMINUM WIRE

415/380-50-3

Single Package Heat Pump  
4 and 5 Ton

Factory Wiring ———  
Field Wiring - - - - -

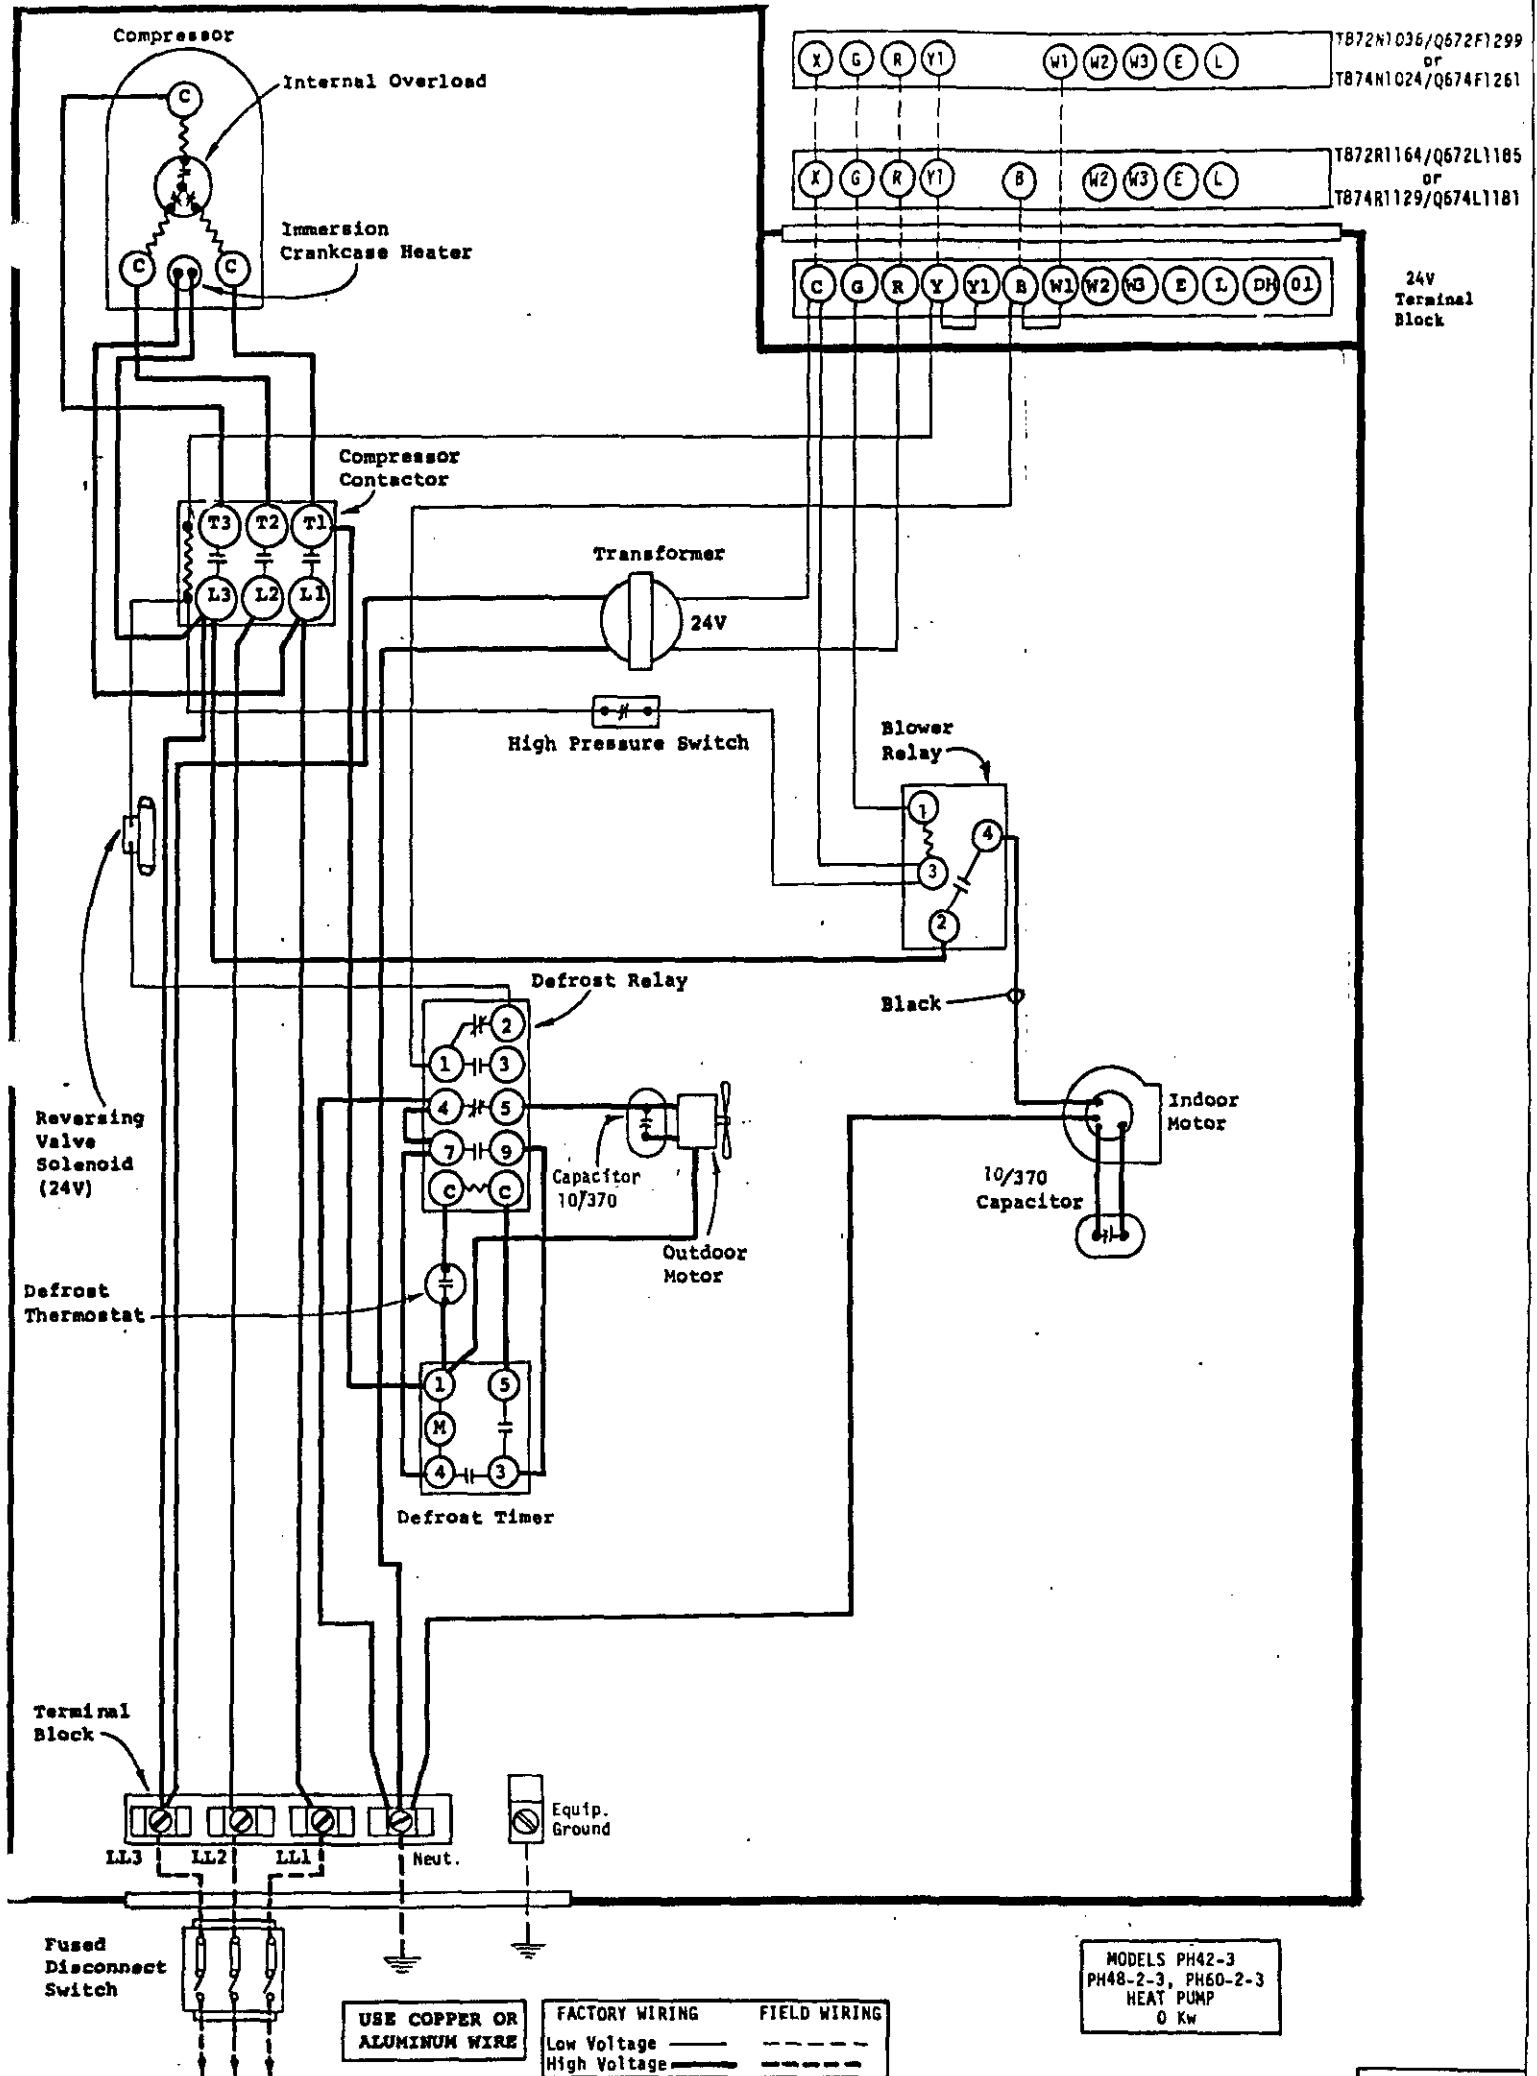


T872N1036/Q672F1299  
or  
T874N1024/Q674F1261

T872R1164/Q672L1165  
or  
T874R1129/Q674L1181

24V  
Terminal  
Block


MODELS PH42-3  
PH48-2-3, PH60-2-3  
HEAT PUMP  
0 Kw

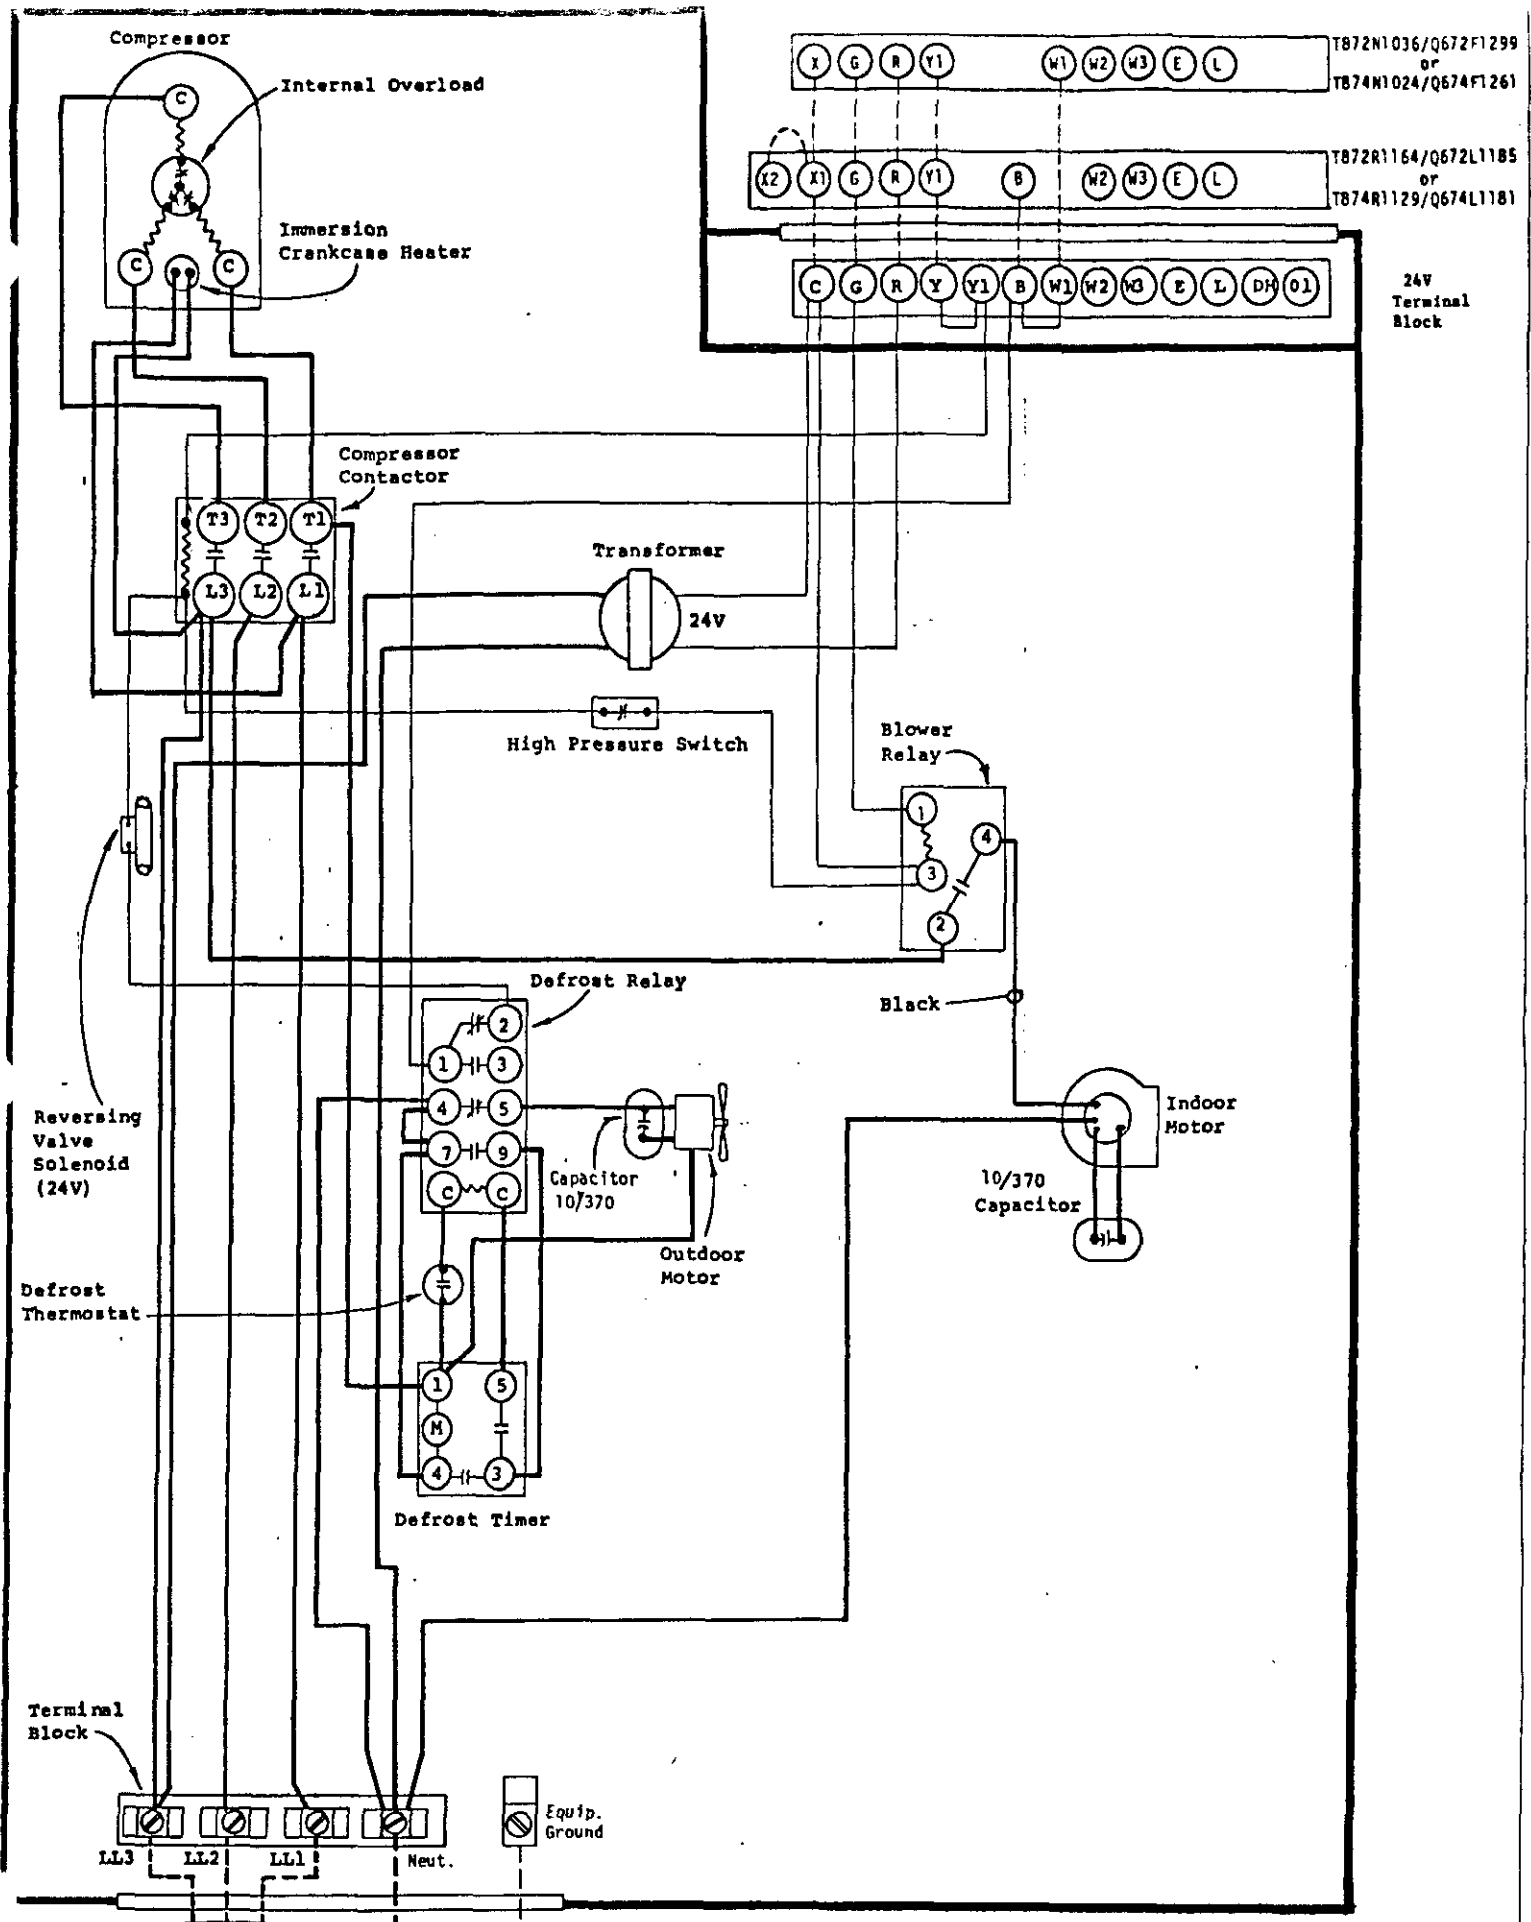

USE COPPER OR ALUMINUM WIRE

	FACTORY WIRING	FIELD WIRING
Low Voltage	—————	- - - - -
High Voltage	—————	- - - - -

MODELS PH42-3  
PH48-2-3, PH60-2-3  
HEAT PUMP  
0 Kw

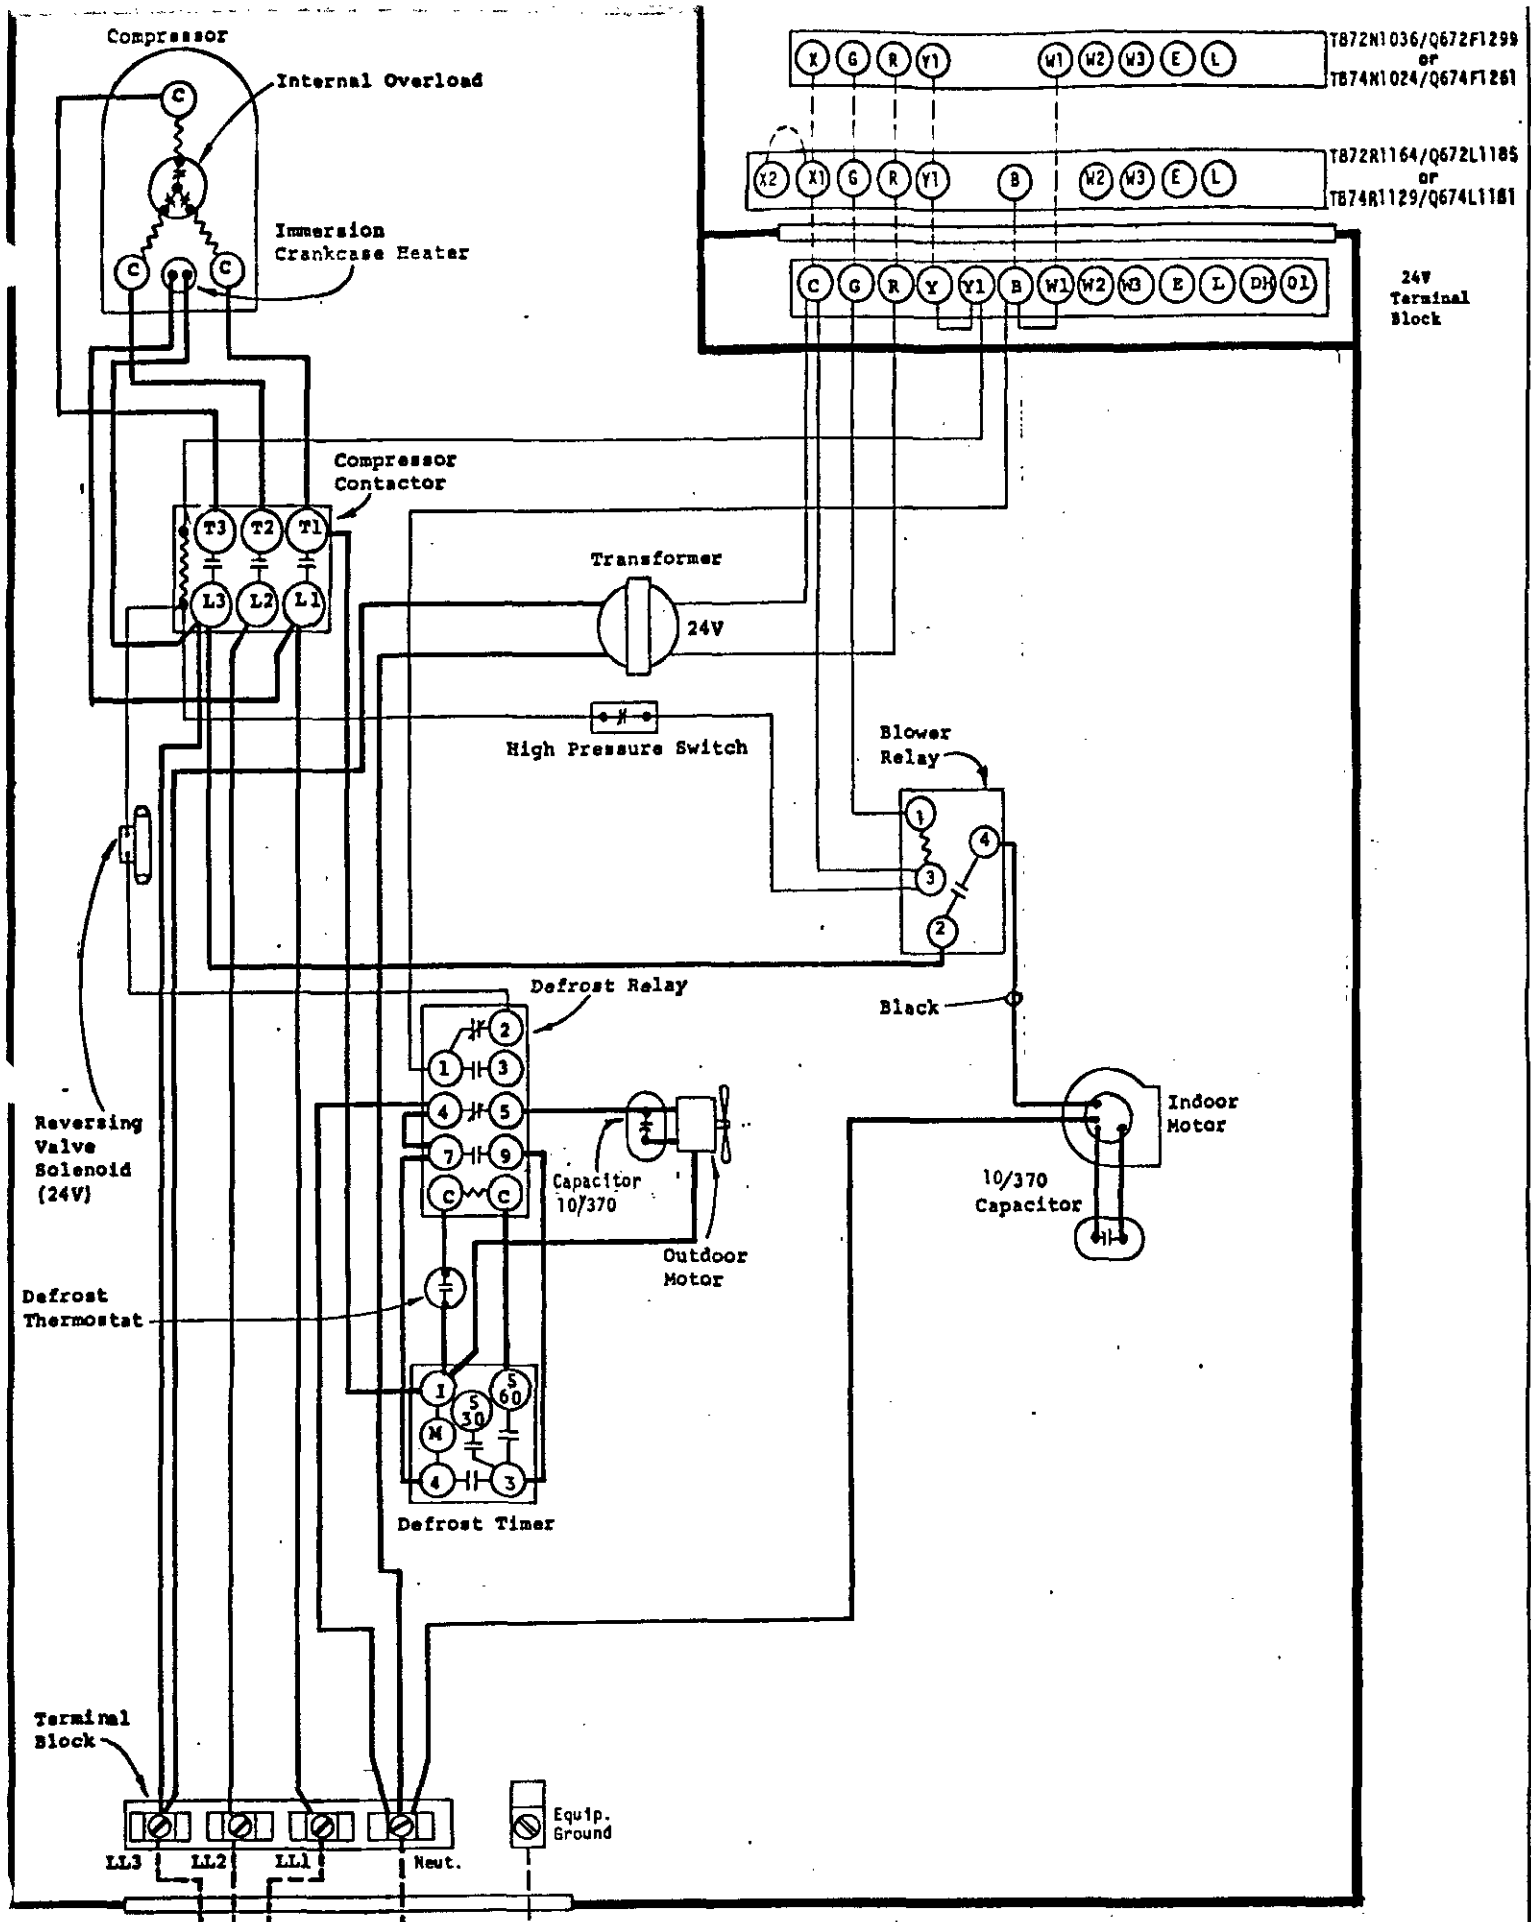

T872N1036/Q672F1299  
or  
T874N1024/Q674F1261


T872R1164/Q672L1185  
or  
T874R1129/Q674L1181

24V  
Terminal  
Block

MODELS PH42-3  
PH48-2-3, PH60-2-3  
HEAT PUMP  
0 Kw

**USE COPPER OR ALUMINUM WIRE**

	FACTORY WIRING	FIELD WIRING
Low Voltage	—————	-----
High Voltage	—————	-----

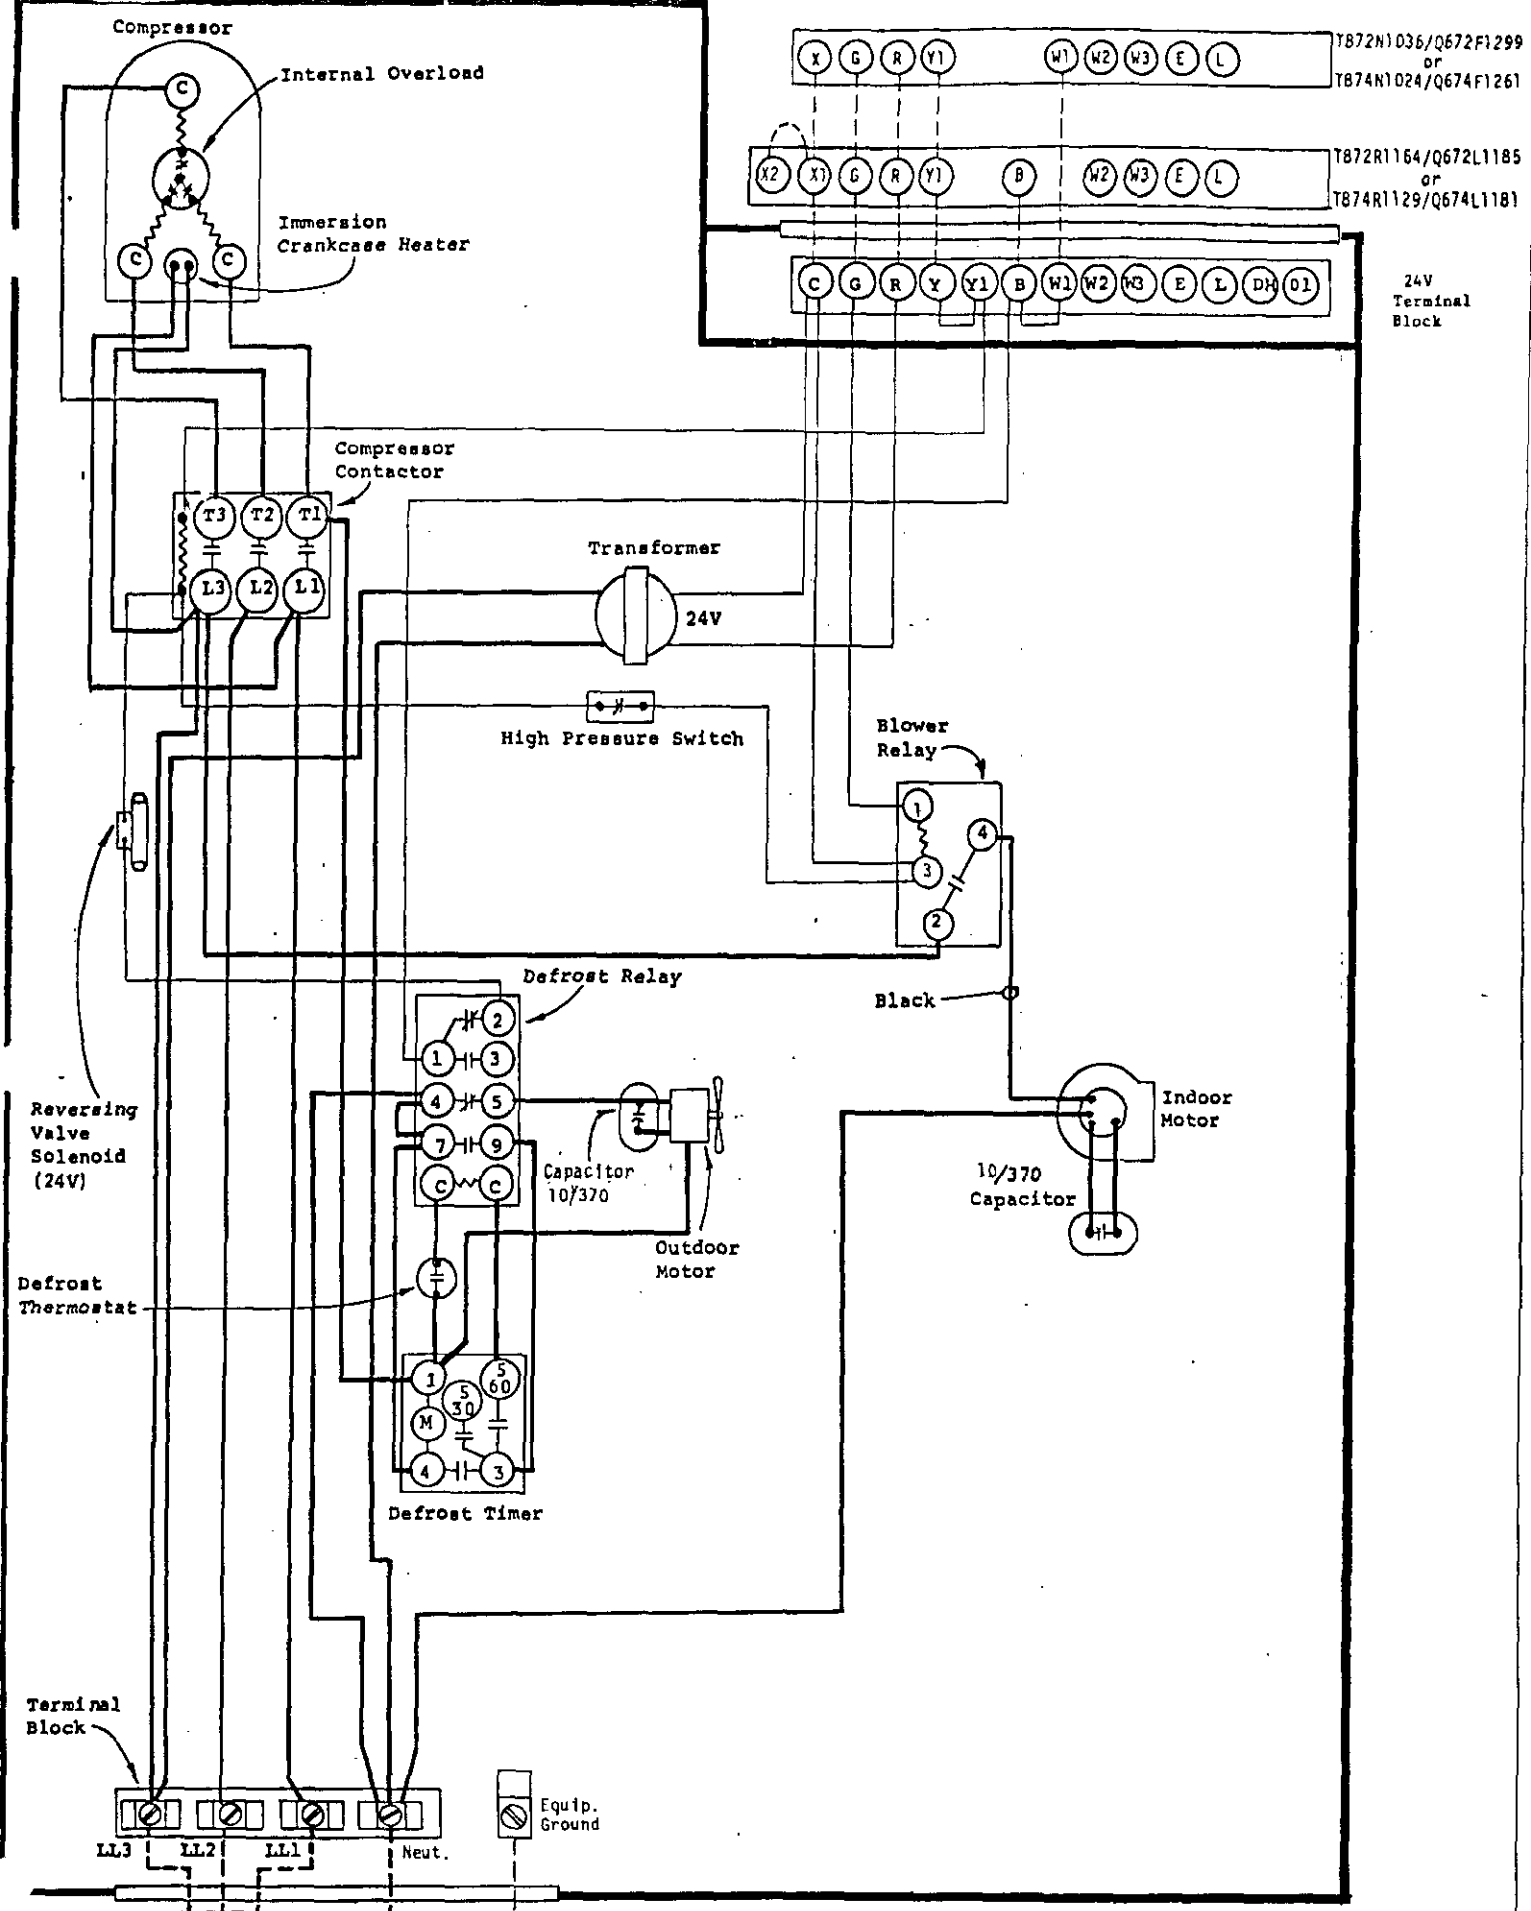

**USE COPPER OR ALUMINUM WIRE**

	FACTORY WIRING	FIELD WIRING
Low Voltage	—————	- - - - -
High Voltage	—————	- - - - -

MODELS PH42-3  
PH48-2-3, PH60-4-3  
HEAT PUMP  
0 Kw