


CHART A	
MODEL	CAPACITOR
20WA2	30/370
24WA5	35/370

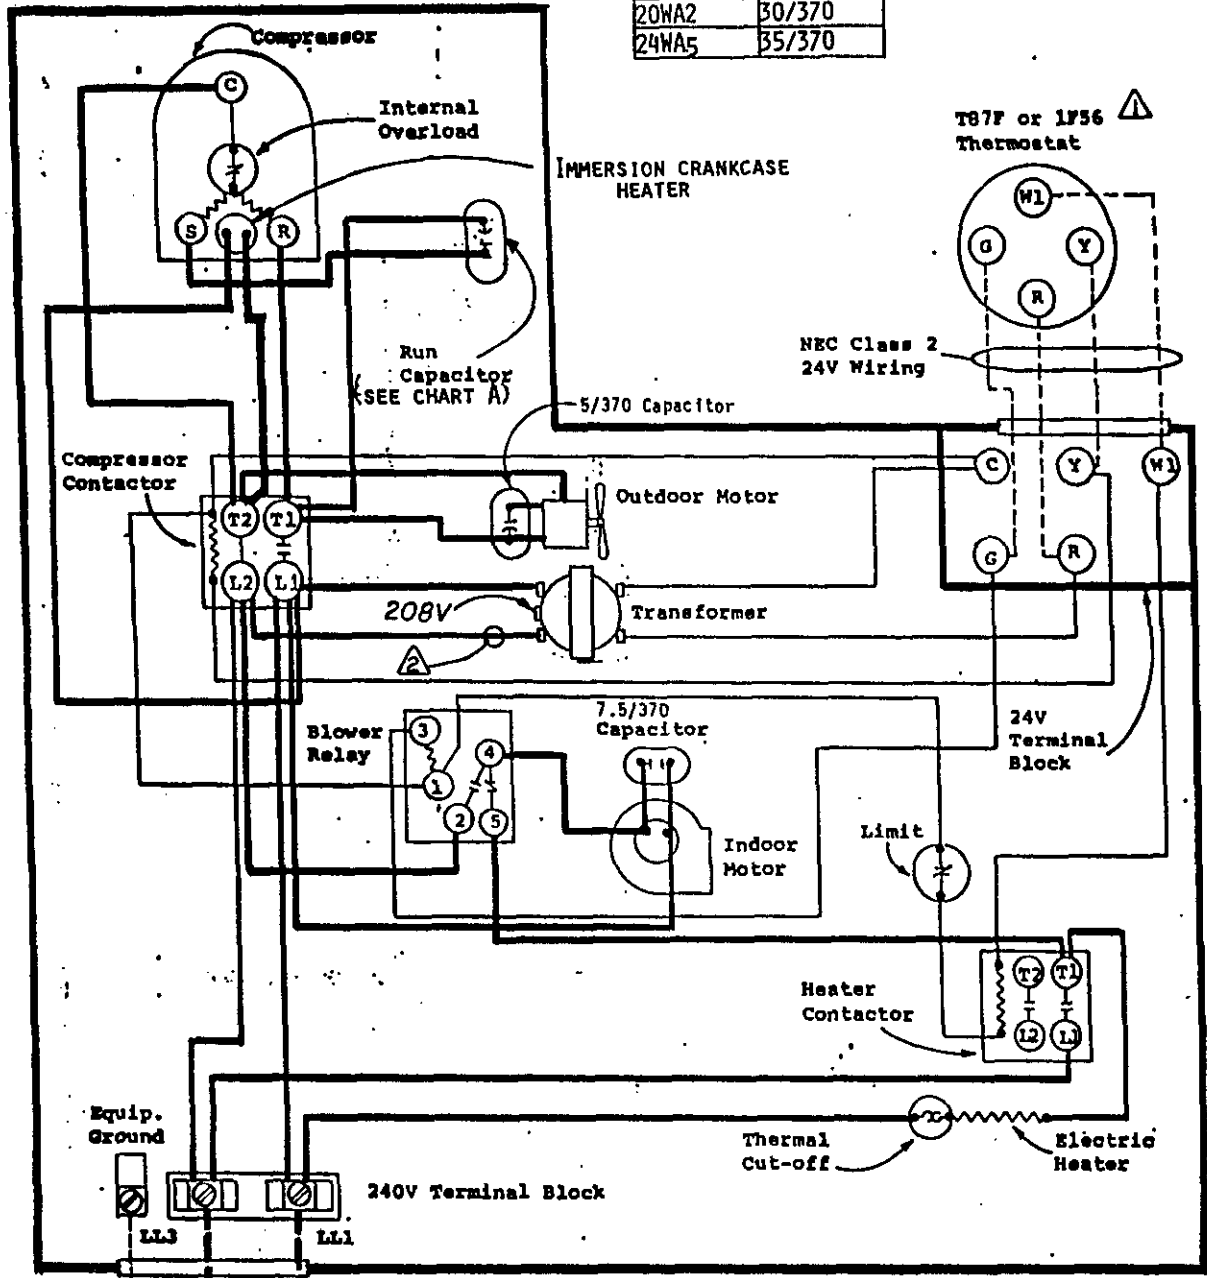

USE COPPER OR ALUMINUM WIRE

- ⚠ See alternate thermostat sheet. Set heat anticipator at .40A.
- ⚠ For 208V operation move this wire to 208V transformer tap.

MODELS
20WA2
24WA5
w/4 OR 5KW

FACTORY WIRING	FIELD WIRING
Low Voltage ———	-----
High Voltage ———	-----