


	4 KW	5 KW
Model	Cir. Breaker	Cir. Breaker
20WA4	25 A.	30 A.
24WA6	30 A.	30 A.

⚠ Thermostat T87F or 1F56

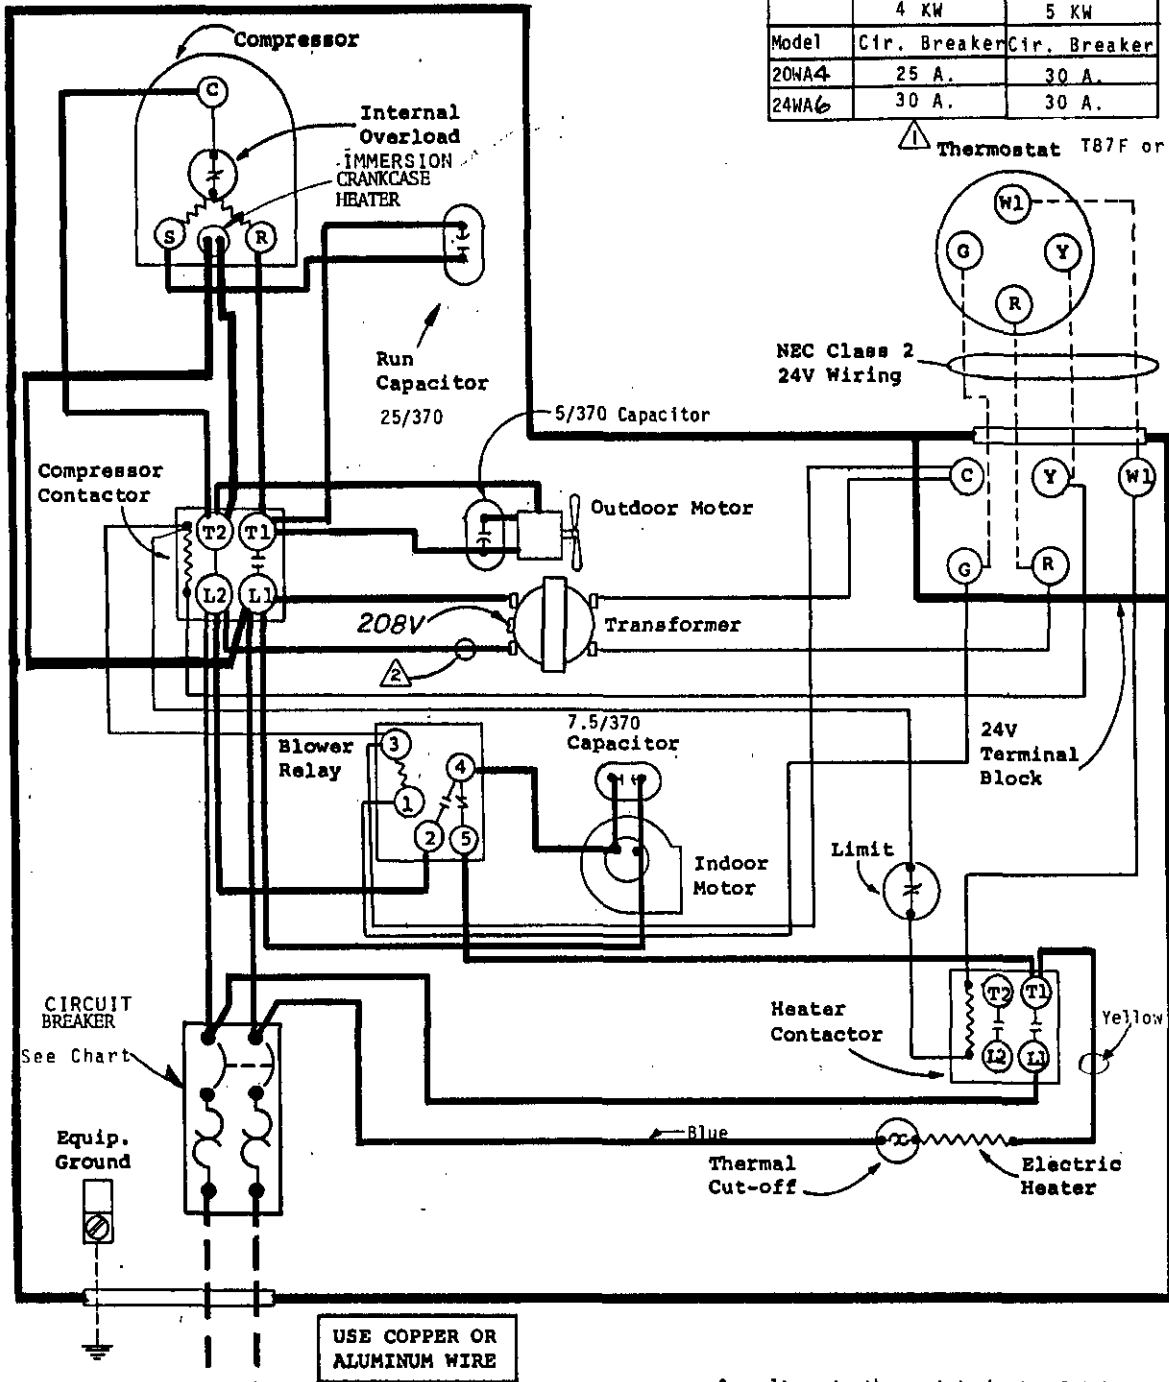

USE COPPER OR ALUMINUM WIRE

- ⚠ See alternate thermostat sheet. Set heat anticipator at .40A.
- ⚡ For 208V operation move this wire to 208V transformer tap.

230/208-60-1

FACTORY WIRING	FIELD WIRING
Low Voltage	-----
High Voltage	-----