


CHART A	
MODEL	CAPACITOR
20WA2	30/370
24WA5	35/370

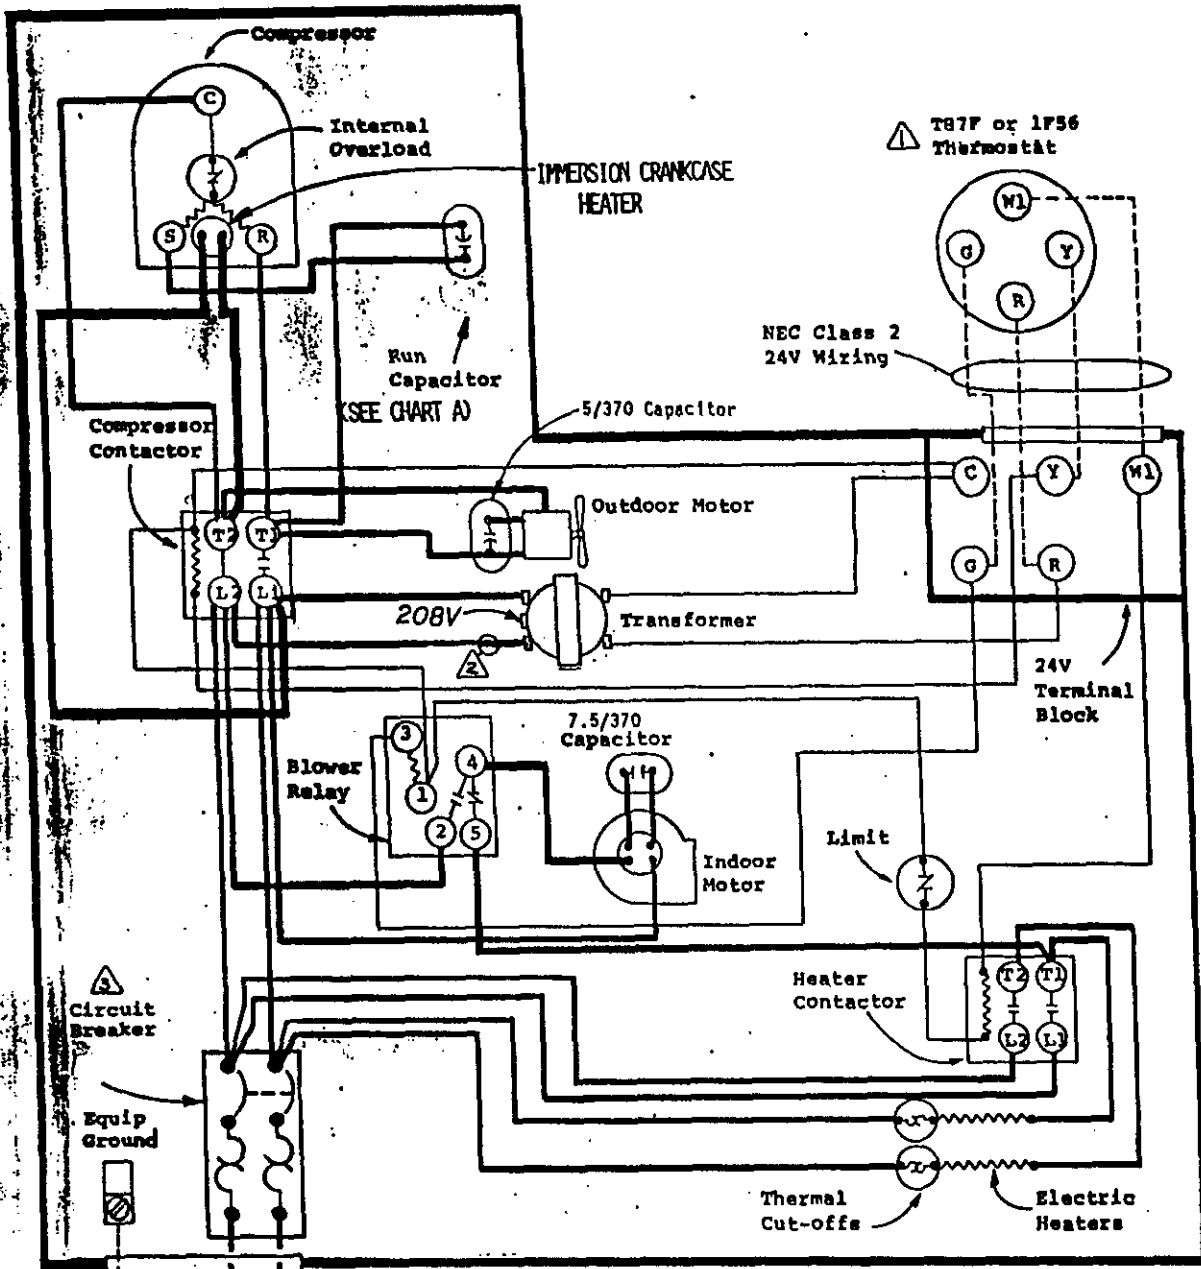

USE COPPER OR ALUMINUM WIRE

- ⚠ See alternate thermostat sheet. Set heat anticipator at .40A.
- ⚠ For 208V operation move this wire to 208V transformer top.
- ⚠

MODEL	KW	CIRCUIT BREAKER
20WA2, 24WA5	8	45 A.
20WA2, 24WA5	10	60 A.

MODELS
20WA2 24WA5
w/ 8 OR 10KW

230/208-60-1