


Low Ambient Control
CO @ 200 PSIG
CI @ 250 PSIG

ACCUSTAT
LMS-AHII



8201-039
Time Delay

8201-043
Resistor
3.0 Megohm
5-Minutes

Equip.
Ground

USE COPPER
CONDUCTORS ONLY

⚠ Capacitor provides off-cycle crankcase heat.


⚠ For 208V operation move this wire to 208V transformer tap.

Fused
Disconnect
Switch

MODELS
20WA1 & 24WA2
Catalog No. 00A35

220/208-60-1

Factory Wiring _____
Field Wiring - - - - -

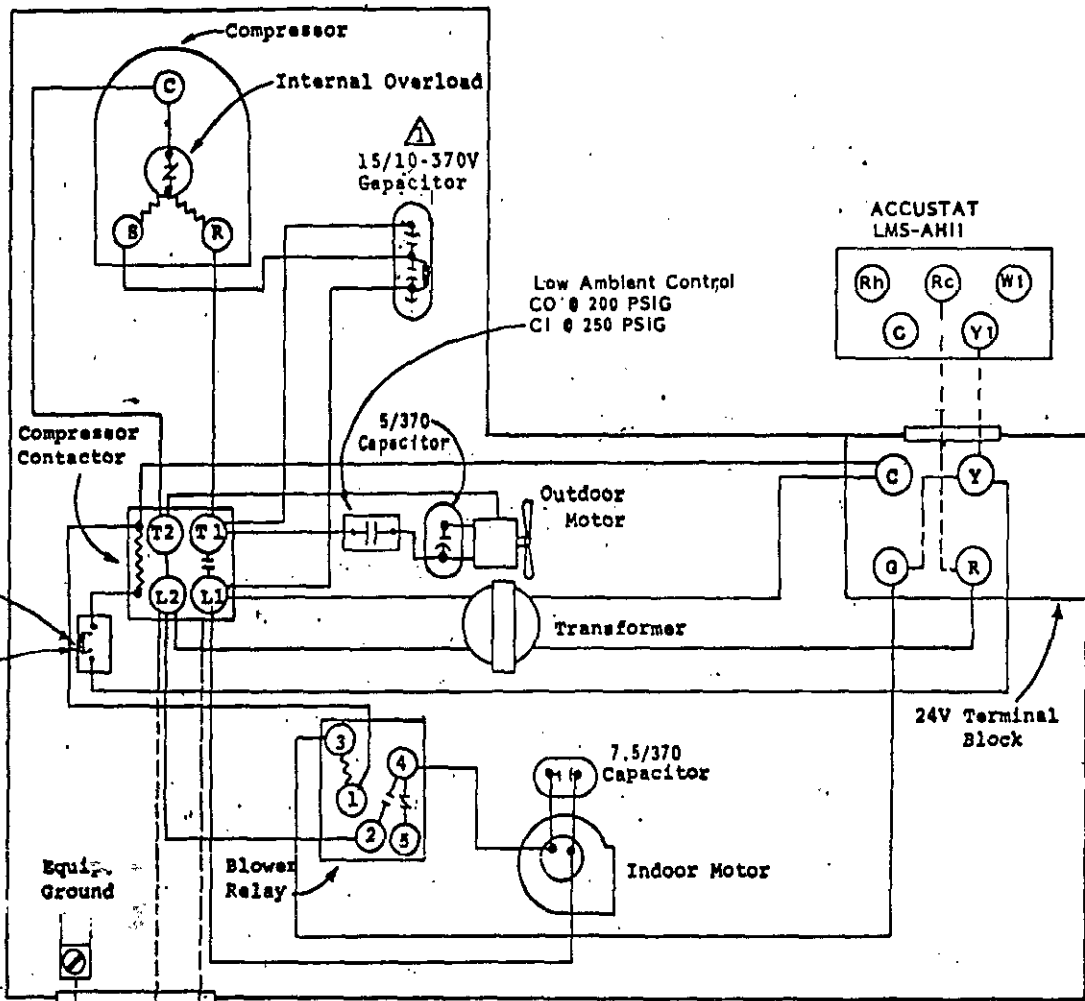

8201-039
Time Delay

8201-043
Resistor
1.0 Megohm
5-Minutes

Equip.
Ground

Blower
Relay

7.5/370
Capacitor

Indoor Motor

Transformer

Outdoor
Motor

24V Terminal
Block

ACCUSTAT
LMS-AHII

Low Ambient Control
CO @ 200 PSIG
CI @ 250 PSIG

15/10-370V
Capacitor

Internal Overload

Compressor

USE COPPER
CONDUCTORS ONLY

⚠ Capacitor provides off-cycle crankcase heat.

Fused
Disconnect
Switch

230/208-60-1

MODELS
20WA1 & 24WA2
Catalog No. 00A35

NEW DIAGRAM
ADD TO FILE
DATE 1-22-85

Factory Wiring _____
Field Wiring - - - - -