

⚠ If there is an X1 and X2 terminal on Q674L1181, jumper them together and connect from C to either one.


T872M1036/Q672F1299

or
T874N1024/Q674F1261

T872R1164/Q672L1185

or
T874R1129/Q674L1181

24V
Terminal
Block

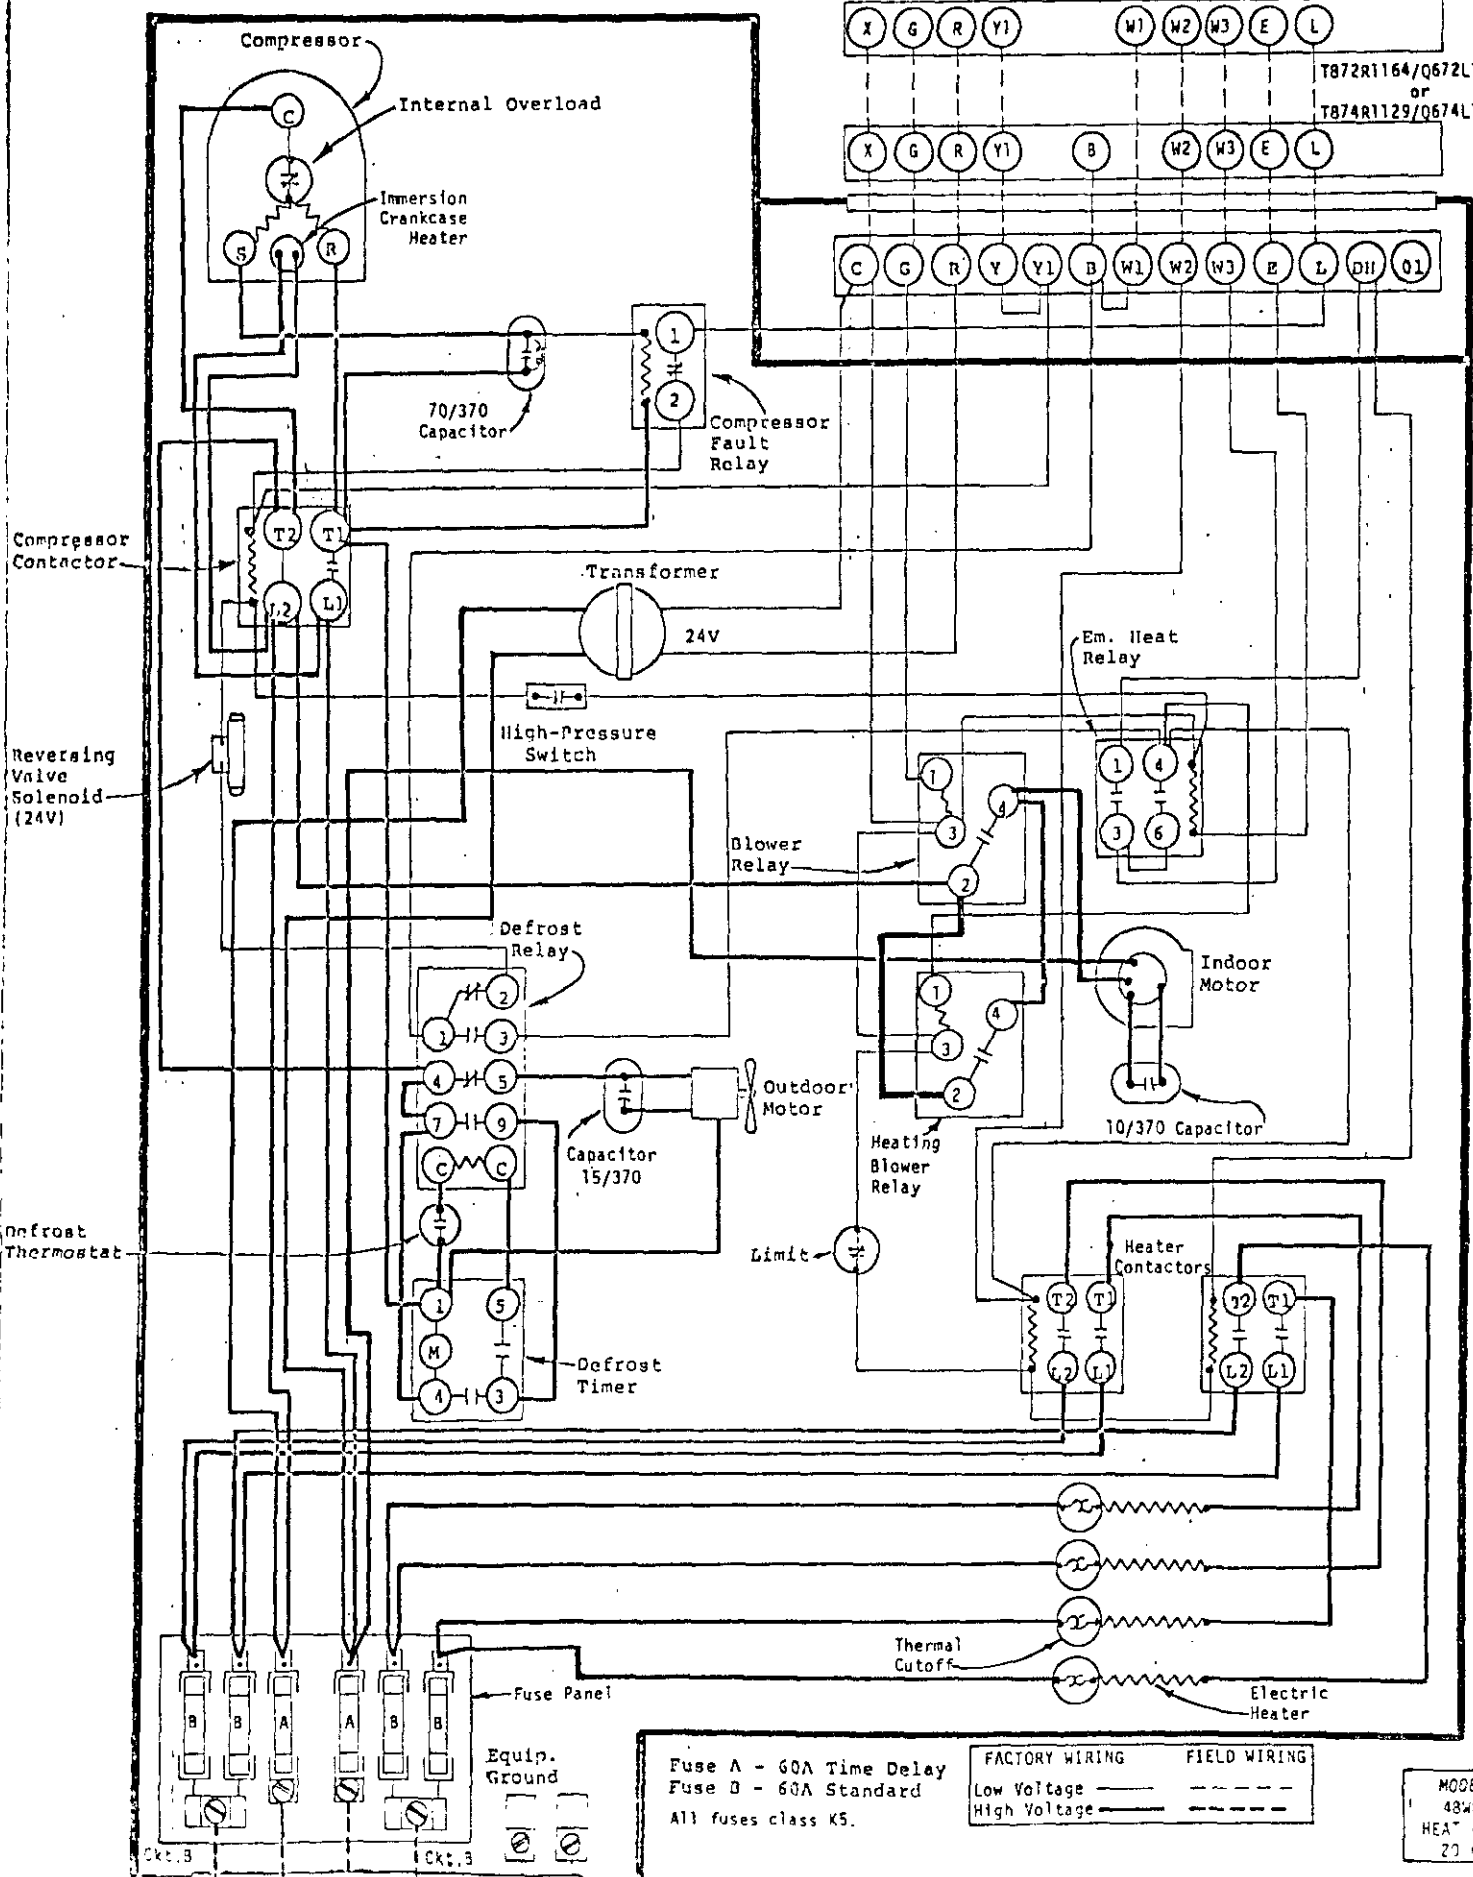

Fuse A - 60A Time Delay
 Fuse B - 60A Standard
 All fuses class K5.

	FACTORY WIRING	FIELD WIRING
Low Voltage	—————	- - - - -
High Voltage	—————	- - - - -

MODEL
 48WH2
 HEAT PUMP
 20 Kw

USE COPPER OR
 ALUMINUM WIRE

237/208-60-1

10-1-57