


⚠ If there is an X1 and X2 terminal on Q674L1181, Jumper them together and connect from C to either one.

T872N1036/Q672F1299
or
T874N1024/Q674F1261

T872R1164/Q672L1185
or
T874R1129/Q674L1181

24V
Terminal
Block

**REVISED DIAGRAM
REPLACES
DATE 2-1-72**

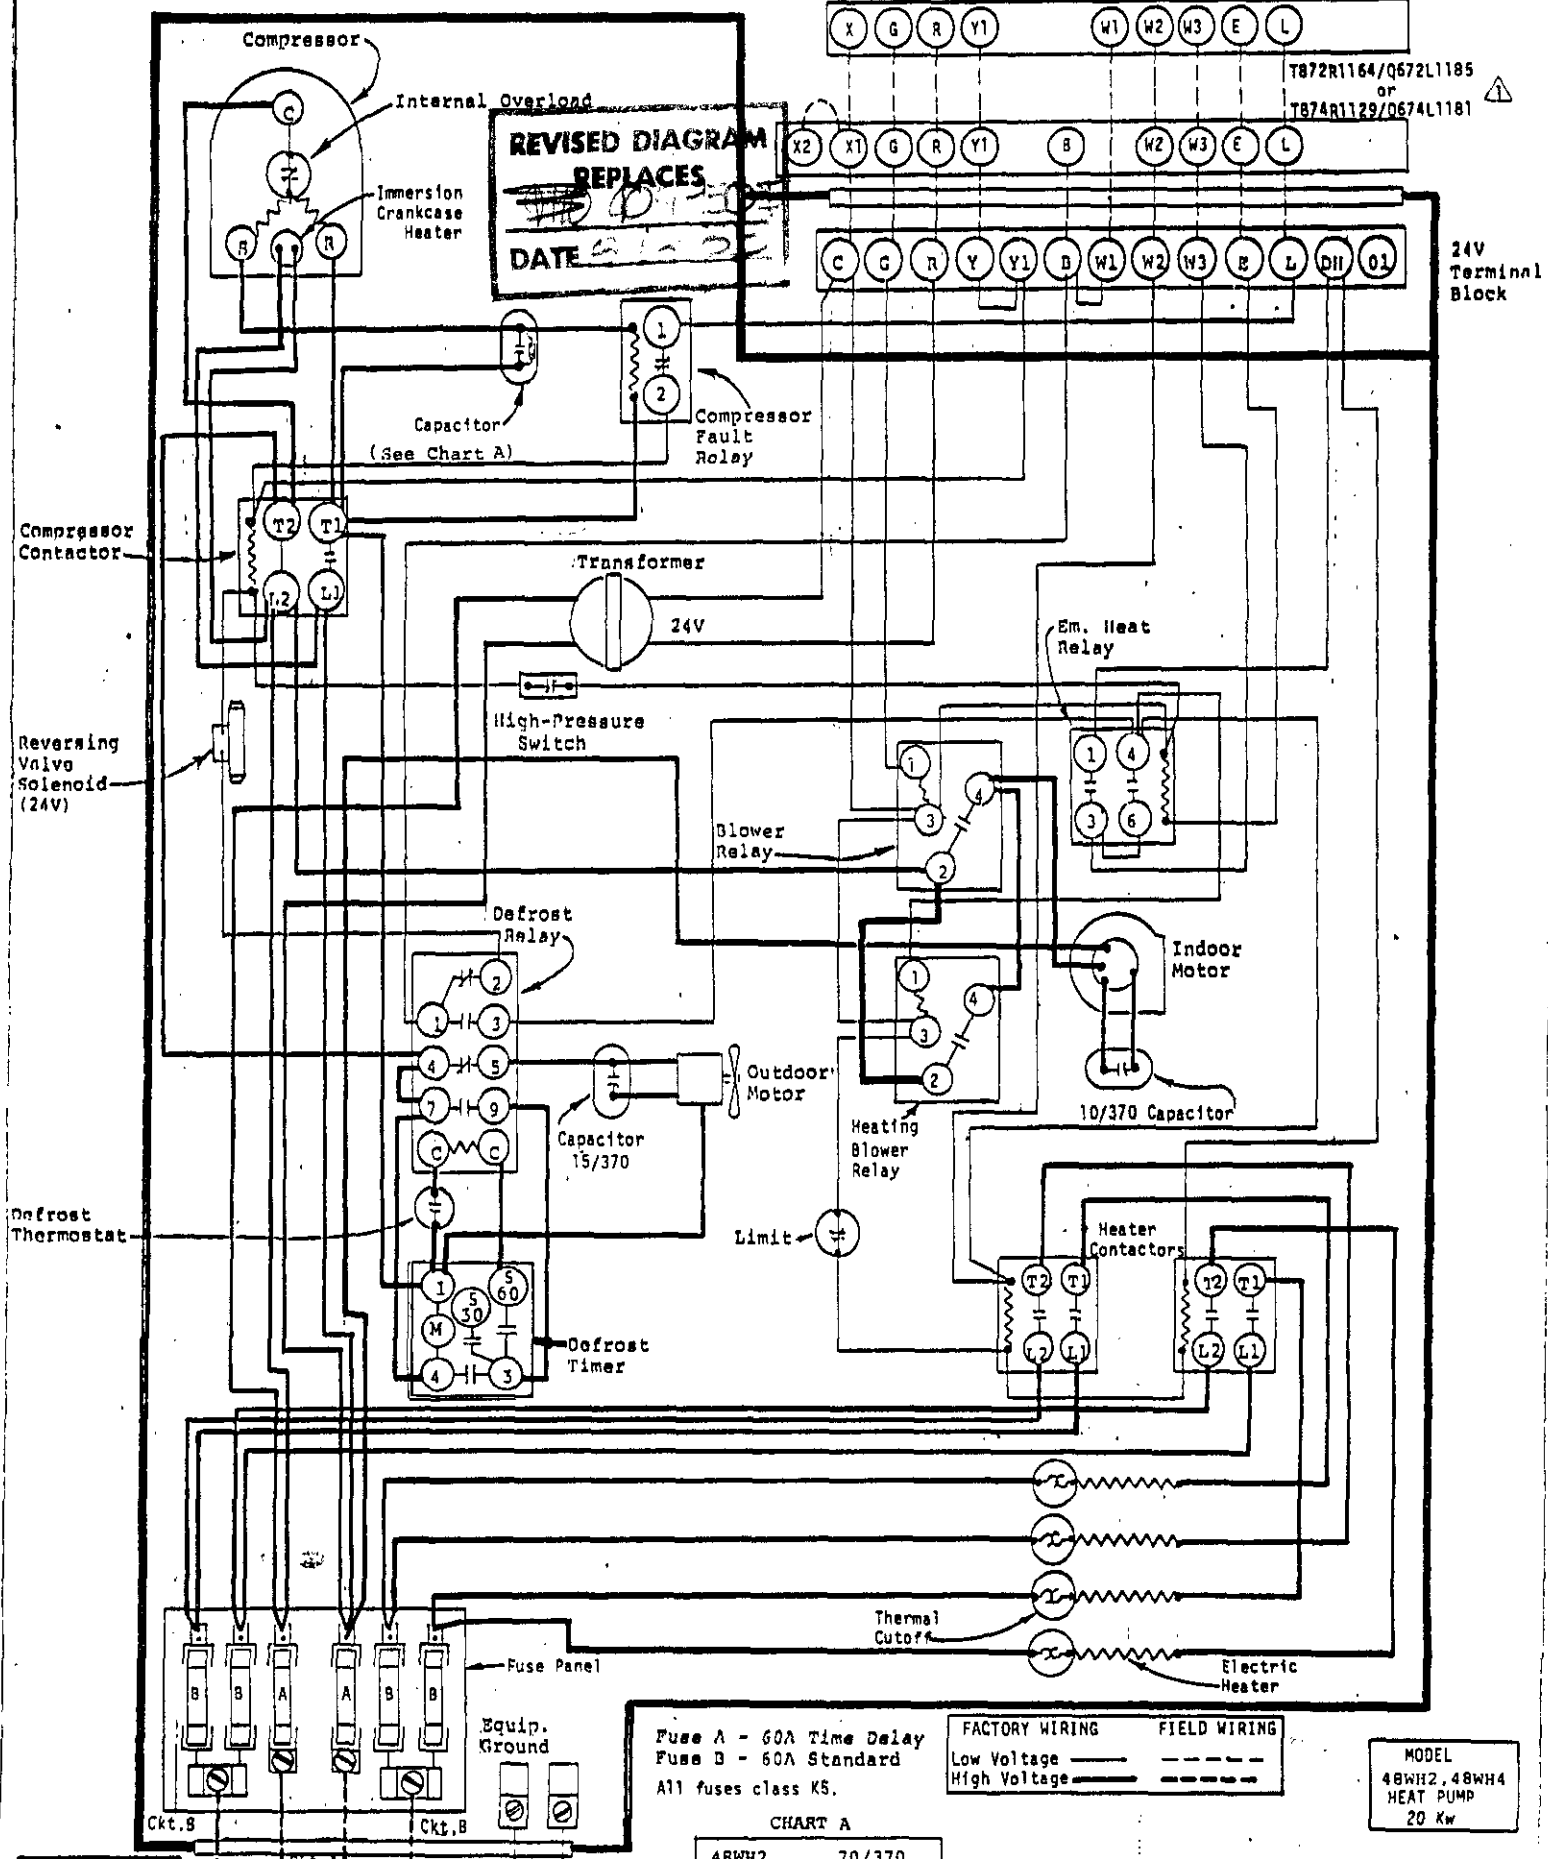

Fuse A - 60A Time Delay
Fuse B - 60A Standard
All fuses class KS.

	FACTORY WIRING	FIELD WIRING
Low Voltage	_____	-----
High Voltage	_____	-----

MODEL
48WH2, 48WH4
HEAT PUMP
20 Kw

CHART A

48WH2	70/370
48WH4	40/440

USE COPPER OR ALUMINUM WIRE

230/208-60-1

4014-150J