


⚠ If there is an X1 and X2 terminal on Q674L1181, jumper them together and connect from C to either one.

T872K1036/Q672F1299  
or  
T874N1024/Q674F1261

T872R1164/Q672L1185  
or  
T874R1129/Q674L1181

24V  
Terminal  
Block

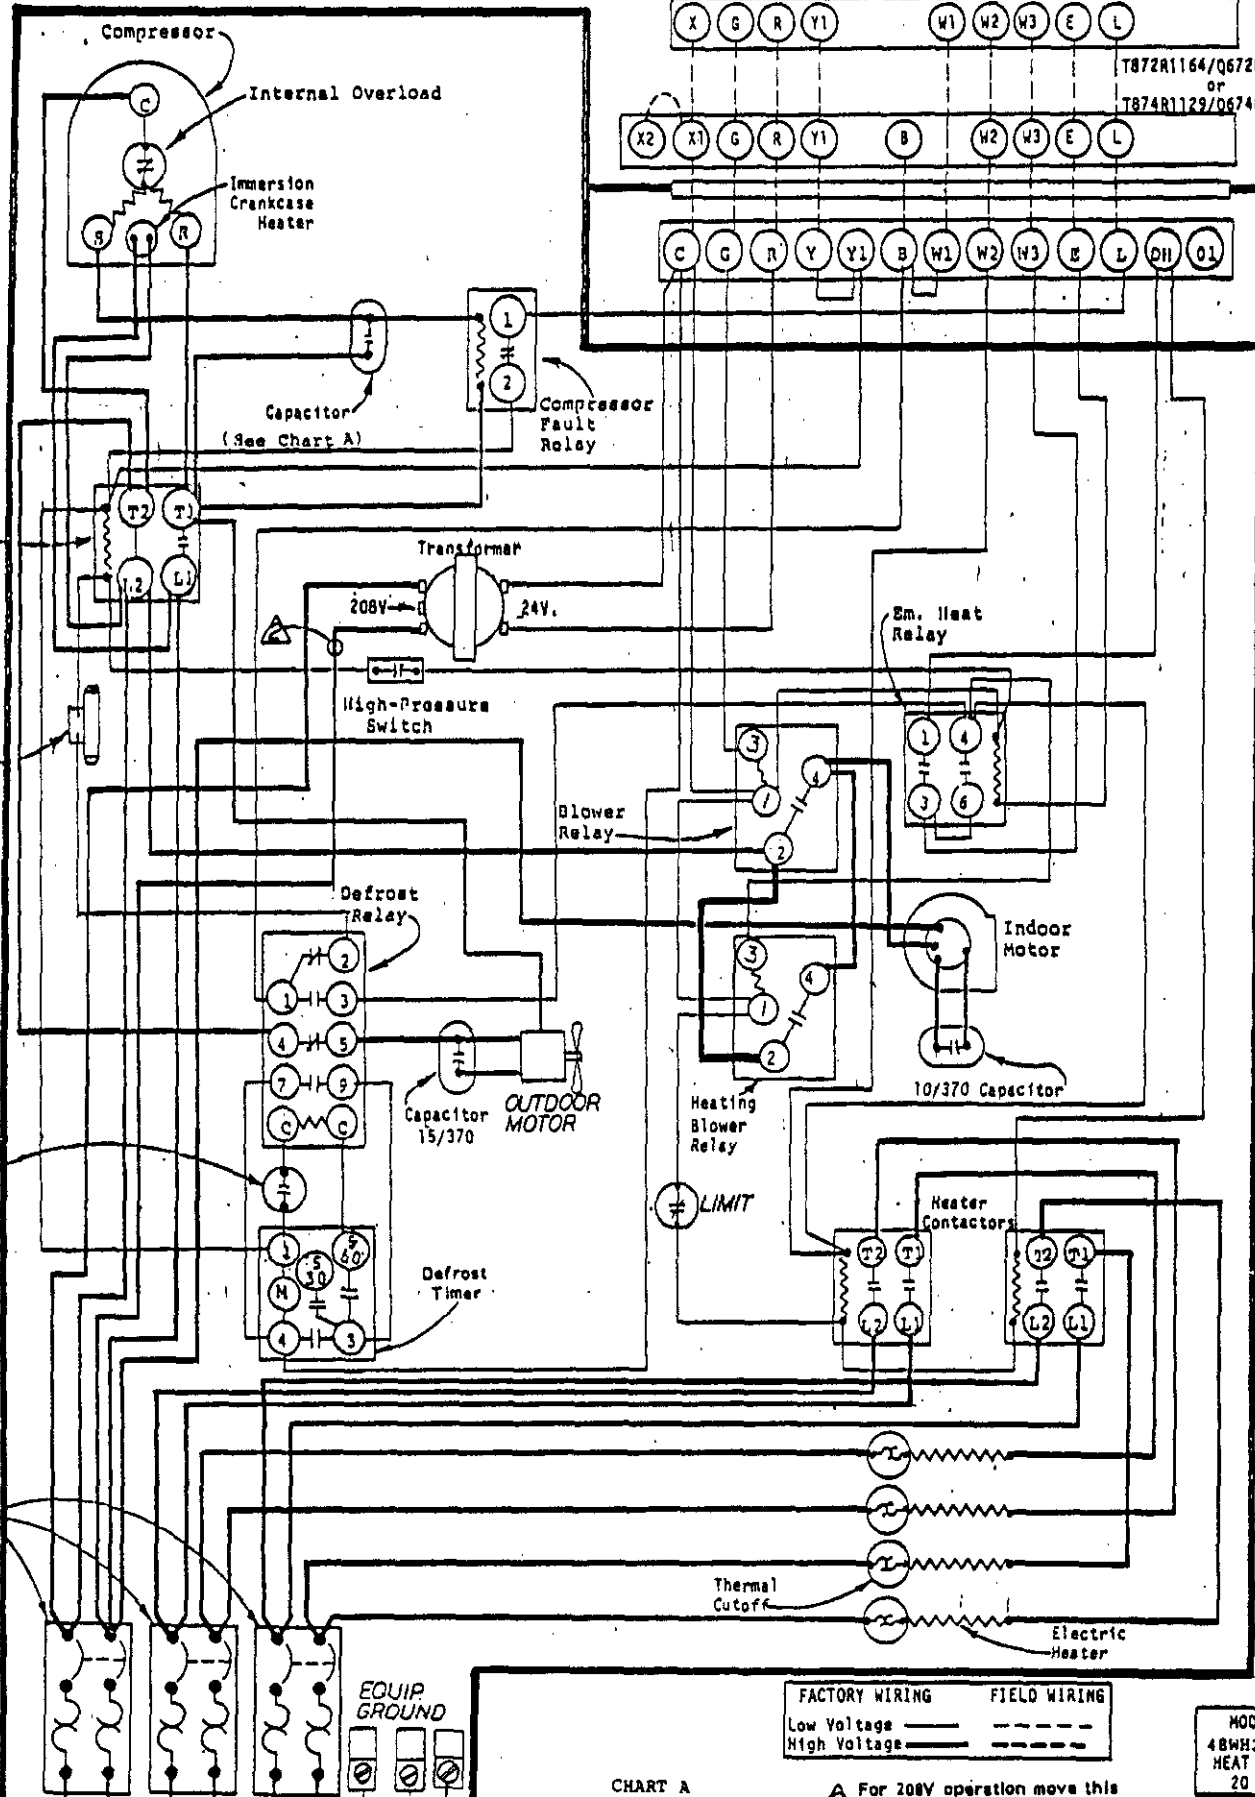

Compressor Contactor

Reversing Valve Solenoid (24V)

Defrost Thermostat

60A Circuit Breaker

USE COPPER OR ALUMINUM WIRE

EXT A EXT B EXT C  
230/208-60-1

EQUIP GROUND

CHART A

48WH2	70/370
48WH5	40/440

FACTORY WIRING	FIELD WIRING
Low Voltage ———	-----
High Voltage - - - - -	-----

⚠ For 208V operation move this wire to 208V transformer tap.

MODEL  
48WH2, 48WH5  
HEAT PUMP  
20 Kw

4014-151A