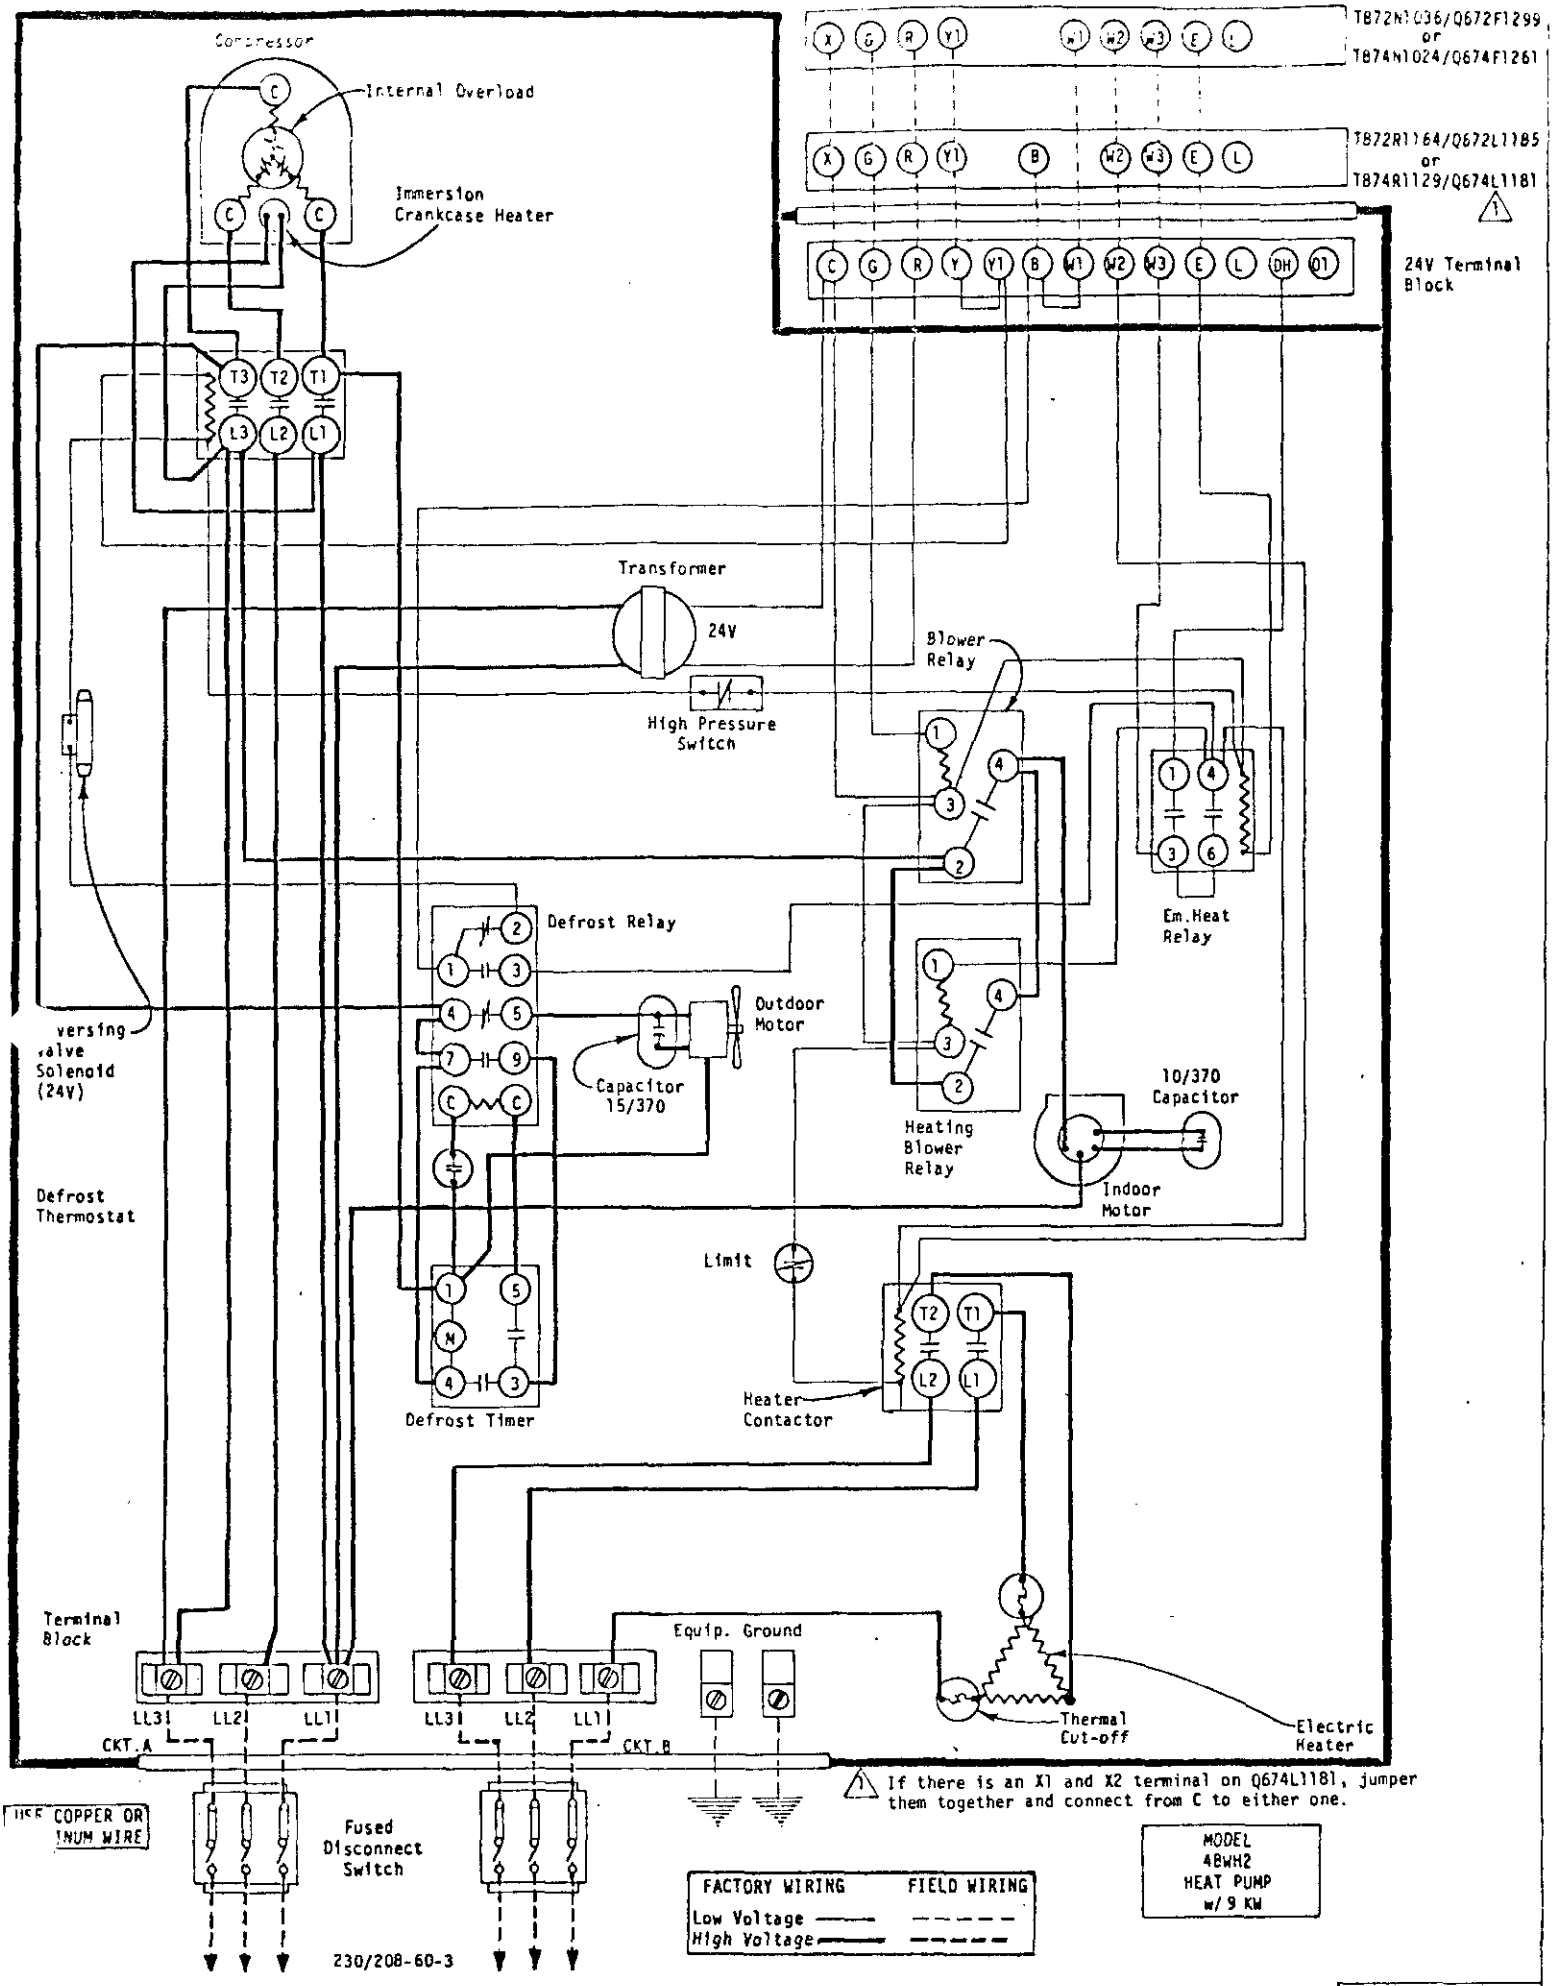
T872N1036/Q672F1299
or
T874N1024/Q674F1261
T872R1164/Q672L1185
or
T874R1129/Q674L1181
1
24V Terminal Block
Compressor
Internal Overload
Immersion Crankcase Heater
Transformer
24V
High Pressure Switch
Blower Relay
Em.Heat Relay
Defrost Relay
Outdoor Motor
Capacitor 15/370
10/370 Capacitor
Heating Blower Relay
Indoor Motor
Reversing Valve Solenoid (24V)
Defrost Thermostat
Limit
Defrost Timer
Heater Contactor
Terminal Block
Equip. Ground
Thermal Cut-off
Electric Heater
CKT.A
CKT.B
1 If there is an X1 and X2 terminal on Q674L1181, jumper them together and connect from C to either one.
USE COPPER OR ALUM WIRE
Fused Disconnect Switch
230/208-60-3
FACTORY WIRING
FIELD WIRING
Low Voltage
High Voltage
MODEL
48WH2
HEAT PUMP
w/ 9 KW
4014-220G