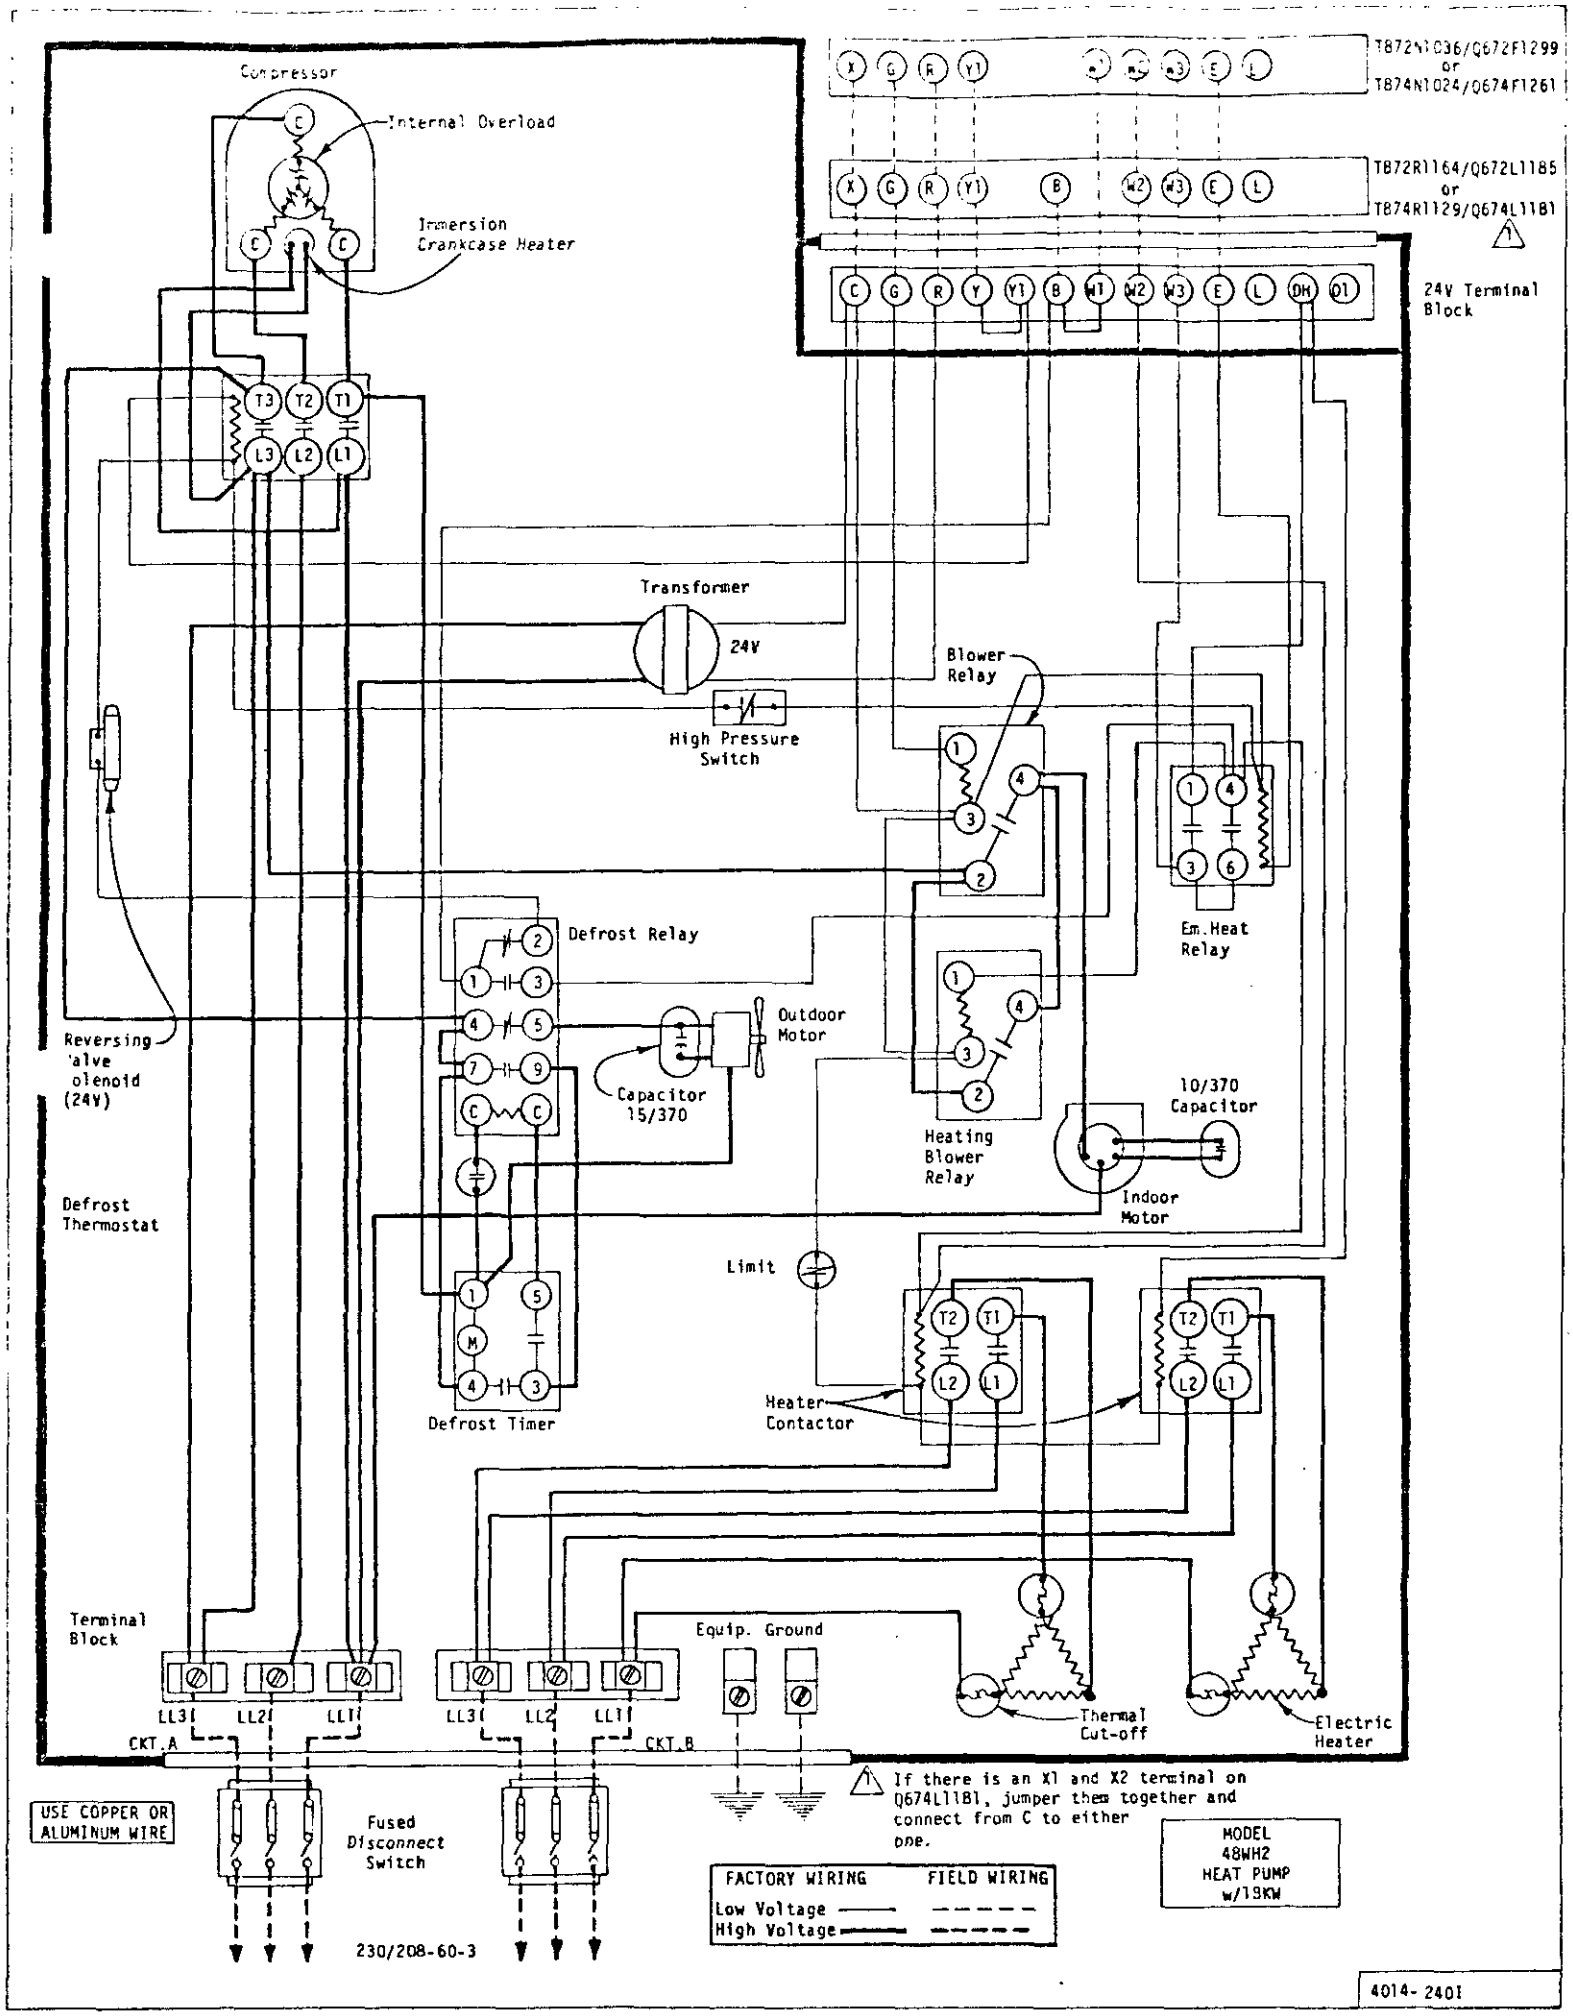
TB72N1036/Q672F1299
or
TB74N1024/Q674F1261
TB72R1164/Q672L11B5
or
TB74R1129/Q674L11B1
24V Terminal Block
Compressor
Internal Overload
Immersion Crankcase Heater
Transformer
24V
High Pressure Switch
Blower Relay
Em.Heat Relay
Defrost Relay
Outdoor Motor
Capacitor 15/370
Reversing Valve Solenoid (24V)
Defrost Thermostat
Heating Blower Relay
10/370 Capacitor
Indoor Motor
Limit
Defrost Timer
Heater Contactor
Terminal Block
Equip. Ground
Thermal Cut-off
Electric Heater
CKT.A
CKT.B
USE COPPER OR ALUMINUM WIRE
Fused Disconnect Switch
230/208-60-3
If there is an X1 and X2 terminal on Q674L11B1, jumper them together and connect from C to either one.
FACTORY WIRING
FIELD WIRING
Low Voltage
High Voltage
MODEL 48WH2 HEAT PUMP w/19KW
4014-2401