


**SPLIT SYSTEM AIR CONDITIONERS**  
 35EC04 & 42ECQ  
 200/240V 50HZ 3PH

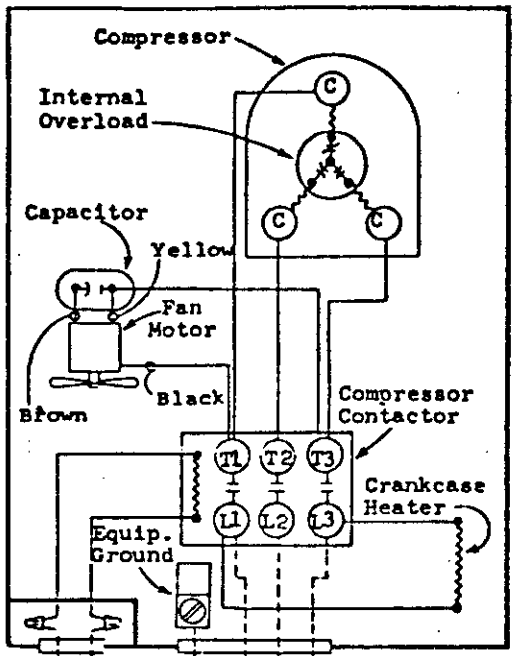

Use Minimum  
 Transformer  
 Rating of 40VA

Use Copper  
 Conductors  
 Only

C Y  
 24V

Fused  
 Disconnect  
 Switch

Factory Wiring  
 Field Wiring

200/240 -3- 50

4023-510