


CKT.A
CKT.A
CKT.B
CKT.B

REPLACEMENT FUSES
MUST BE CLASS K-5

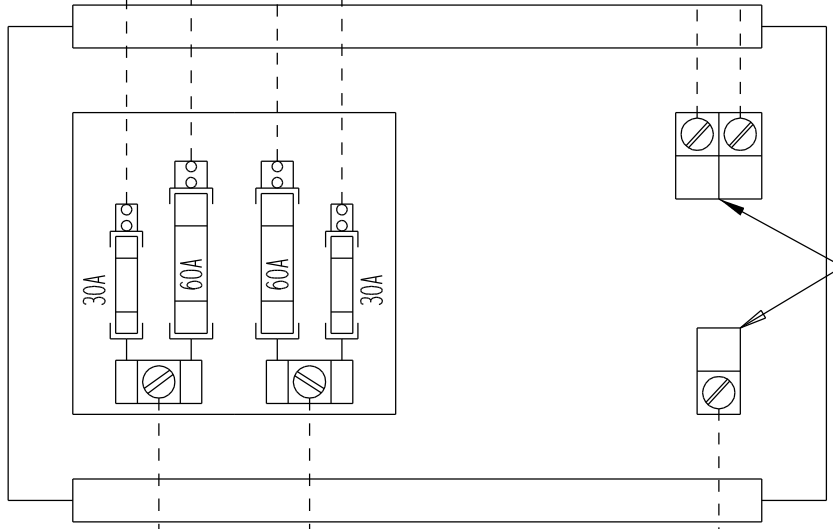

EQUIPMENT
GROUND

RFP-15
FUSE PANEL

240/208-60-1

GROUND

USE 60C COPPER OR
ALUMINUM WIRE

4031-802 B