



REFER TO INSTALLATION INSTRUCTIONS FOR CONTROL CIRCUIT WIRING.

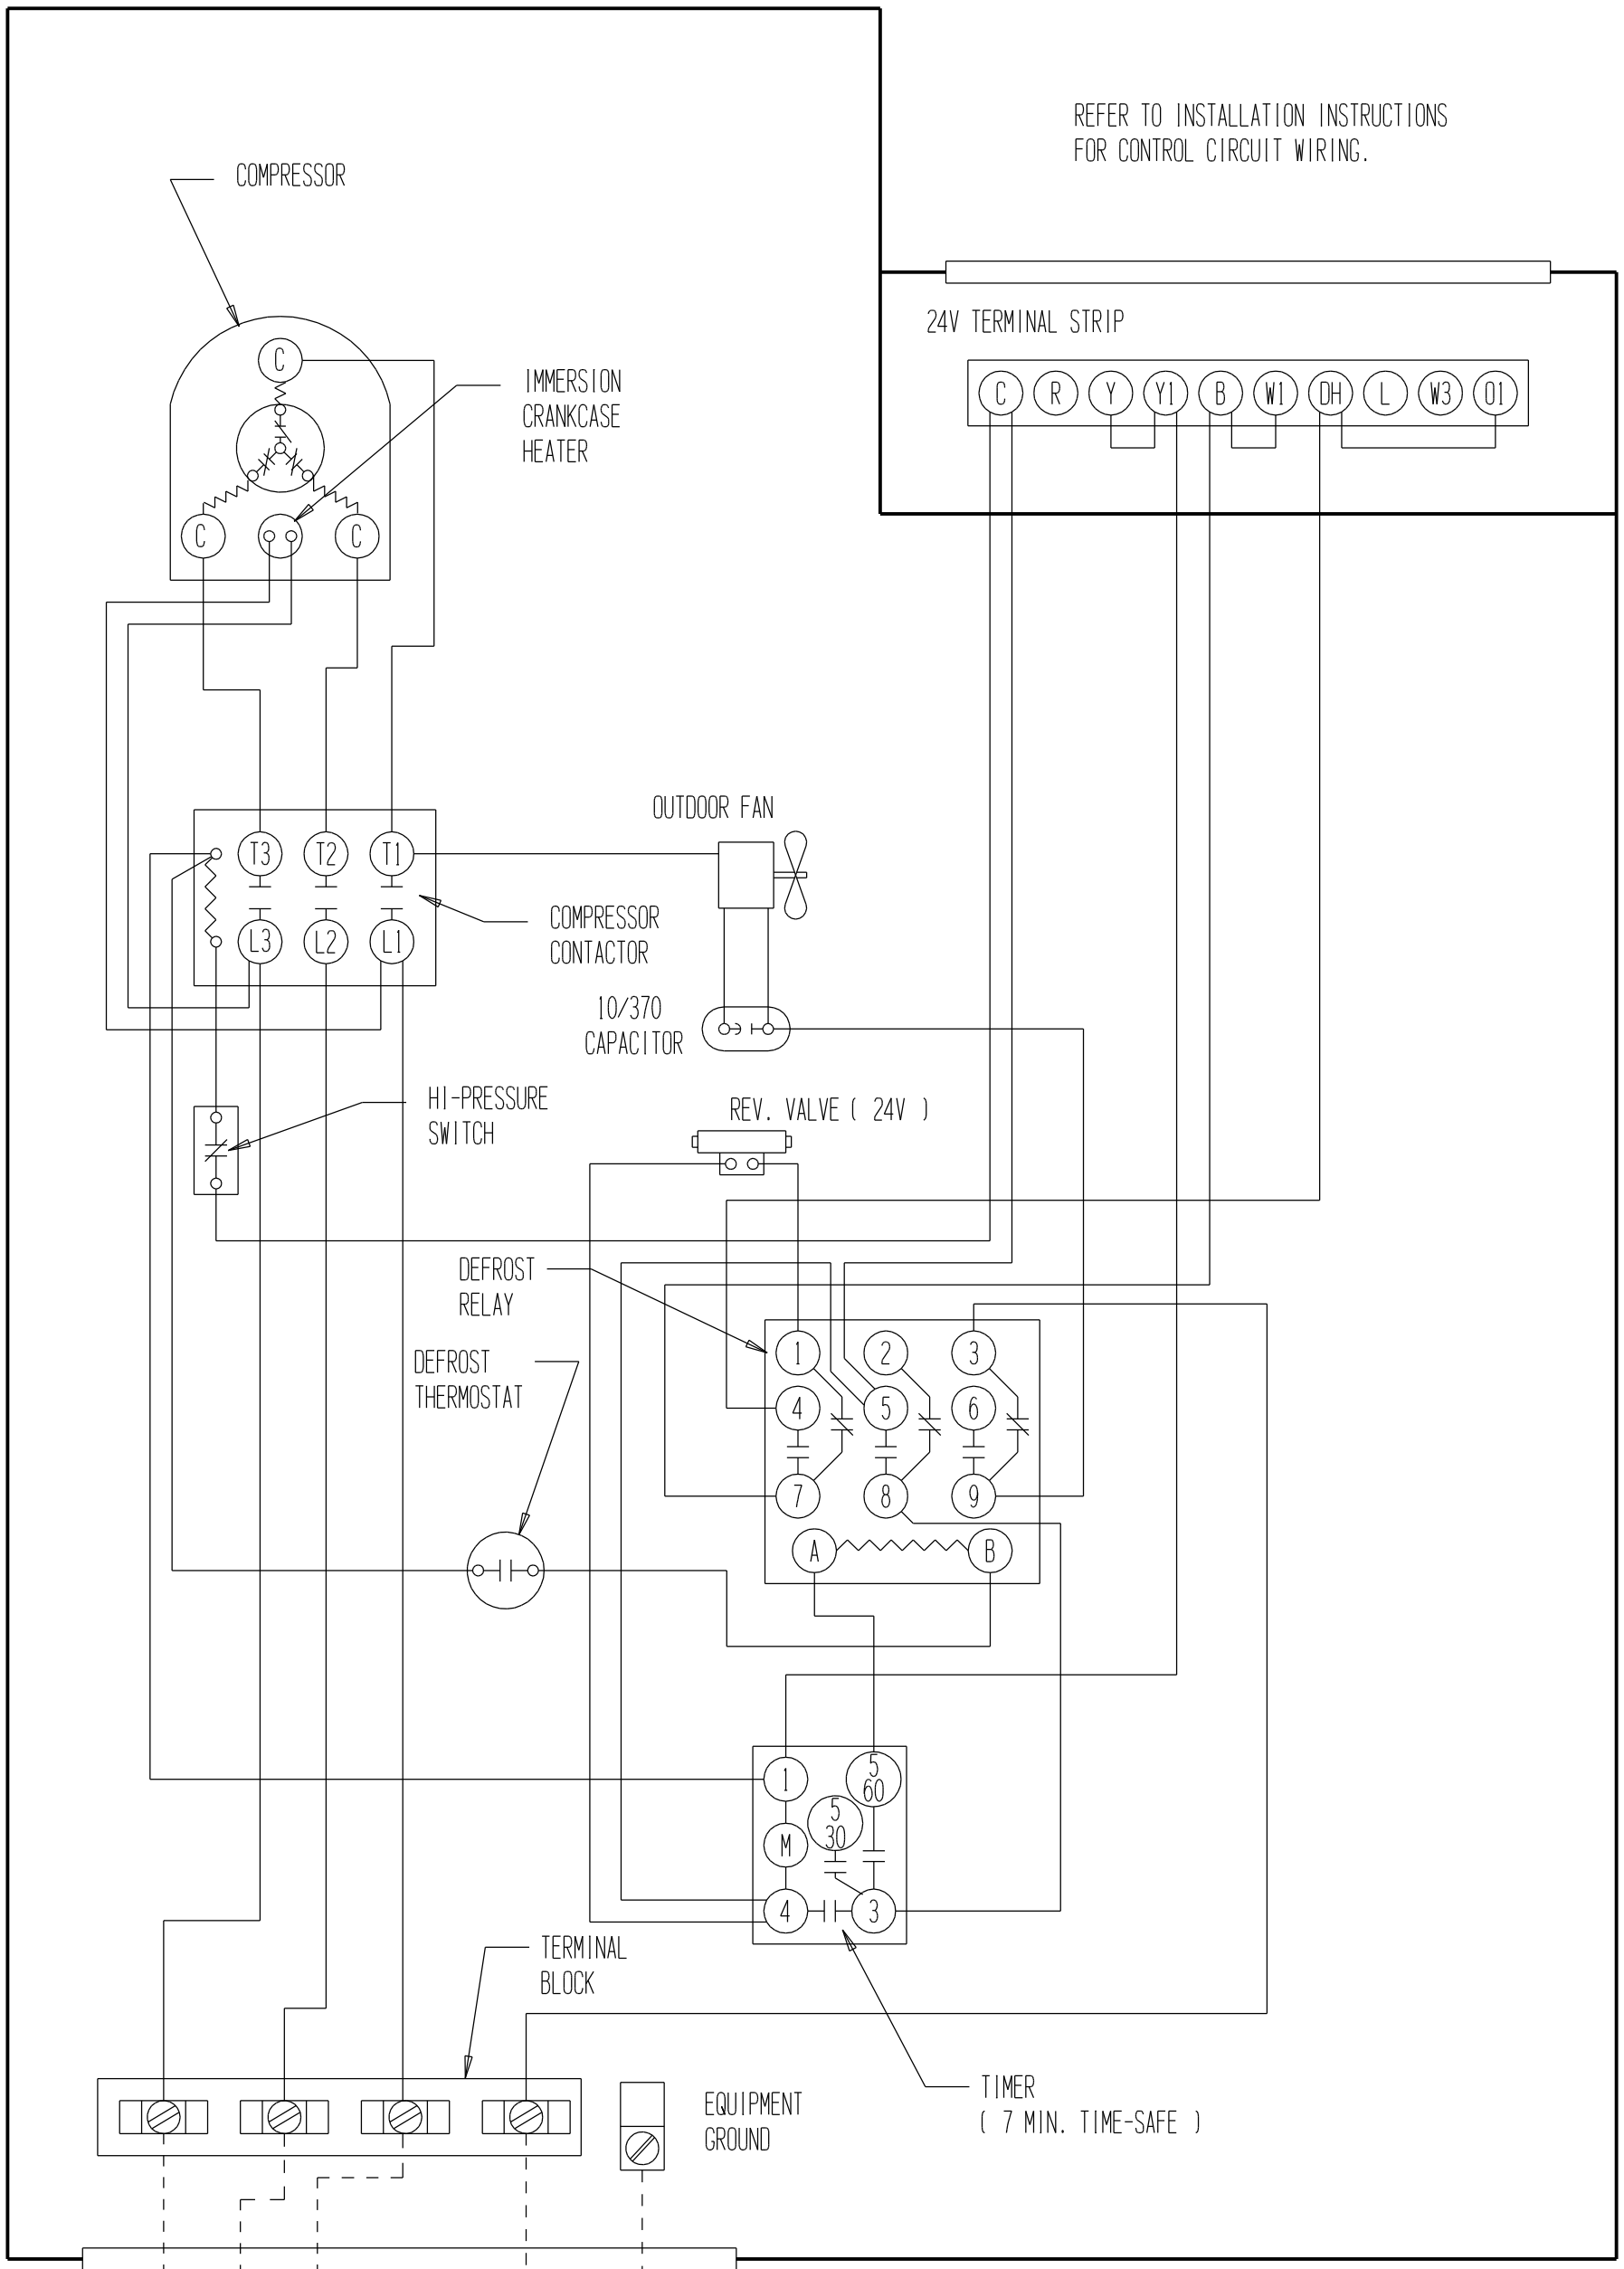

FUSIBLE DISCONNECT SWITCH



NEUTRAL

USE COPPER CONDUCTORS ONLY

| | FACTORY WIRING | FIELD WIRING |
|--------------|----------------|--------------|
| Low Voltage | ————— | ----- |
| High Voltage | ————— | ----- |