


REFER TO CONTROL CIRCUIT WIRING ON CONTROL PANEL COVER AND INSTALLATION INSTRUCTIONS FOR HOOK-UP OF OPTIONAL DUCT HEATER

SOLENOID VALVE (OPTIONAL)

CHECK LIGHT

SET HEAT ANTICIPATOR AT .45A FOR EITHER TYPE OF WALL THERMOSTAT

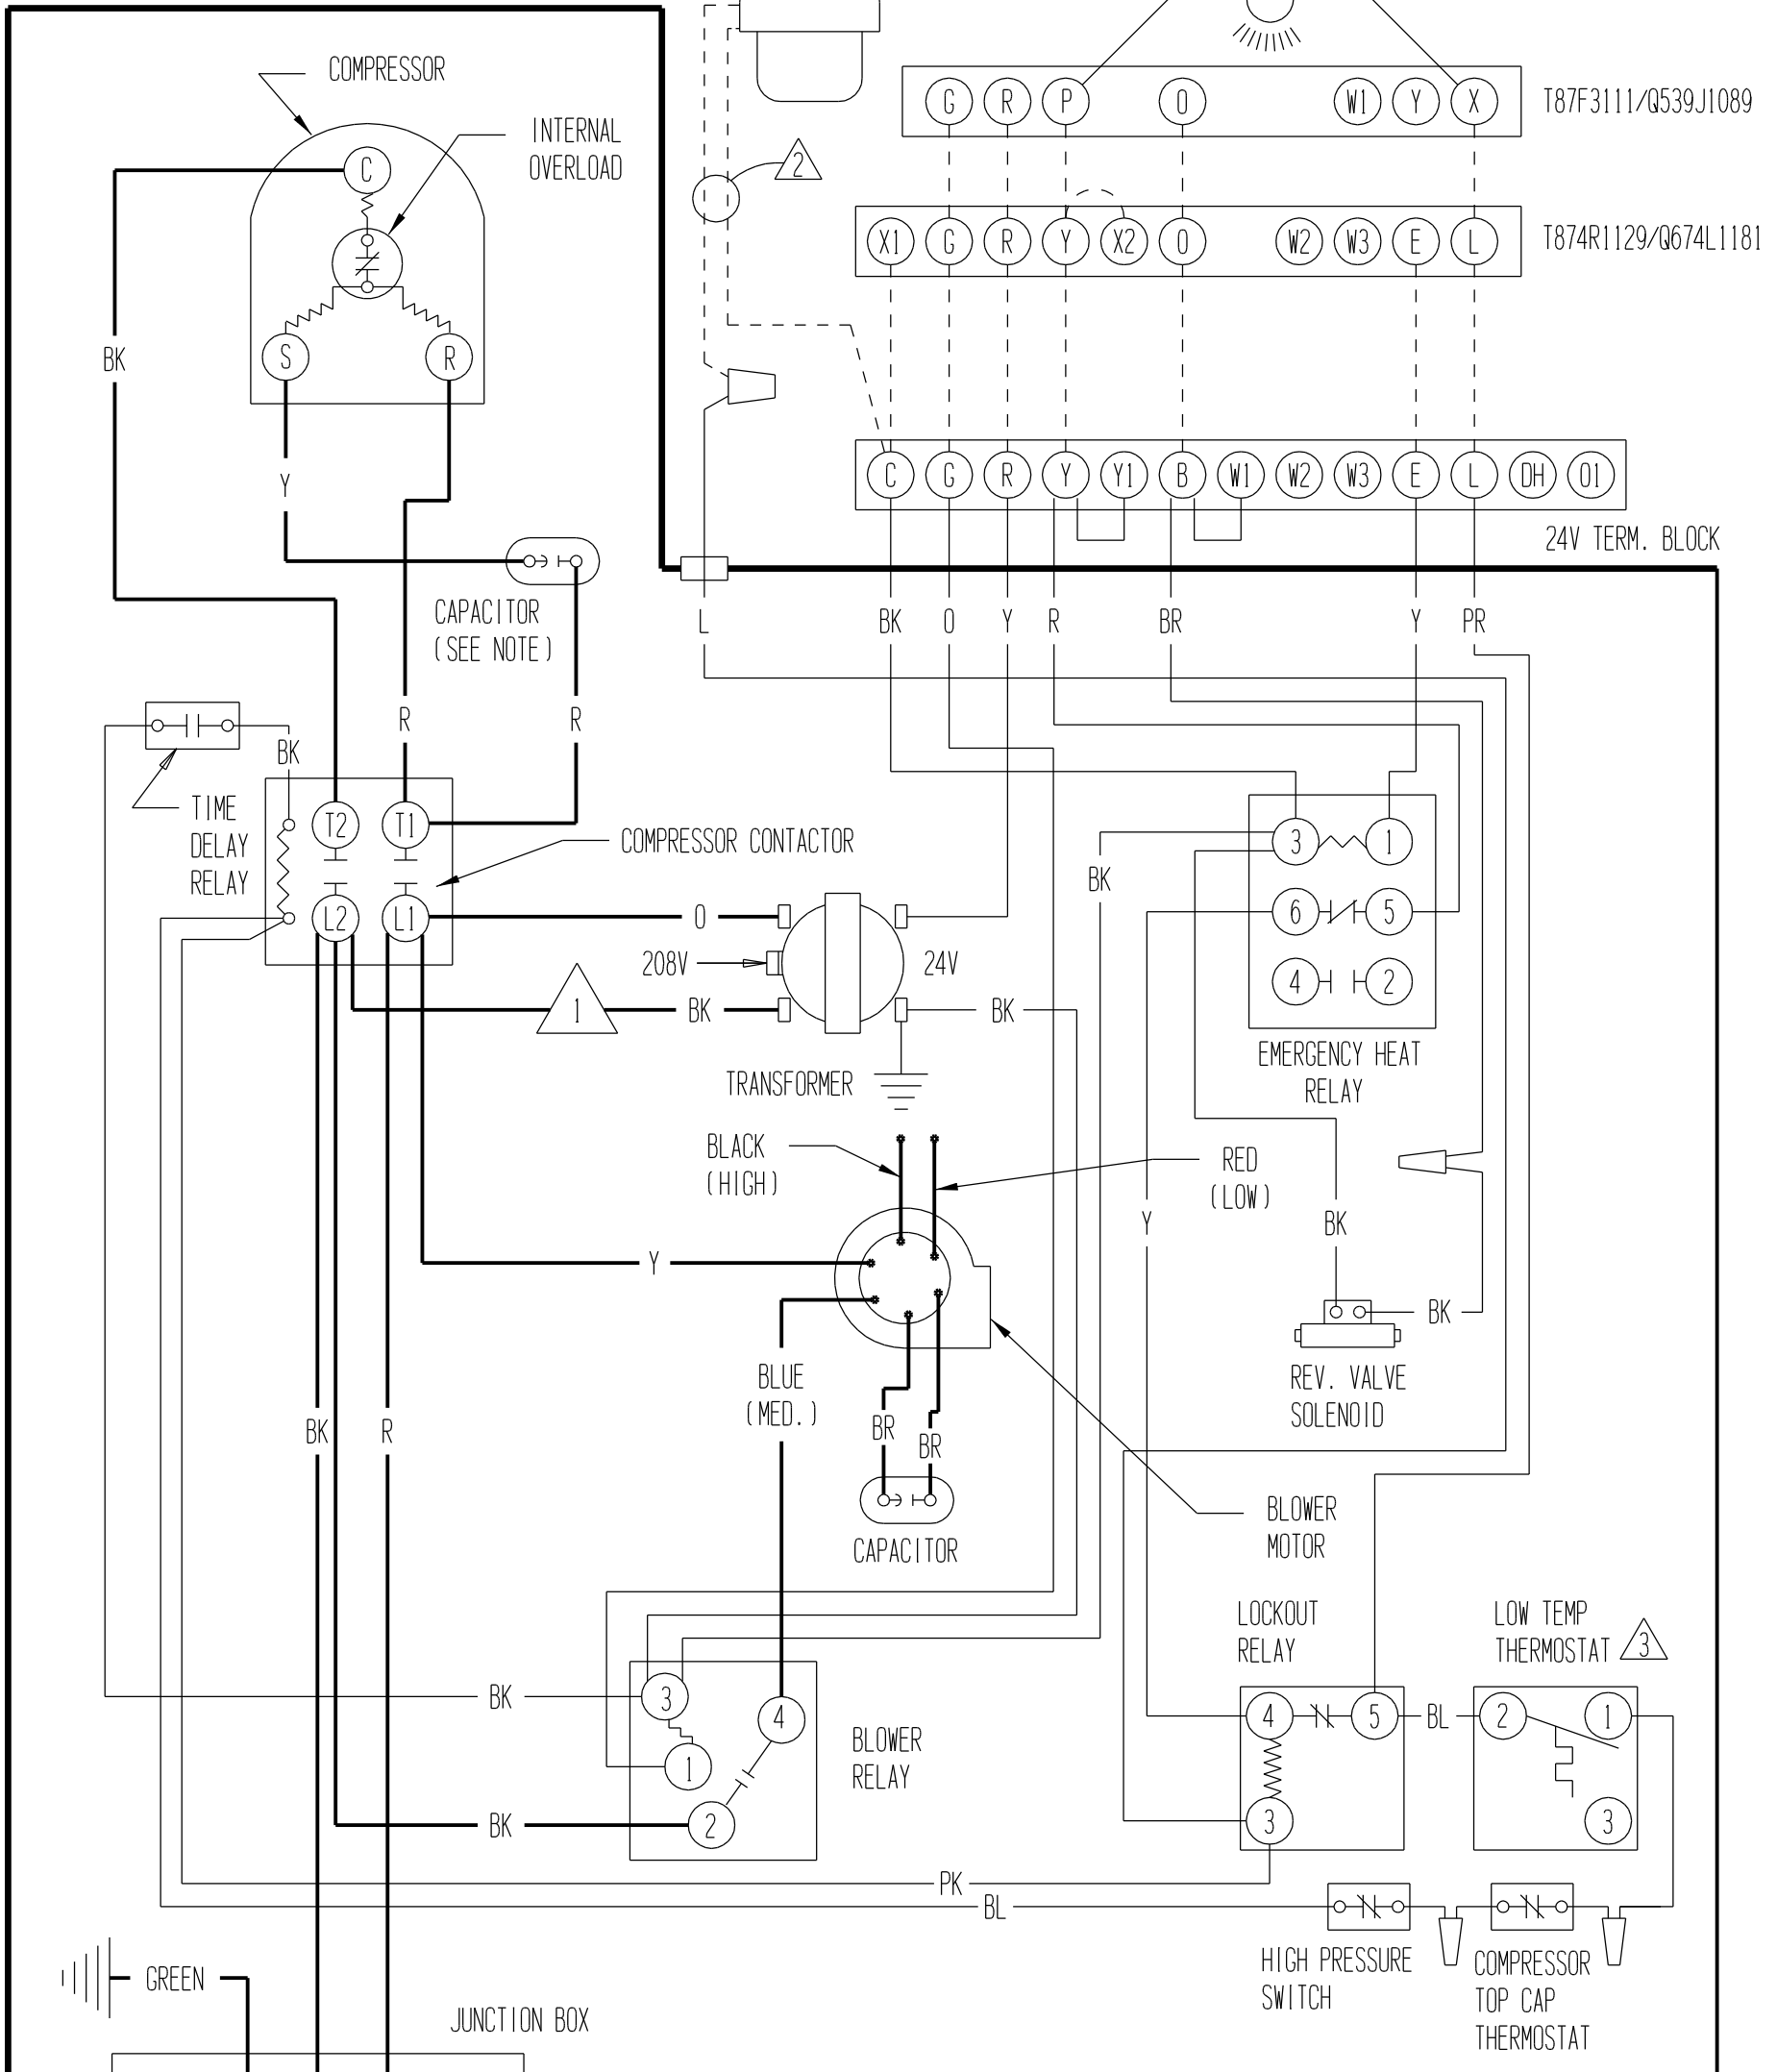

GREEN

JUNCTION BOX

1 FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP

2 USE WIRING RATED FOR USE IN NEC CLASS 1 SYSTEM

3 FACTORY SET AT 25° FOR OPEN LOOP APPLICATION
RESET TO 15°F FOR CLOSED LOOP APPLICATIONS

USE COPPER CONDUCTORS RATED FOR MINIMUM OF 75° C ONLY

	FACTORY WIRING	FIELD WIRING
Low Voltage	_____	-----
High Voltage	_____	-----

CAPACITOR RATINGS		
MODEL	COMPRESSOR	BLOWER
WPV24C	25/370	5/370

COLOR CODE	
WIRE COLOR	ABBREVIATION
BLACK	BK
BROWN	BR
RED	R
ORANGE	O
YELLOW	Y
GREEN	G
BLUE	BL
VIOLET (PURPLE)	V (PR)
GRAY (SLATE)	GY (S)
WHITE	W
TAN	T
PINK	PK
LAVENDER	L