


# CONNECTION DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD,  
DISCONNECT POWER BEFORE SERVICING

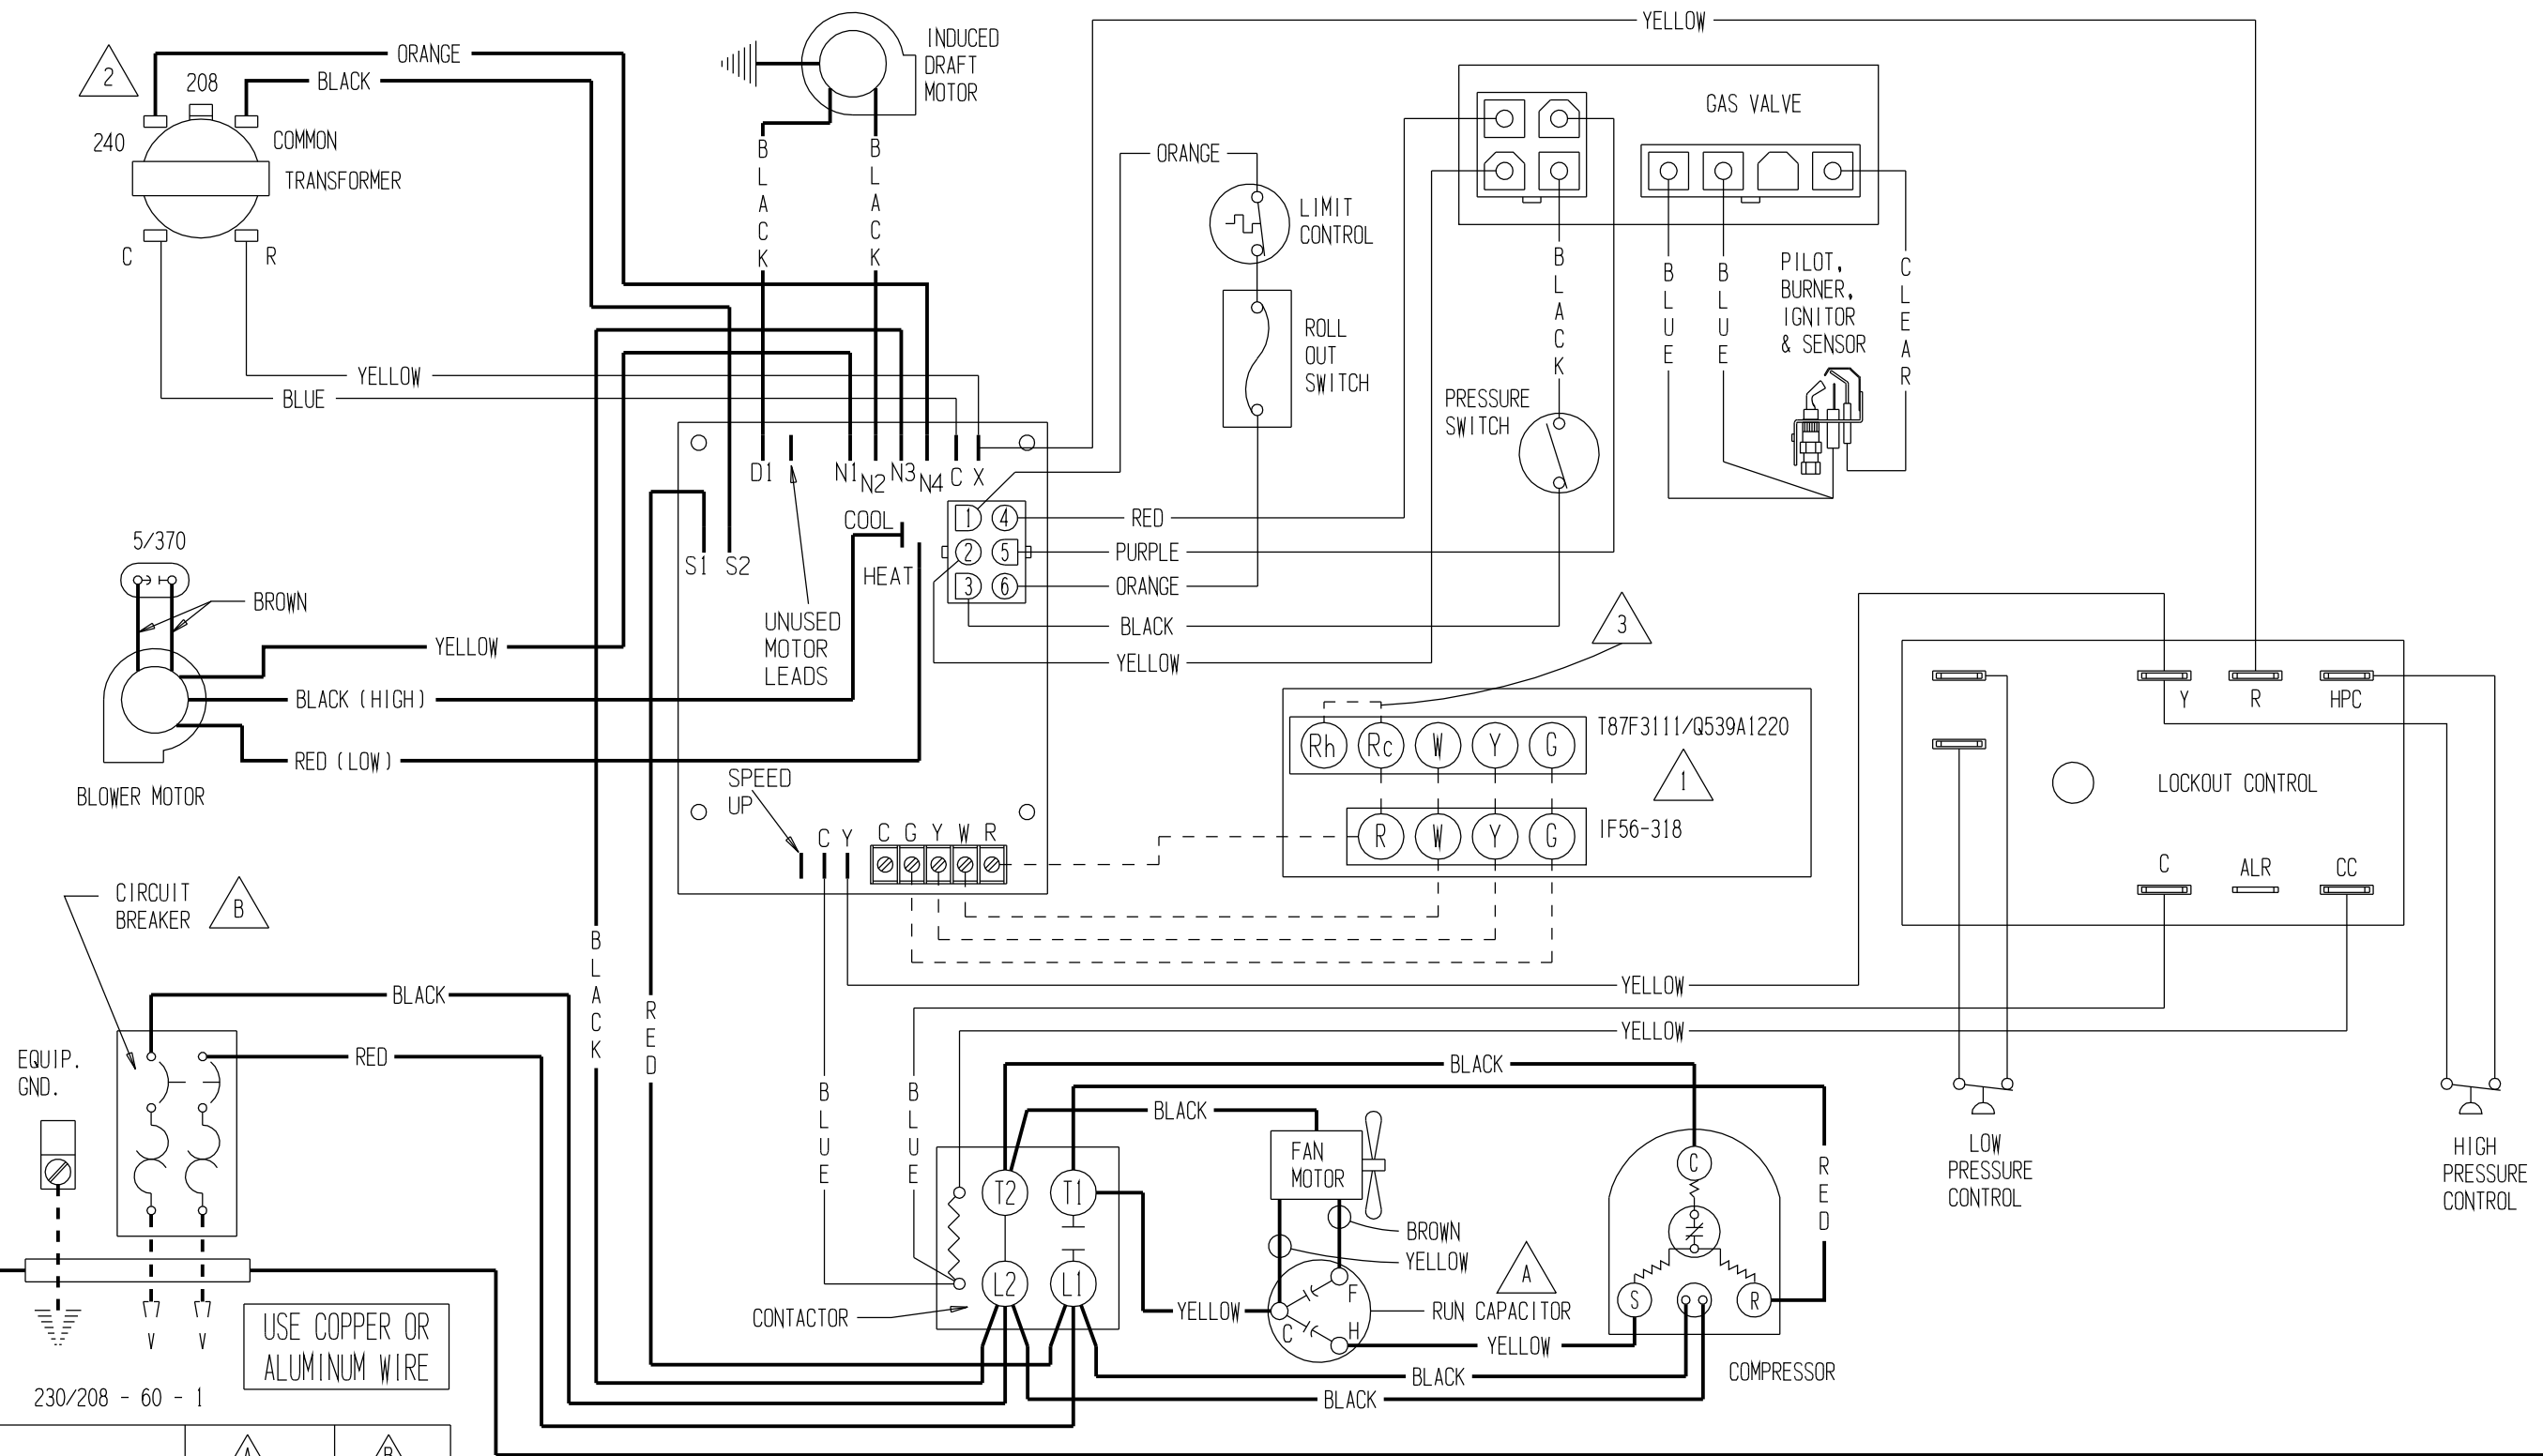

USE COPPER OR ALUMINUM WIRE  
230/208 - 60 - 1

MODEL	<b>A</b> RUN CAPACITOR	<b>B</b> CIRCUIT BREAKER
WAG30D-A54C	35+5/370	35A
WAG36D-A54C	40+10/370	40A
WAG40D-A54C	40+10/440	45A

	FACTORY WIRING	FIELD WIRING
Low Voltage	—	- - - -
High Voltage	—	- - - -

IF ANY OF THE ORIGINAL WIRE AS SUPPLIED WITH THE APPLIANCE MUST BE REPLACED, IT MUST BE REPLACED WITH WIRING MATERIAL HAVING A TEMPERATURE RATING OF ATLEAST 105°C EXCEPT THE IGNITION CABLE WHICH IS 250°C HIGH VOLTAGE CABLE.

**1** SET HEAT ANTICIPATOR AT .6 A **2** FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP **3** ADD JUMPER R<sub>c</sub> - R<sub>h</sub>