


CONNECTION DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD,
DISCONNECT POWER BEFORE SERVICING

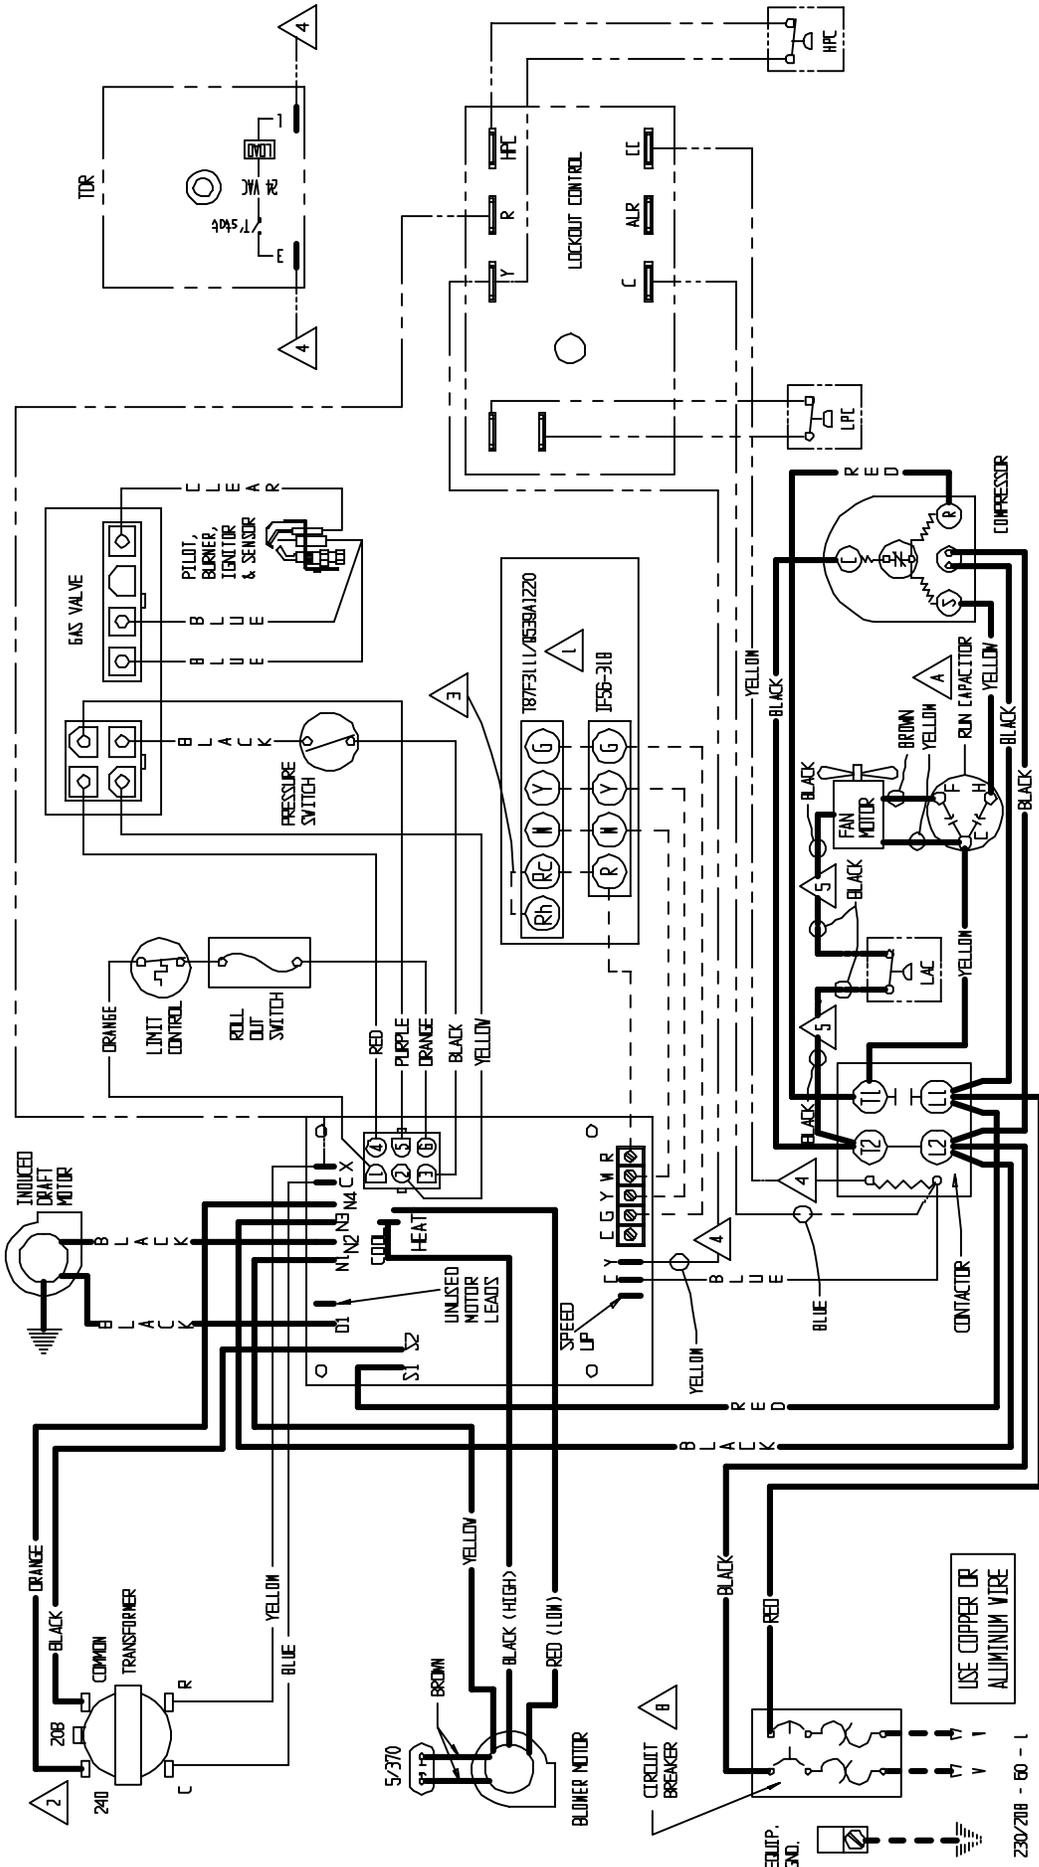

IF ANY OF THE ORIGINAL WIRE AS SUPPLIED WITH THE APPLIANCE MUST BE REPLACED, IT MUST BE REPLACED WITH WIRING MATERIAL HAVING A TEMPERATURE RATING OF ATLEAST 105°C EXCEPT THE IGNITION CABLE WHICH IS 250°C HIGH VOLTAGE CABLE.

FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE	---	---
LOW VOLTAGE	---	---
ACCESSORY	---	---

1. SET HEAT ANTICIPATOR AT .6 A 2. FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP 3. ADD JUMPER RE - Rth 4. 5. LABELLED WIRES CONNECT IF NO OPTIONS USED

MODEL	MIN CAPACITOR	CIRCUIT BREAKER
VAL300-AS4C	35+5/370	35A
VAL360-AS4C	40+10/370	40A
VAL400-AS4C	40+10/440	45A