



CONNECTION DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD,
DISCONNECT POWER BEFORE SERVICING

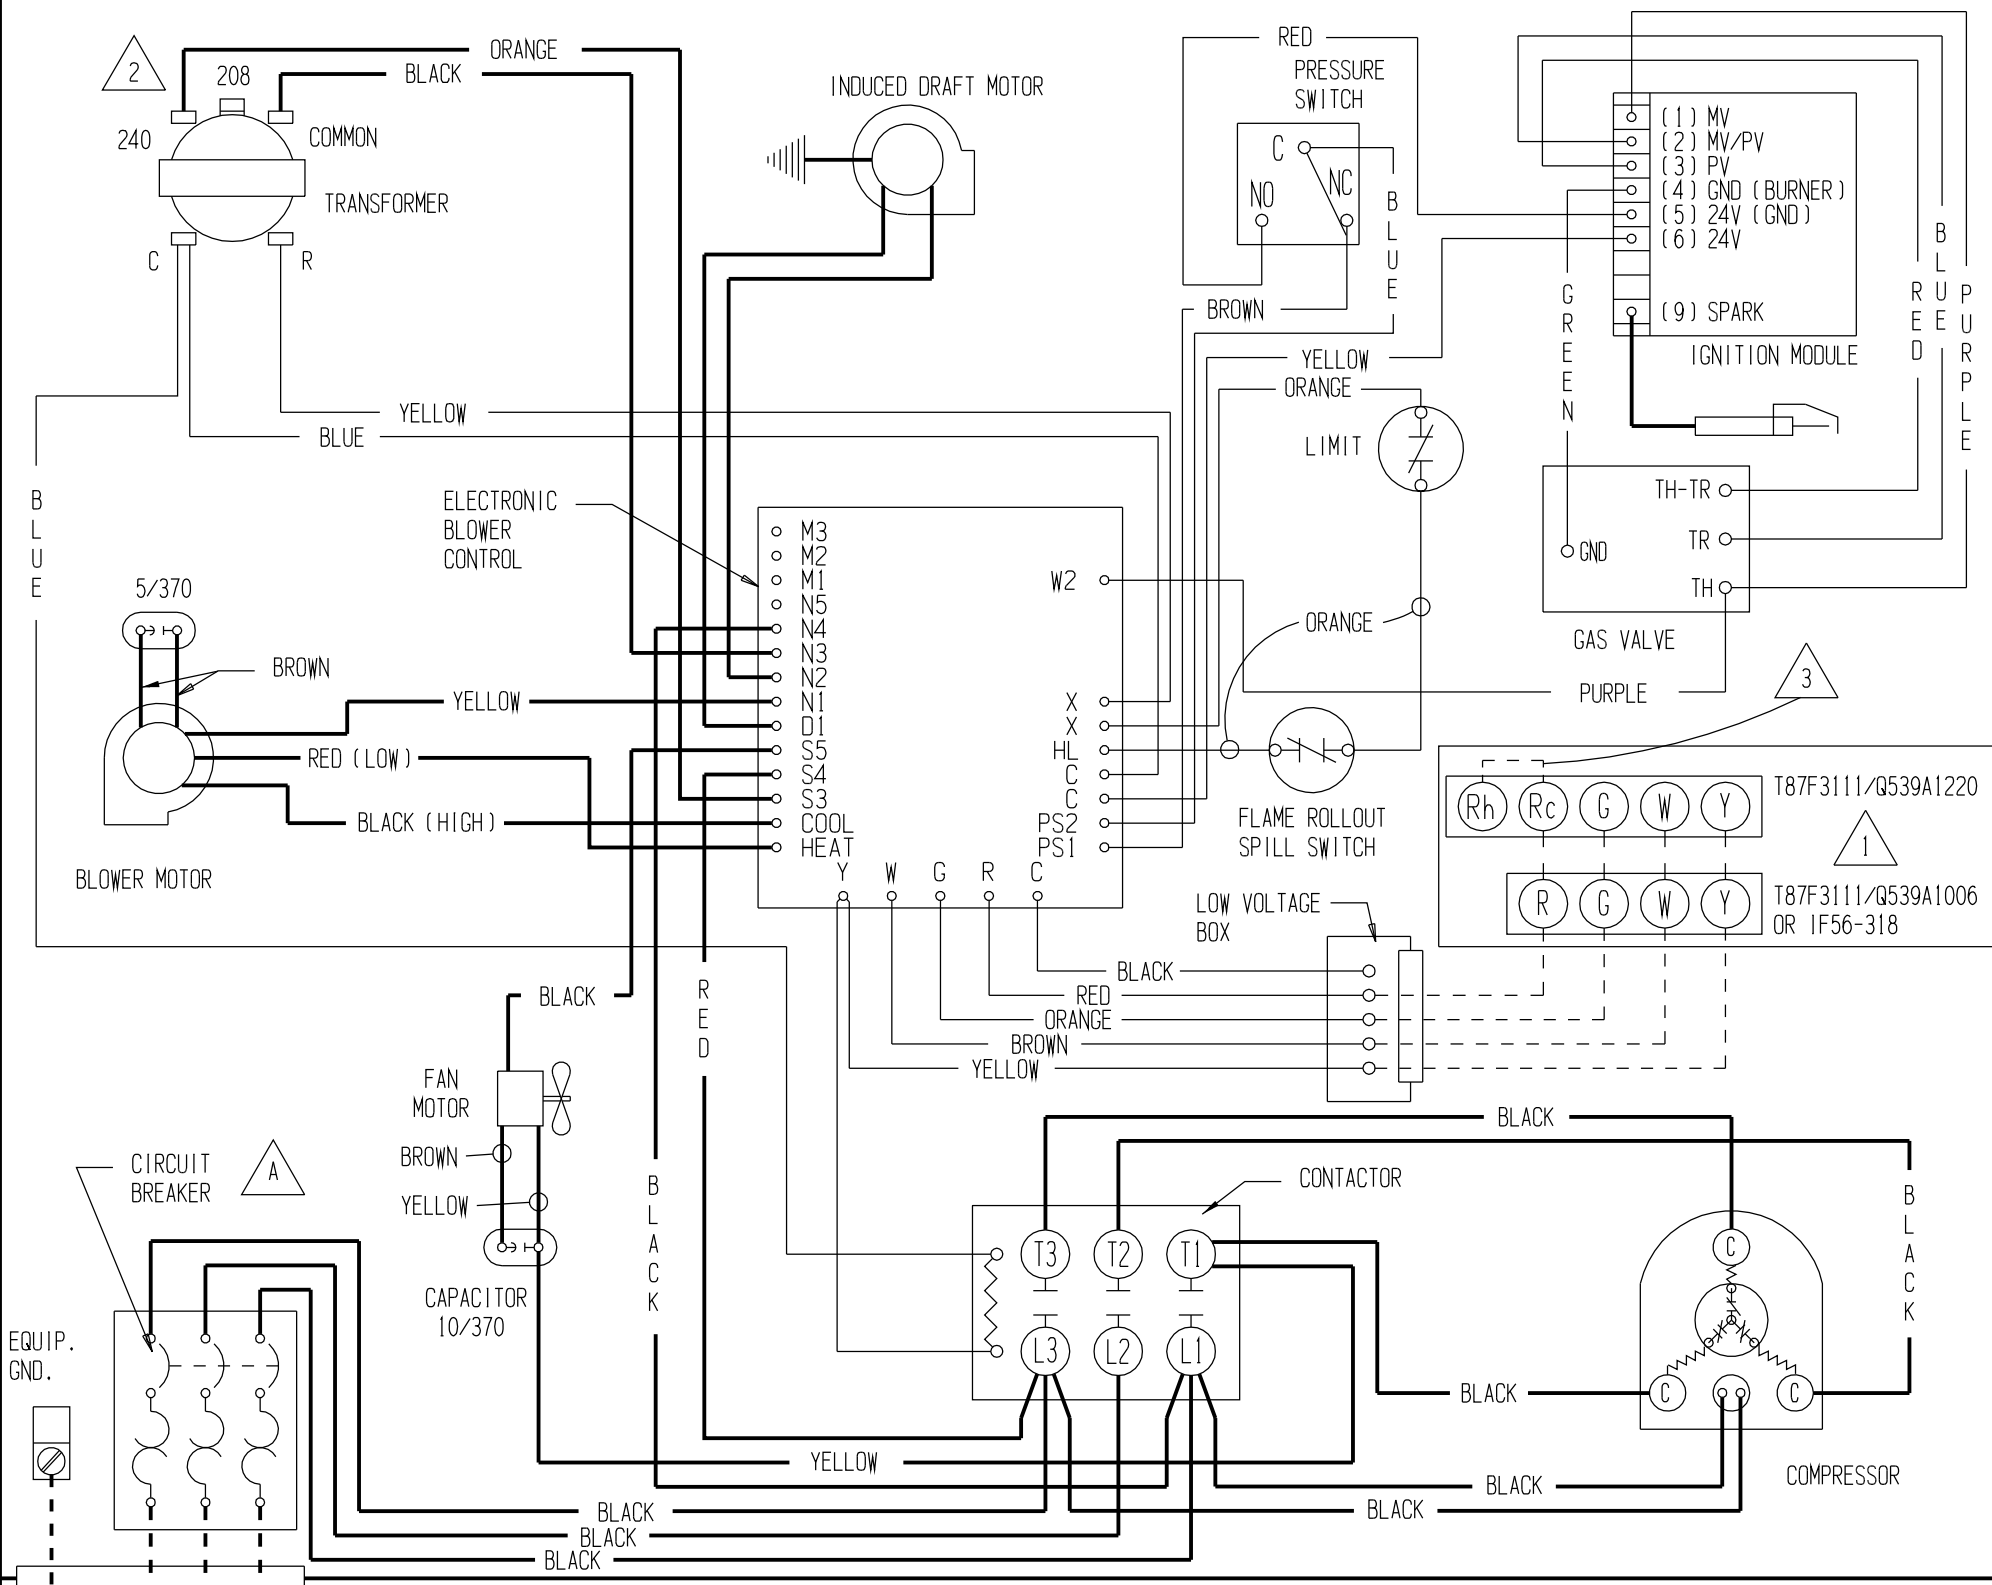

LADDER DIAGRAM

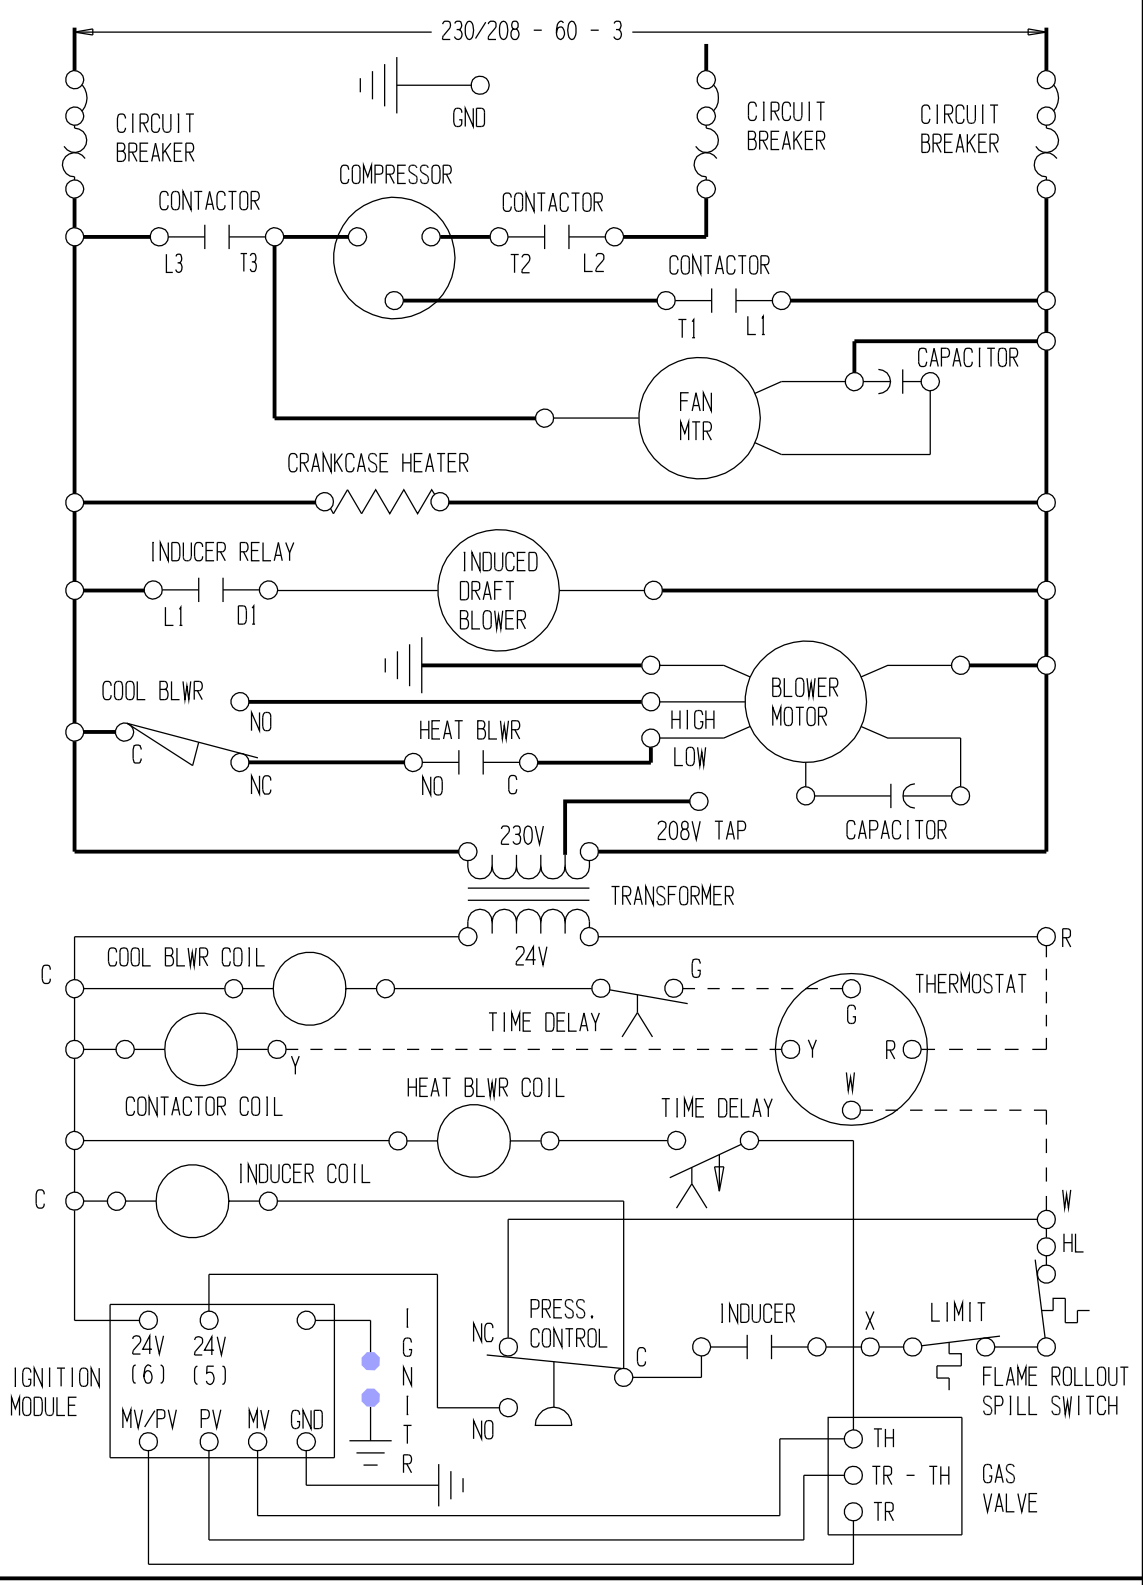


USE COPPER OR ALUMINUM WIRE

1 SET HEAT ANTICIPATOR AT .6 A

2 FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP

MODEL	CIRCUIT BREAKER
WAG36A-B54C	30A
WAG40A-B54C	35A

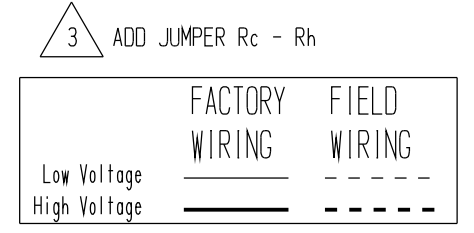

IF ANY OF THE ORIGINAL WIRE AS SUPPLIED WITH THE APPLIANCE MUST BE REPLACED, IT MUST BE REPLACED WITH WIRING MATERIAL HAVING A TEMPERATURE RATING OF AT LEAST 105° C. EXCEPT THE IGNITION CABLE WHICH IS 250° C. HIGH VOLTAGE CABLE.