


CONNECTION DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD,
DISCONNECT POWER BEFORE SERVICING

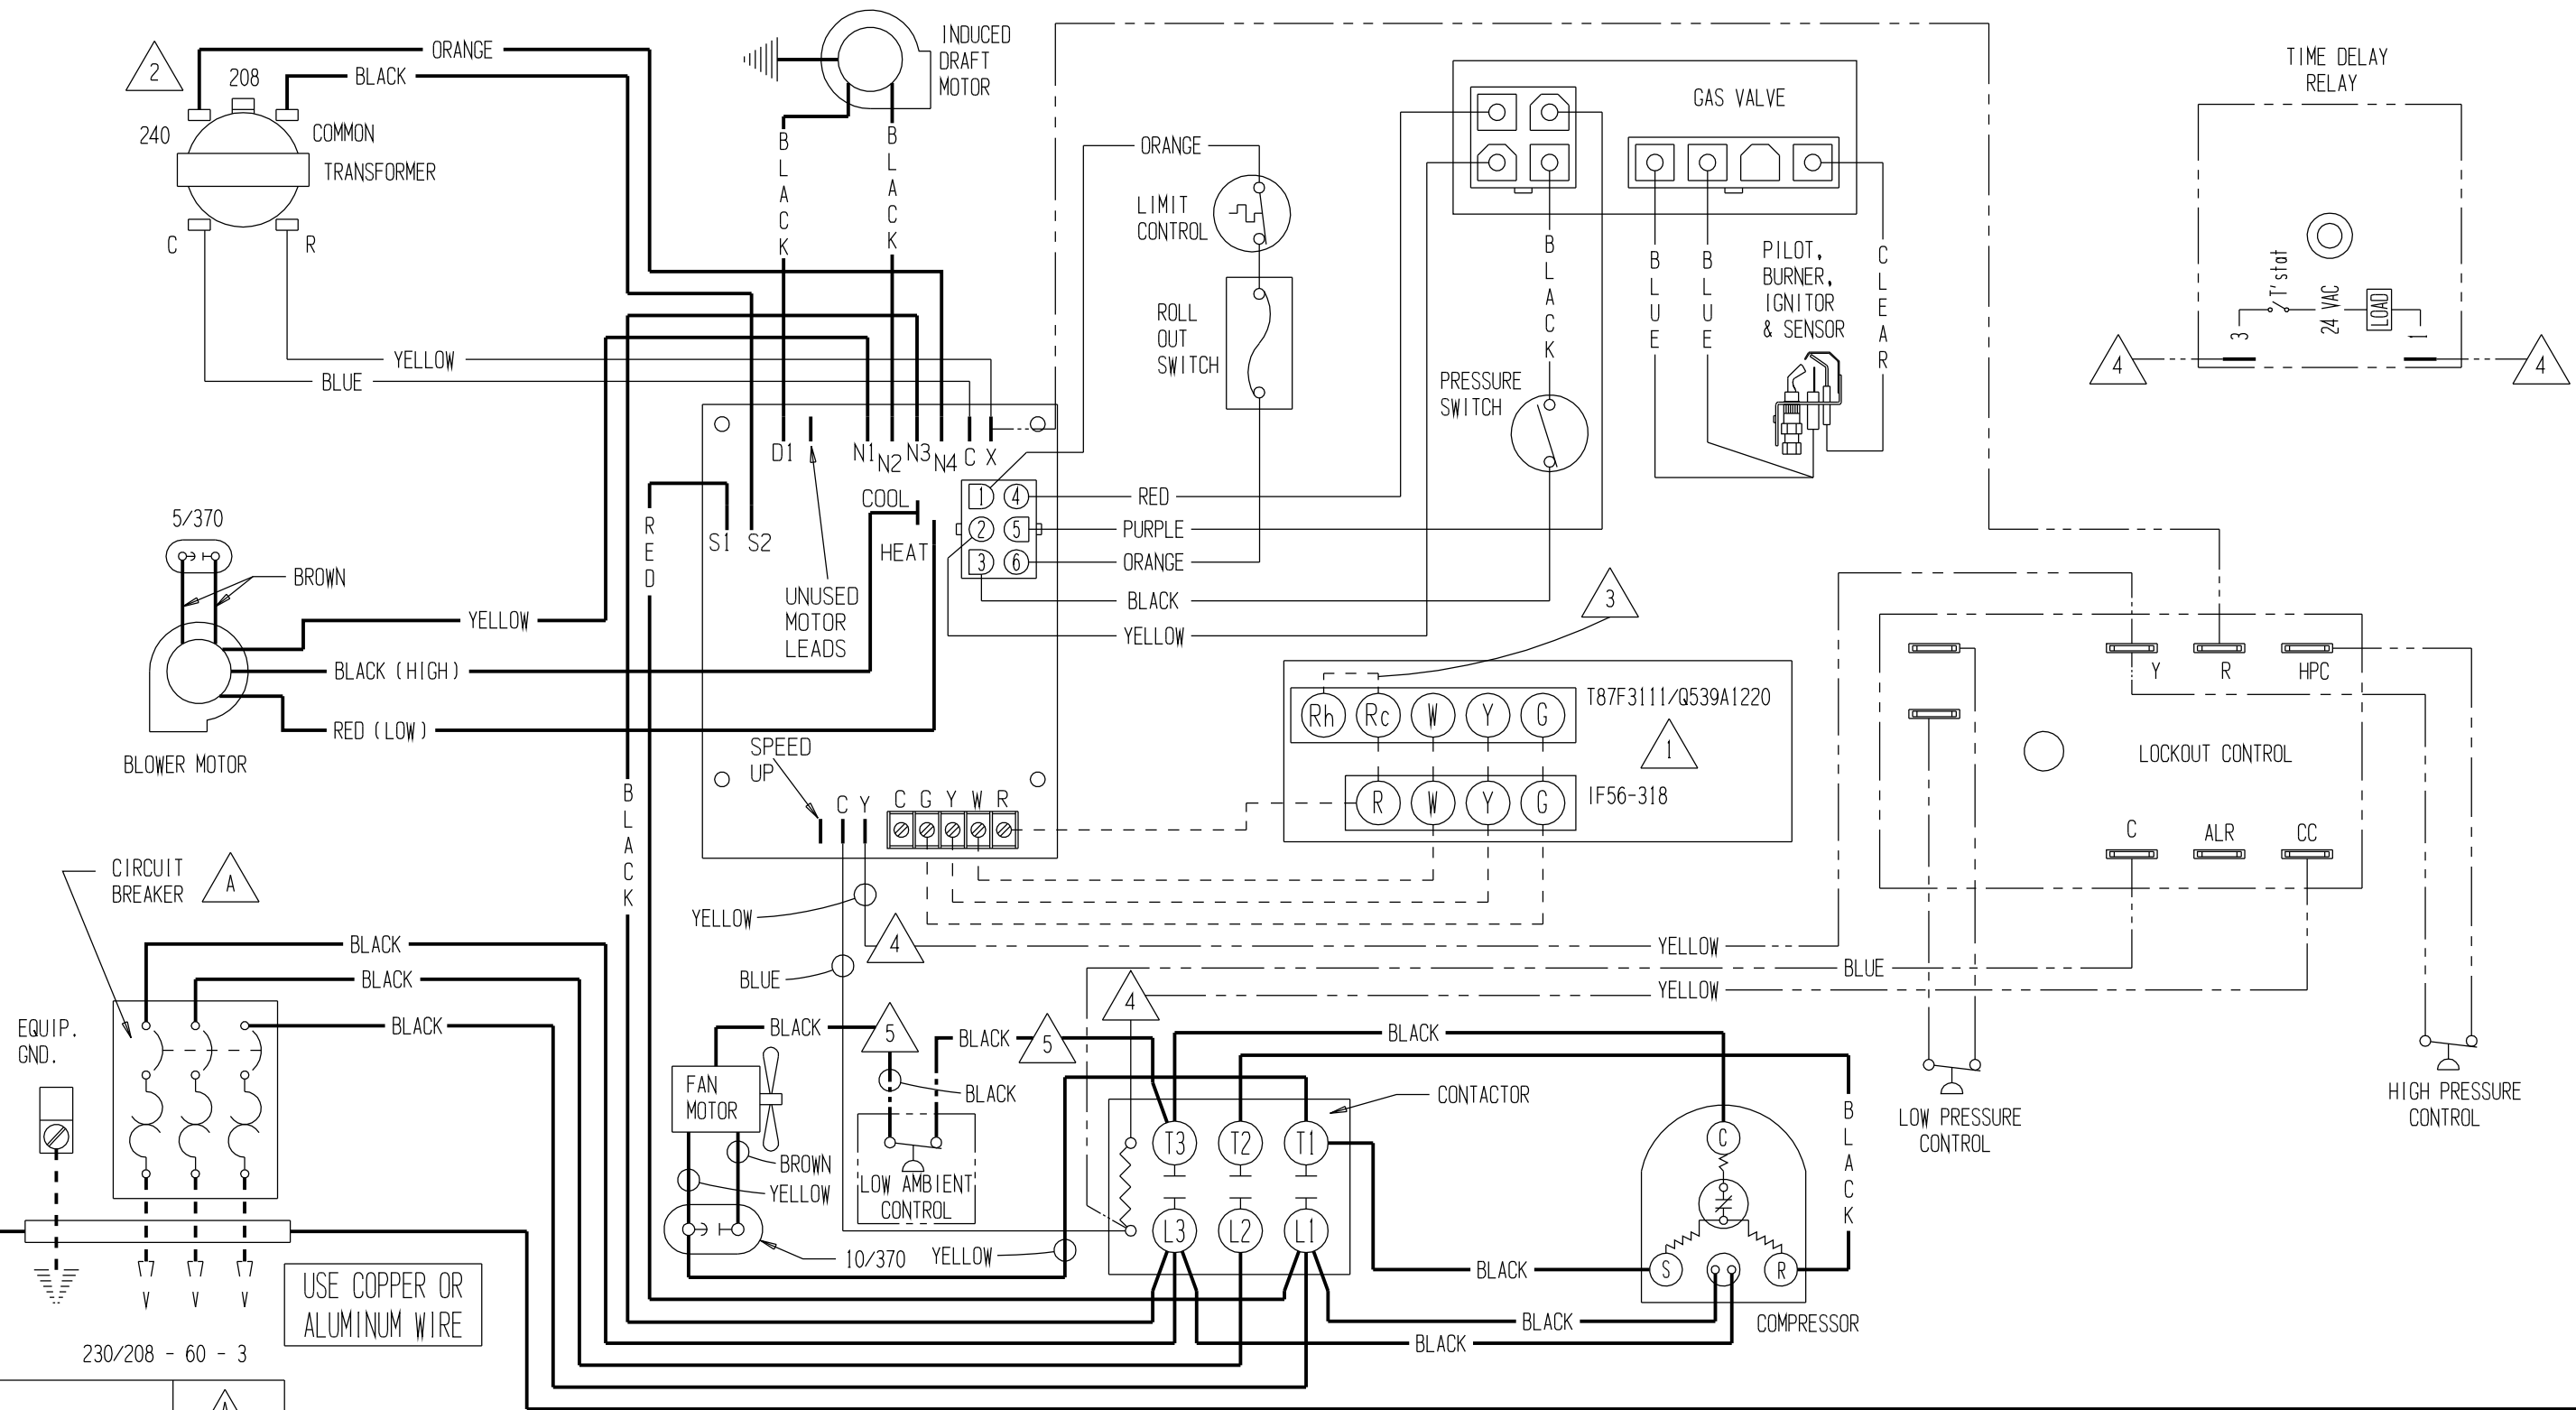

CIRCUIT BREAKER Δ

EQUIP. GND.

USE COPPER OR ALUMINUM WIRE

230/208 - 60 - 3

MODEL	Δ CIRCUIT BREAKER
WAG36D-B54C	30A
WAG40D-B54C	30A

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE	————	- - - -	· · · ·
LOW VOLTAGE	————	- - - -	· · · ·
ACCESSORY	————	- - - -	· · · ·

IF ANY OF THE ORIGINAL WIRE AS SUPPLIED WITH THE APPLIANCE MUST BE REPLACED, IT MUST BE REPLACED WITH WIRING MATERIAL HAVING A TEMPERATURE RATING OF AT LEAST 105°C EXCEPT THE IGNITION CABLE WHICH IS 250°C HIGH VOLTAGE CABLE.

- Δ 1 SET HEAT ANTICIPATOR AT .6 A
- Δ 2 FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP
- Δ 3 ADD JUMPER Rc - Rh
- Δ 4
- Δ 5 LABELED WIRES CONNECT IF NO OPTIONS USED