


# CONNECTION DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD,  
DISCONNECT POWER BEFORE SERVICING

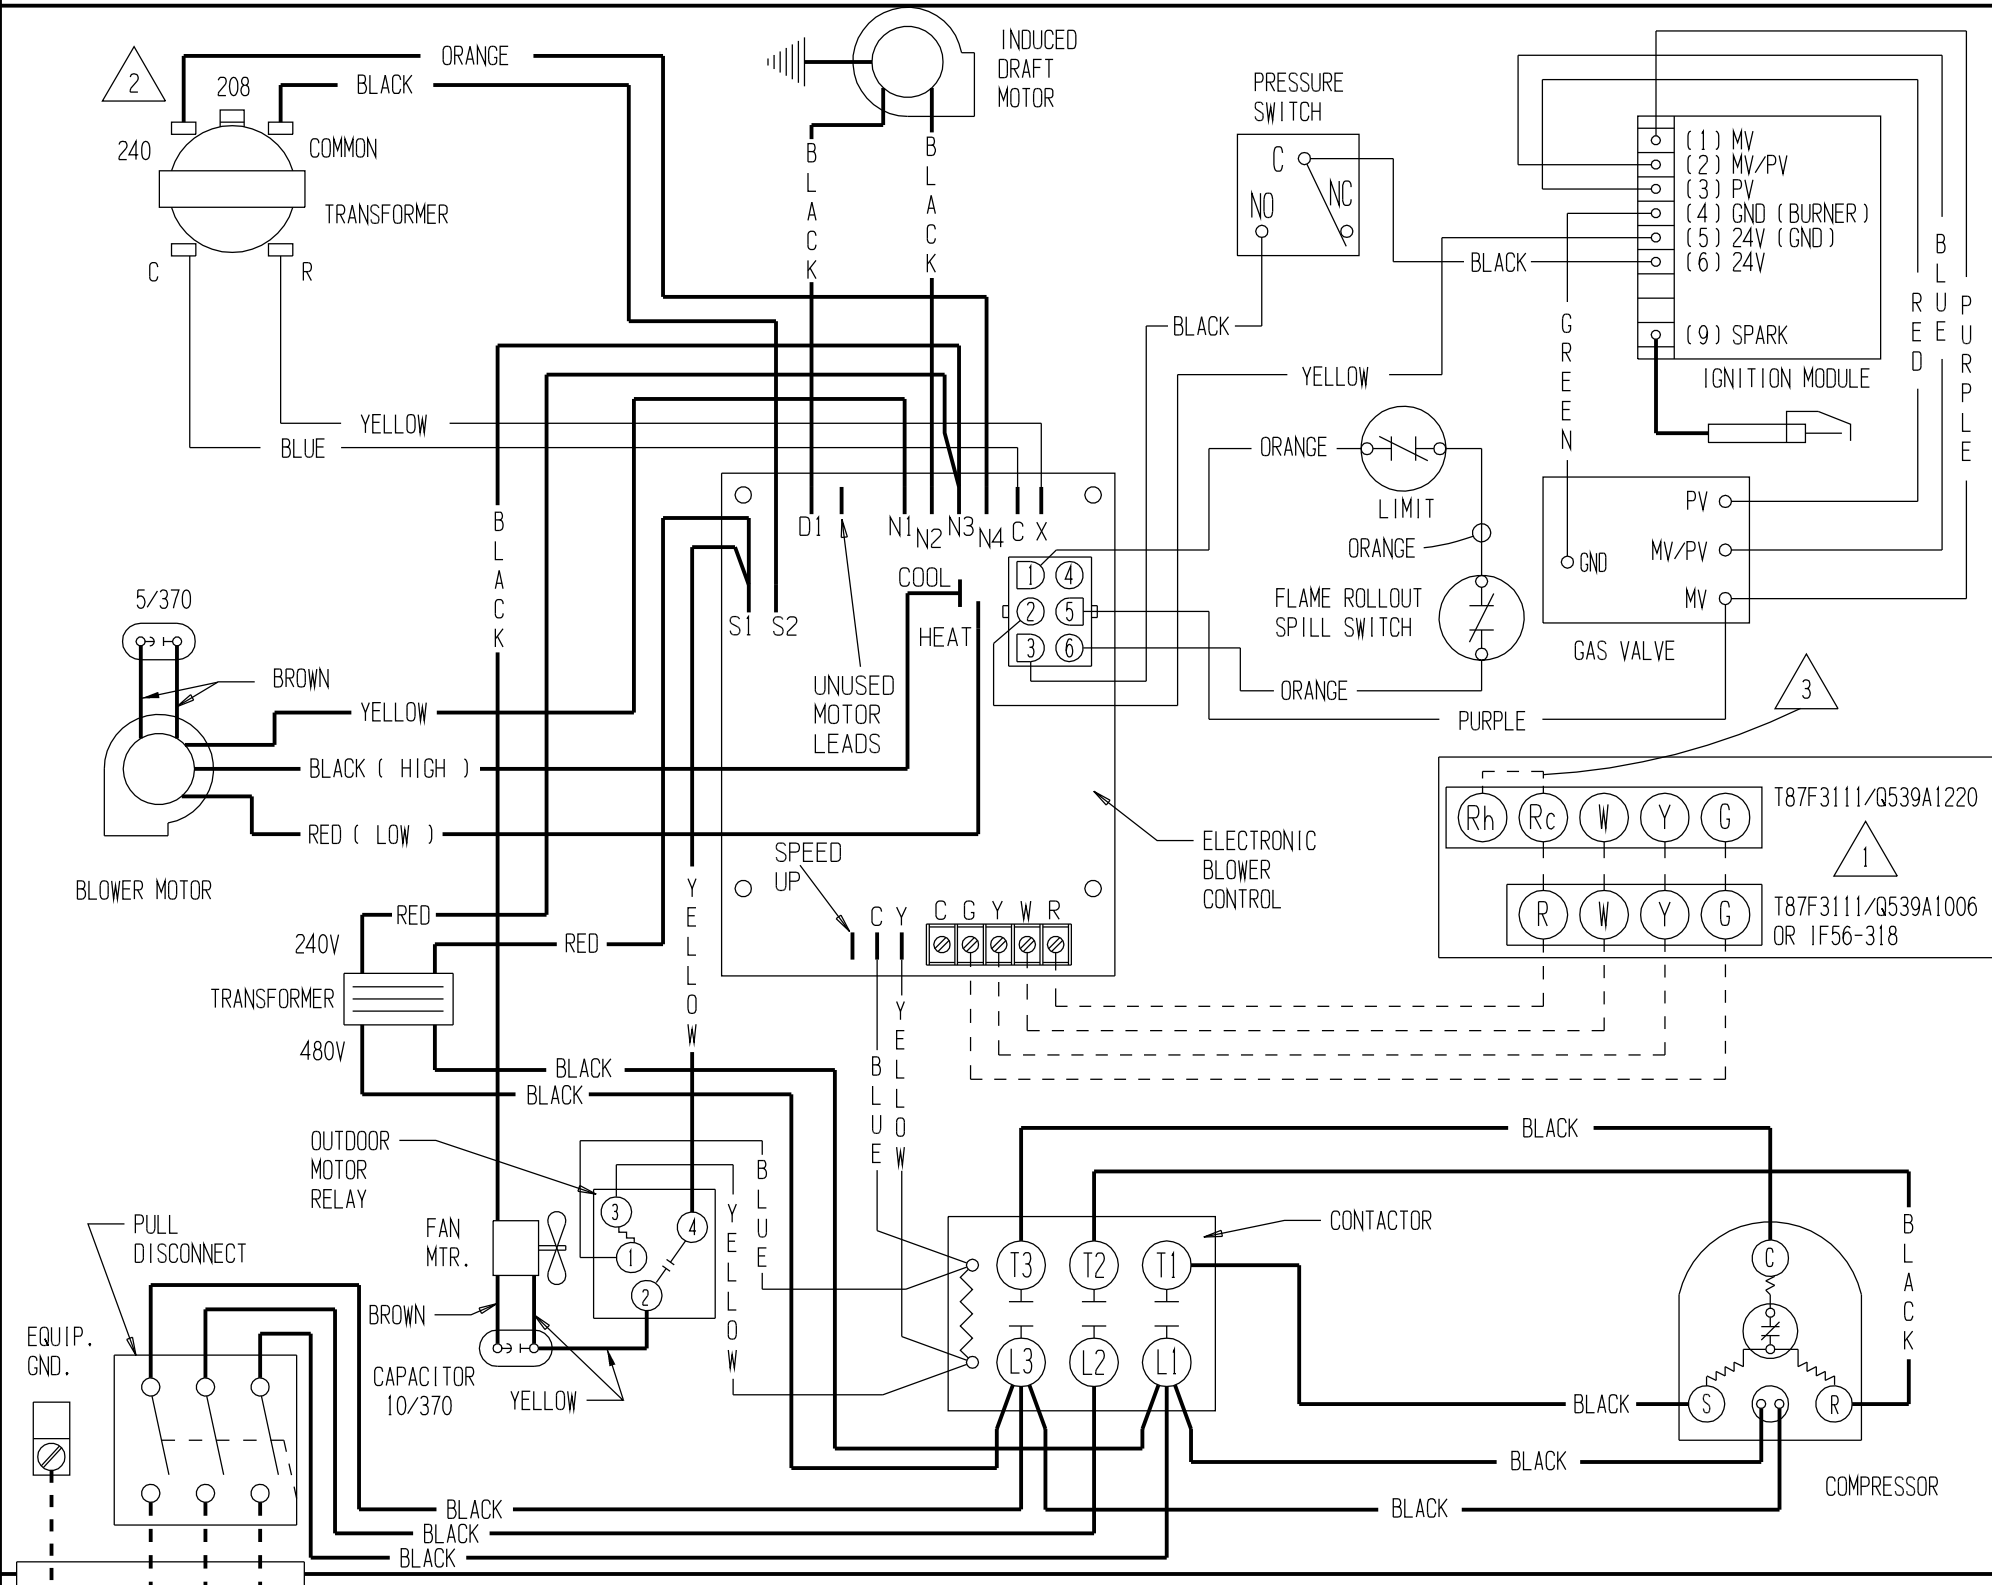

USE COPPER OR ALUMINUM WIRE

	FACTORY WIRING	FIELD WIRING
Low Voltage	—————	- - - - -
High Voltage	—————	- - - - -

IF ANY OF THE ORIGINAL WIRE AS SUPPLIED WITH THE APPLIANCE MUST BE REPLACED, IT MUST BE REPLACED WITH WIRING MATERIAL HAVING A TEMPERATURE RATING OF AT LEAST 105°C EXCEPT THE IGNITION CABLE WHICH IS 250°C HIGH VOLTAGE CABLE.

1 SET HEAT ANTICIPATOR AT .6 A    2 FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP    3 ADD JUMPER R<sub>c</sub> - R<sub>h</sub>

# LADDER DIAGRAM

