


QH SERIES HEAT PUMP CONNECTION DIAGRAM

FOR USE WITH "A" OR "G" CLIMATE CONTROL OPTION

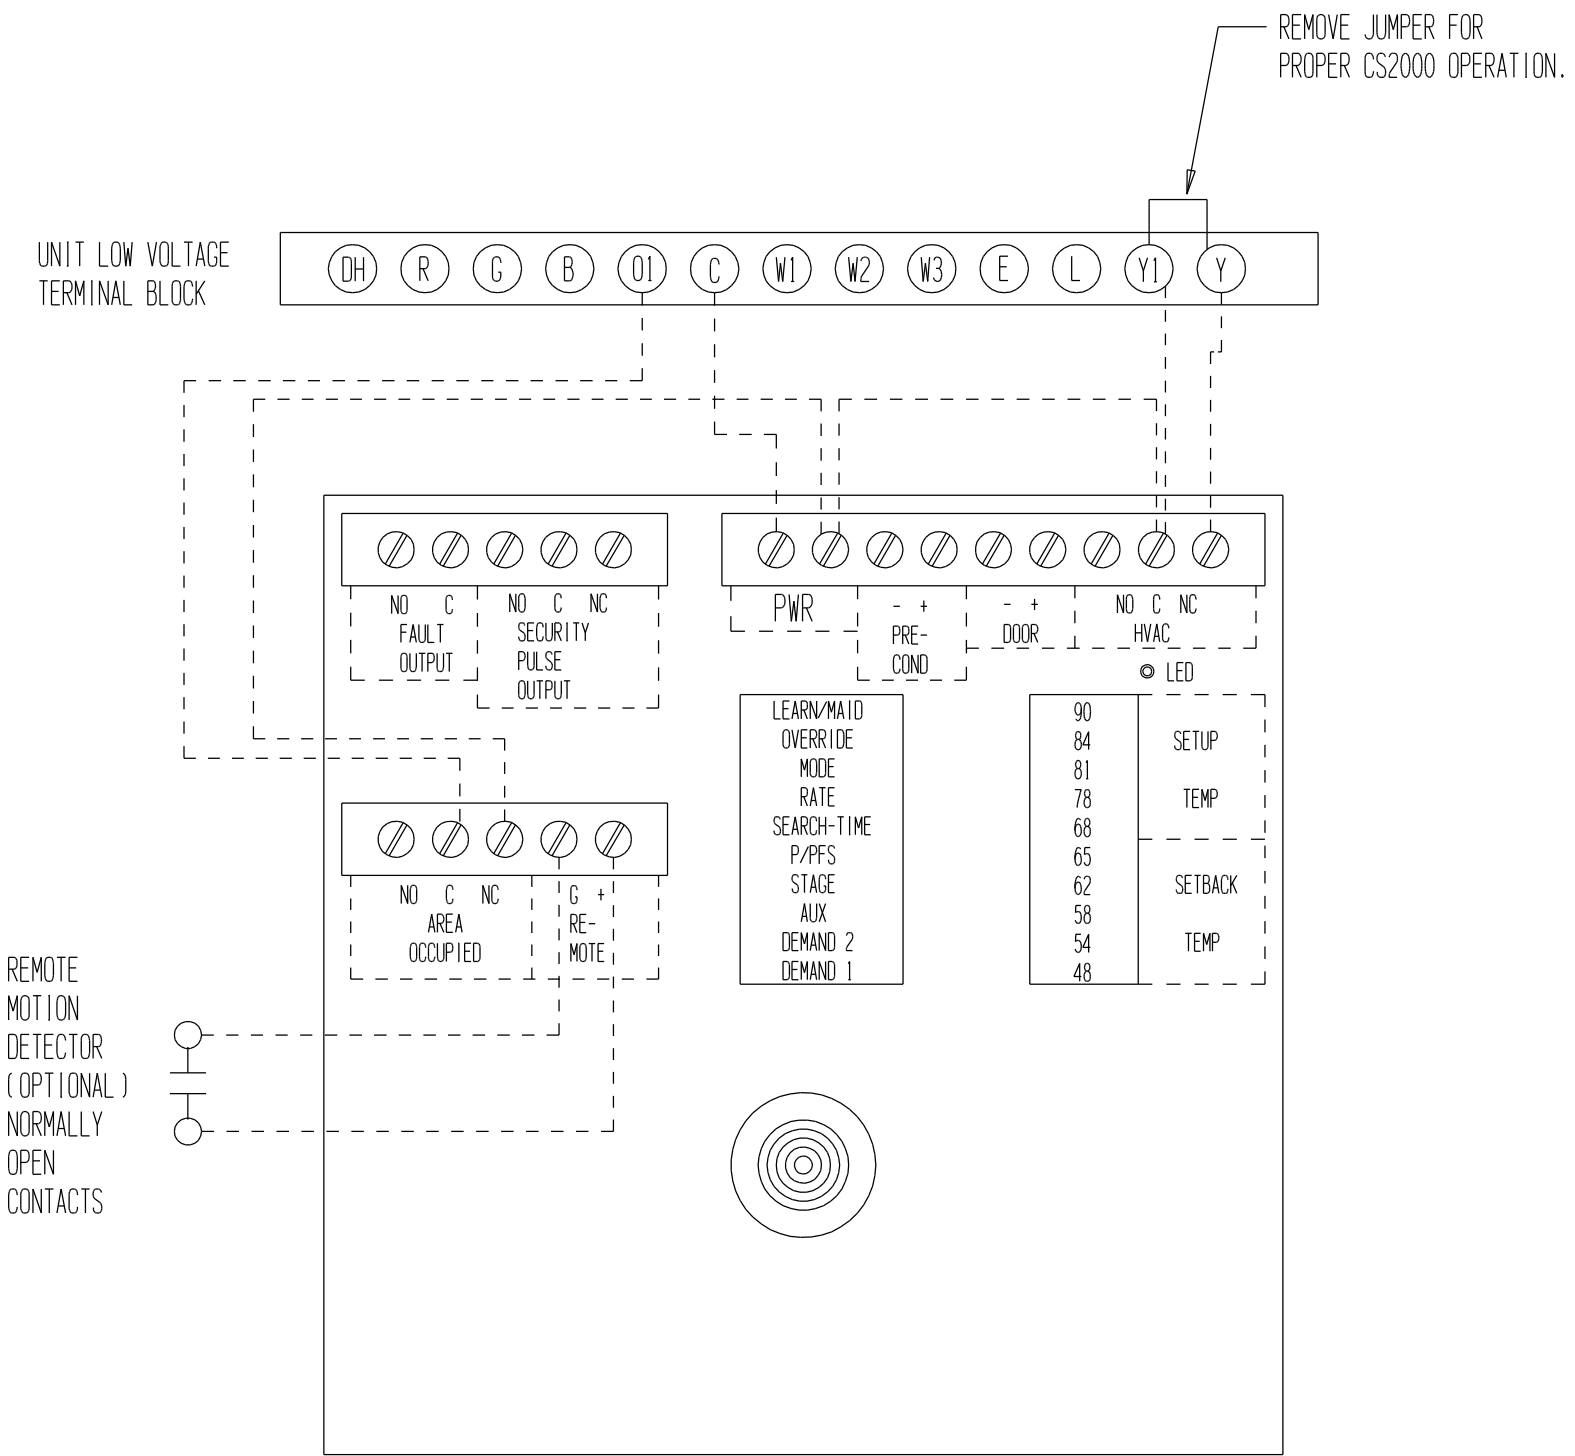

RECOMMENDED SWITCH SETTINGS SHOWN BELOW

THIS SYSTEM MAY BE CUSTOMIZED TO INDIVIDUAL INSTALLATIONS. REFER TO CS2000 TECHNICAL REFERENCE MANUAL FOR CUSTOMIZATION OPTIONS.

FUNCTION SWITCHES

| | |
|-------------|--|
| LEARN/MAID | |
| OVERRIDE | |
| MODE | |
| RATE | |
| SEARCH-TIME | |
| P/PFS | |
| STAGE | |
| AUX | |
| DEMAND 2 | |
| DEMAND 1 | |

TEMPERATURE SWITCHES

| | |
|--|----|
| | 90 |
| | 84 |
| | 81 |
| | 78 |
| | 68 |
| | 65 |
| | 62 |
| | 58 |
| | 54 |
| | 48 |