


QA SERIES AIR CONDITIONER CONNECTION DIAGRAM
FOR USE WITH "X" CLIMATE CONTROL OPTION

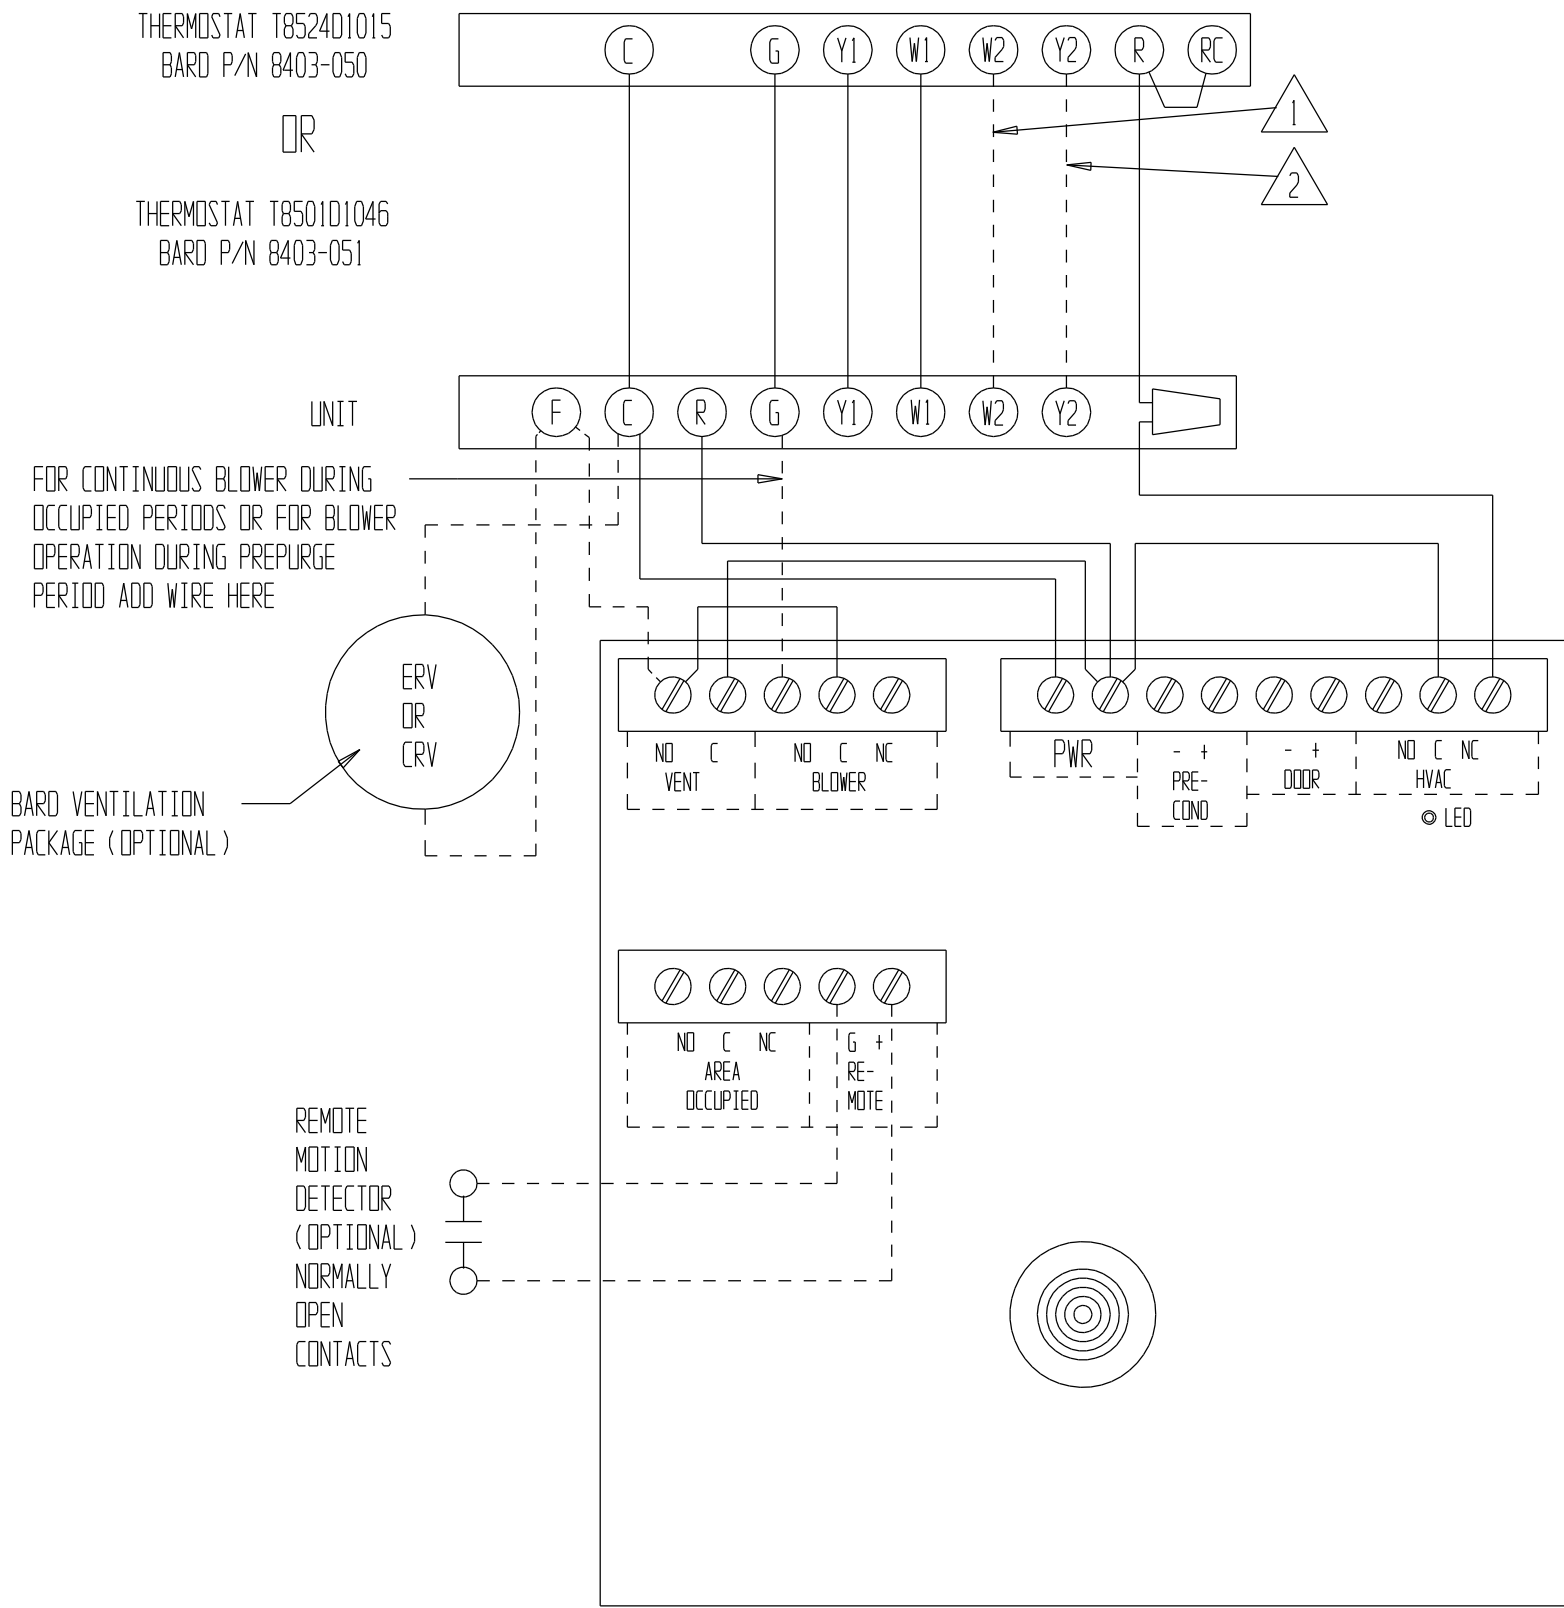

- △ 1 NEEDED WHEN 2 STAGE OF ELECTRIC HEAT ARE REQUIRED.
- △ 2 REQUIRED FOR 2 STAGE COOLING UNITS OR UNITS WITH ECONOMIZERS.

RECOMMENDED SWITCH SETTINGS SHOWN BELOW

FUNCTION SWITCHES		TEMPERATURE SWITCHES	
LEARN			90
PRE P			84
MODE			81
RATE			78
SEARCH-TIME			68
N/C			65
STAGE			62
AUX			58
DEMAND 2			54
DEMAND 1			48