


USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT
LEAST 75° C

COMPONENT CODE			
ALR	ALARM RELAY (OPT.)	LAC	LOW AMBIENT CONTROL (OPT.)
CC	COMPRESSOR CONTACTOR	LPC	LOW PRESSURE CONTROL (OPT.)
CCM	COMPRESSOR CONTROL MODULE	LS	LIMIT SWITCH
COMP	COMPRESSOR	OFM	OUTDOOR FAN MOTOR
DCC	DUAL CAN CAPACITOR	T	TRANSFORMER
GND	EQUIPMENT GROUND	TB	TERMINAL BLOCK
H1	HEAT STRIP #1	TB2	TERMINAL BLOCK 2 (OPT.)
HC1	HEATER CONTACTOR #1	TBL	LOW VOLTAGE TERMINAL BLOCK
HPC	HIGH PRESSURE CONTROL	TCD	THERMAL CUTOFF
IBC	INDOOR BLOWER CAPACITOR		
IBM	INDOOR BLOWER MOTOR		
IBR	INDOOR BLOWER RELAY		

⚠️ ⚠️ LABELED WIRES CONNECT IF NO OPTIONS USED.

⚠️ MOVE RED WIRE TO 208V TAP FOR 208V OPERATION

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE	————	-----	-----
LOW VOLTAGE	————	-----	-----
ACCESSORY	————	-----	-----

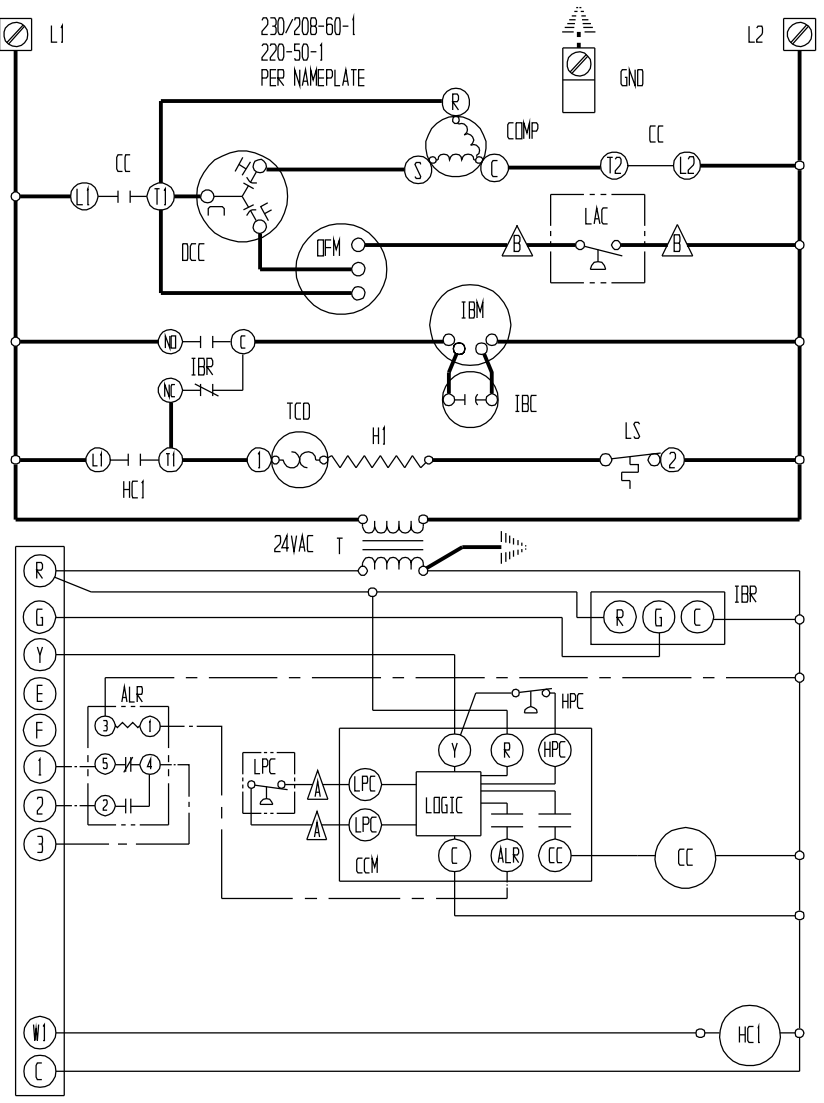

COLOR CODE						
BK	BLACK	Y	YELLOW	V	VIOLET	T
BR	BROWN	G	GREEN	(PR)	PURPLE	PK
R	RED	BL	BLUE	GY	GRAY	L
D	ORANGE	W	WHITE	(S)	SLATE	

BARD MFG. CO.
4095-114 G