


USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT
LEAST 75° C

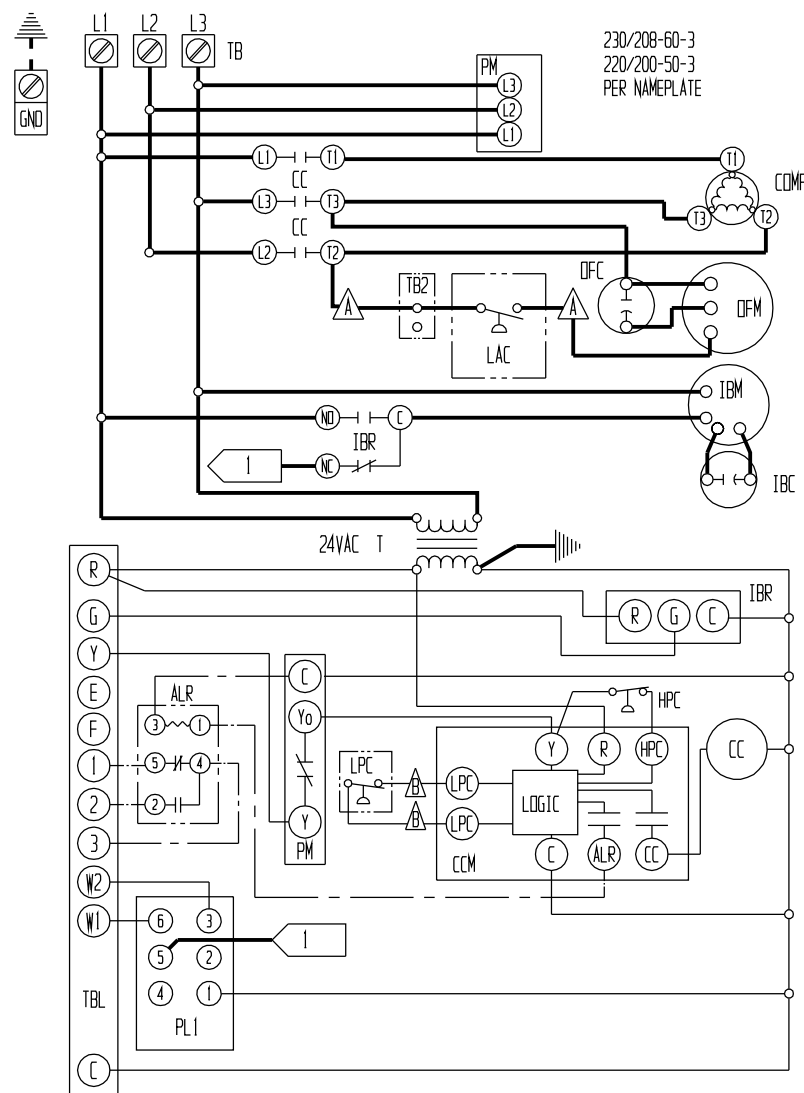

COMPONENT CODE			
ALR	ALARM RELAY	IBM	INDOOR BLOWER MOTOR
CB1	CIRCUIT BREAKER #1	IBR	INDOOR BLOWER RELAY
CB2	CIRCUIT BREAKER #2	LAC	LOW AMBIENT CONTROL
CC	COMPRESSOR CONTACTOR	LPC	LOW PRESSURE CONTROL
CCM	COMPRESSOR CONTROL MODULE	LS	LIMIT SWITCH
COMP	COMPRESSOR	OFC	OUTDOOR FAN CAPACITOR
GND	EQUIPMENT GROUND	OFM	OUTDOOR FAN MOTOR
H1	HEAT STRIP #1	PL1	PLUG #1
H2	HEAT STRIP #2	PM	PHASE MONITOR
HC1	HEATER CONTACTOR #1	T	TRANSFORMER
HC2	HEATER CONTACTOR #2	TB, TB2	TERMINAL BLOCK
HPC	HIGH PRESSURE CONTROL	TBL	LOW VOLTAGE TERMINAL BLOCK
IBC	INDOOR BLOWER CAPACITOR	TCD	THERMAL CUTOFF

△, △ Labeled wires connect if no options used. △ MOVE RED WIRE TO 208V TAP FOR 208V OPERATION △ RED (LOW) BLUE (MED) BLACK (HIGH) WHERE APPLICABLE

HIGH VOLTAGE LOW VOLTAGE ACCESSORY	FACTORY STD. FIELD OPTIONAL			COLOR CODE																		
	_____	-----	-----	BK	BR	R	O	Y	G	BL	W	V	(PR)	GY	(S)	T	PK	L	TAN	PINK	LAVENDER	
				BLACK	BROWN	RED	ORANGE	YELLOW	GREEN	BLUE	WHITE	VIOLET	PURPLE	GRAY	SLATE							

BARD MFG. CO.
4095-227 E