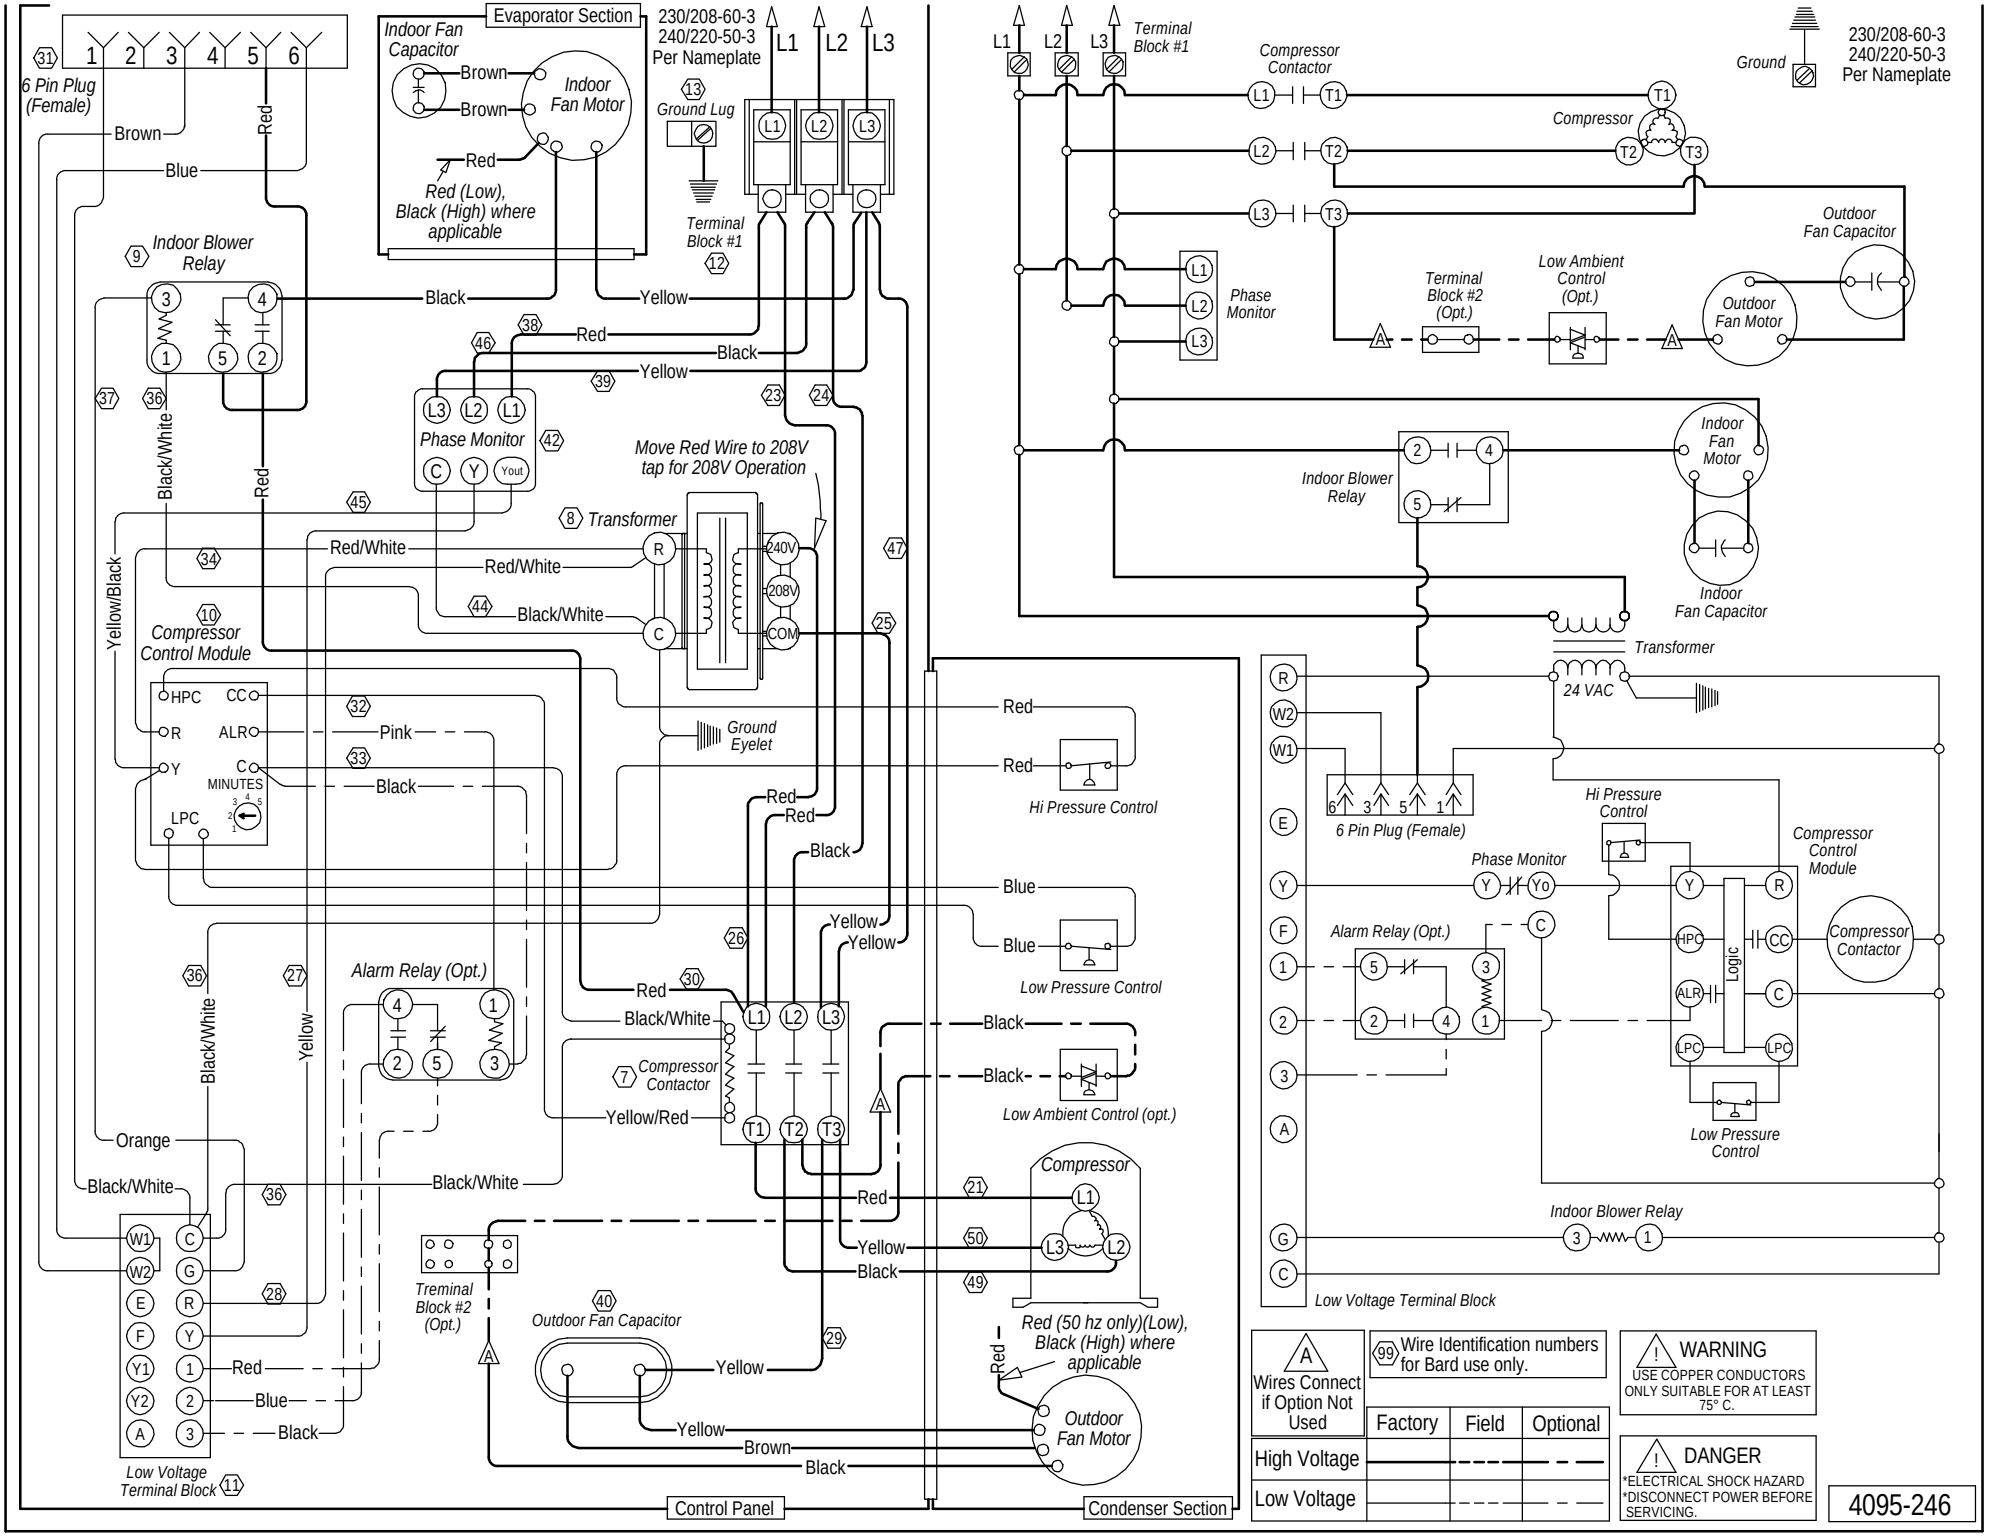
Evaporator Section
Indoor Fan Capacitor
Indoor Fan Motor
Brown
Red
Red (Low), Black (High) where applicable
6 Pin Plug (Female)
230/208-60-3
240/220-50-3
Per Nameplate
Ground Lug
Terminal Block #1
Indoor Blower Relay
Black
Yellow
Phase Monitor
Move Red Wire to 208V tap for 208V Operation
Transformer
240V
208V
COM
Red/White
Black/White
Yellow/Black
Compressor Control Module
HPC
CC
R
ALR
Y
C
MINUTES
LPC
Pink
Ground Eyelet
Hi Pressure Control
Low Pressure Control
Blue
Alarm Relay (Opt.)
Compressor Contactor
Yellow/Red
Low Ambient Control (opt.)
Orange
Compressor
Low Voltage Terminal Block
Treminal Block #2 (Opt.)
Outdoor Fan Capacitor
Red (50 hz only)(Low), Black (High) where applicable
Outdoor Fan Motor
Control Panel
Condenser Section
Terminal Block #1
Compressor Contactor
Compressor
Ground
230/208-60-3
240/220-50-3
Per Nameplate
Phase Monitor
Terminal Block #2 (Opt.)
Low Ambient Control (Opt.)
Outdoor Fan Capacitor
Outdoor Fan Motor
Indoor Blower Relay
Indoor Fan Motor
Indoor Fan Capacitor
Transformer
24 VAC
6 Pin Plug (Female)
Hi Pressure Control
Phase Monitor
Compressor Control Module
Alarm Relay (Opt.)
Logic
Compressor Contactor
Low Pressure Control
Indoor Blower Relay
Low Voltage Terminal Block
Wires Connect if Option Not Used
Wire Identification numbers for Bard use only.
Factory
Field
Optional
High Voltage
Low Voltage
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
4095-246