

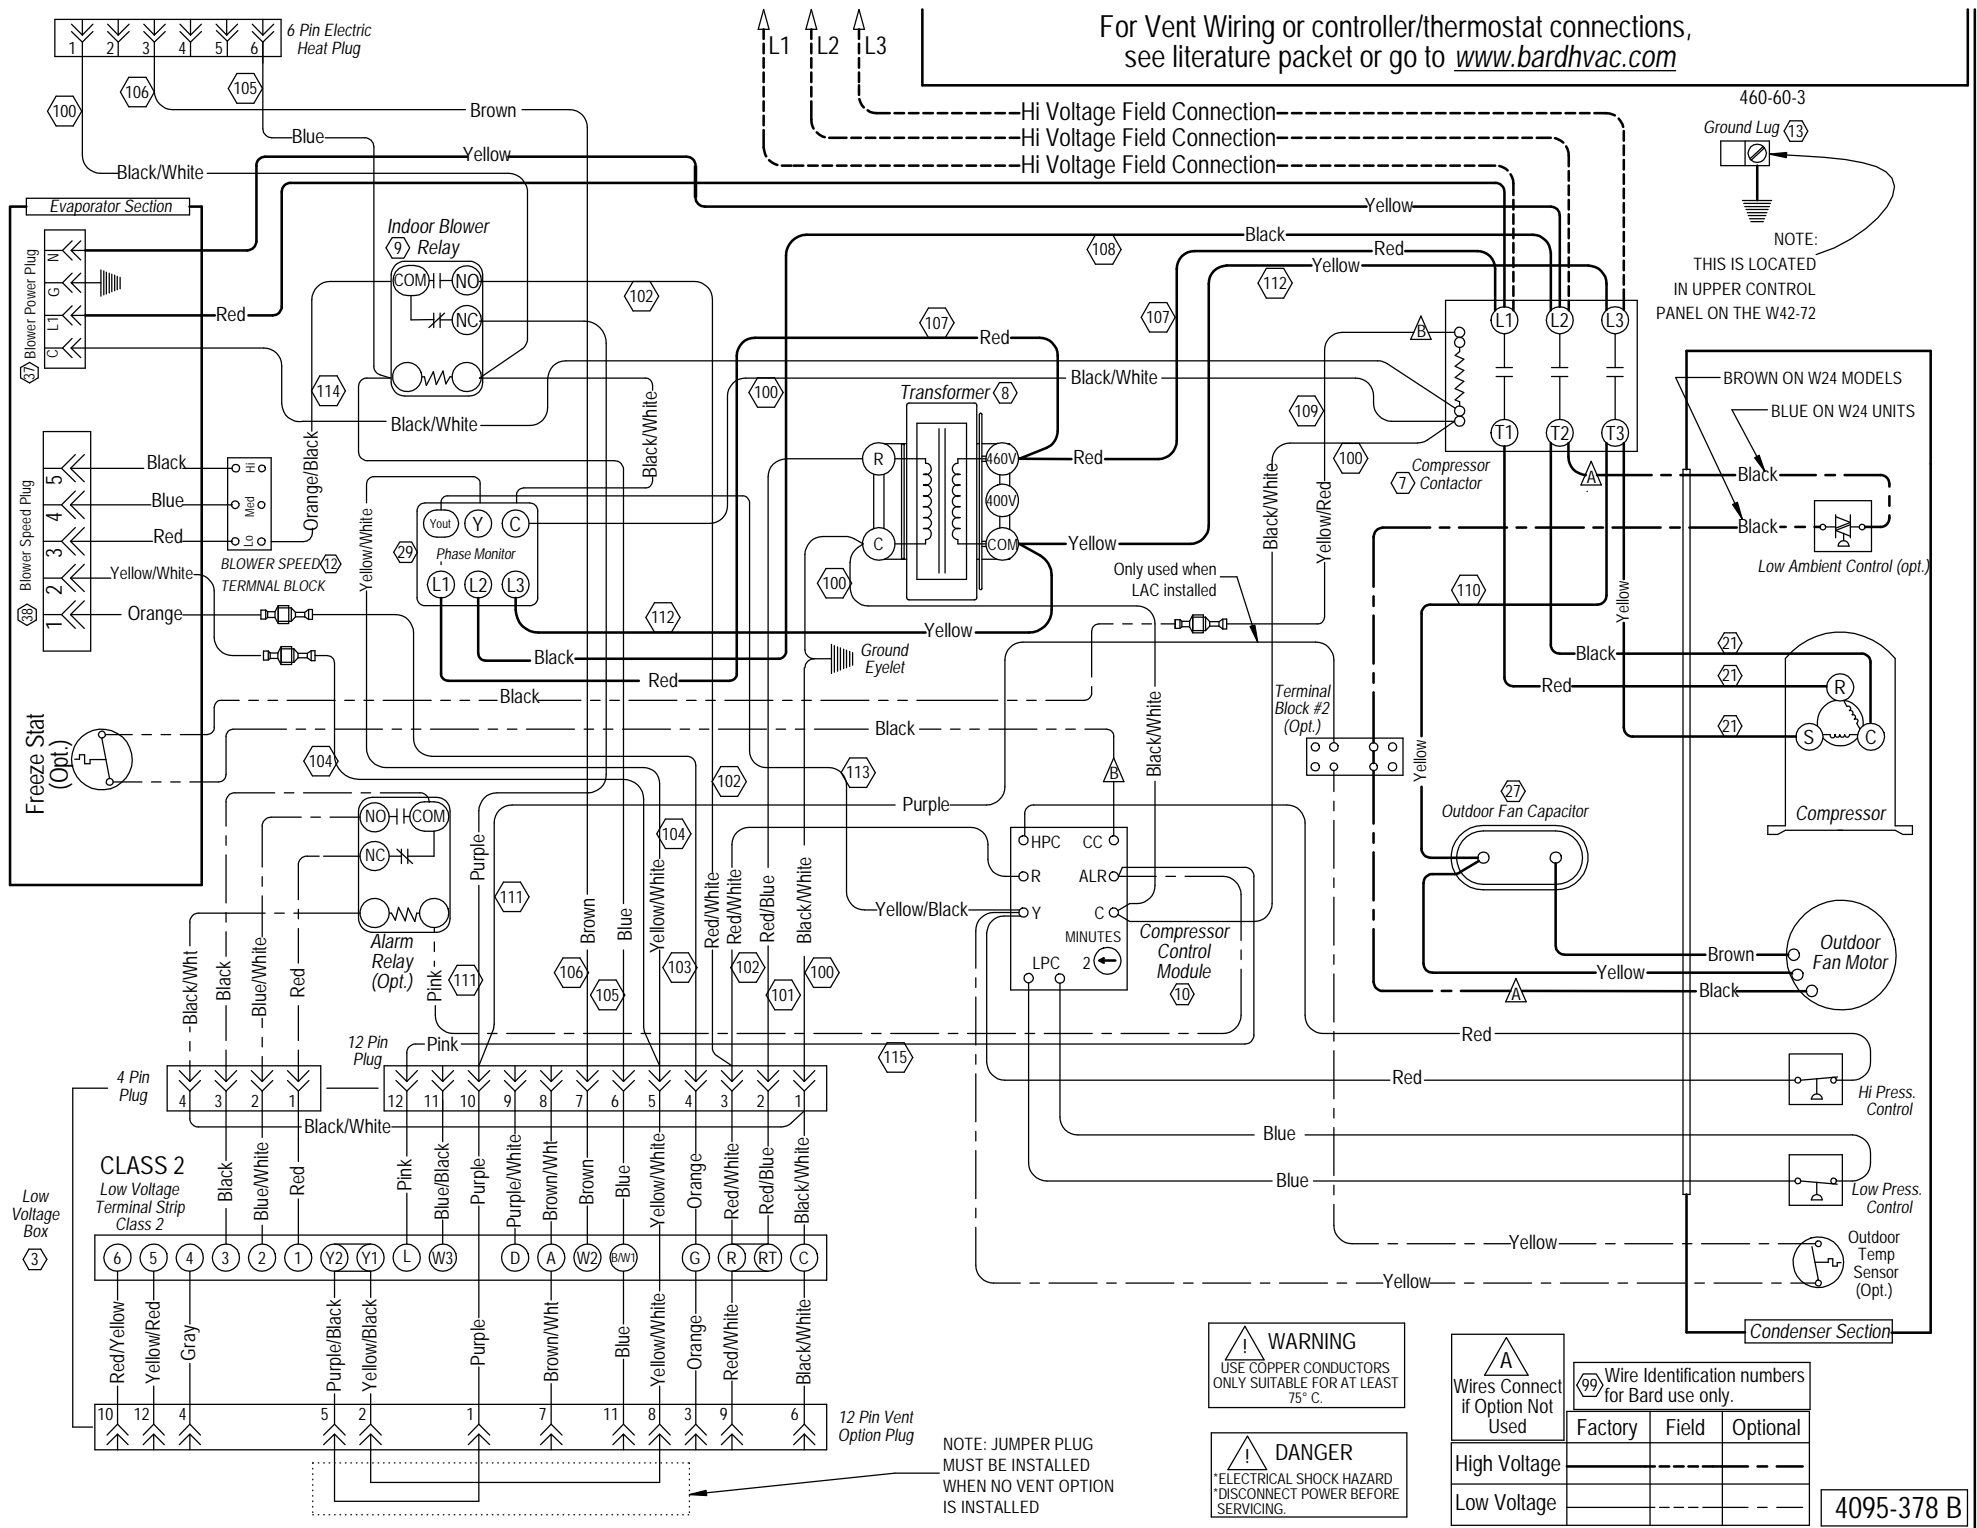





For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com



460-60-3
Ground Lug (13)
NOTE:
THIS IS LOCATED
IN UPPER CONTROL
PANEL ON THE W42-72

BROWN ON W24 MODELS
BLUE ON W24 UNITS
Black
Black
Low Ambient Control (opt.)



	Factory	Field	Optional
High Voltage			
Low Voltage			

4095-378 B