


230/208-60-1  
Per Nameplate



For Vent Wiring or controller/thermostat connections, see literature packet or go to [www.bardhvac.com](http://www.bardhvac.com)

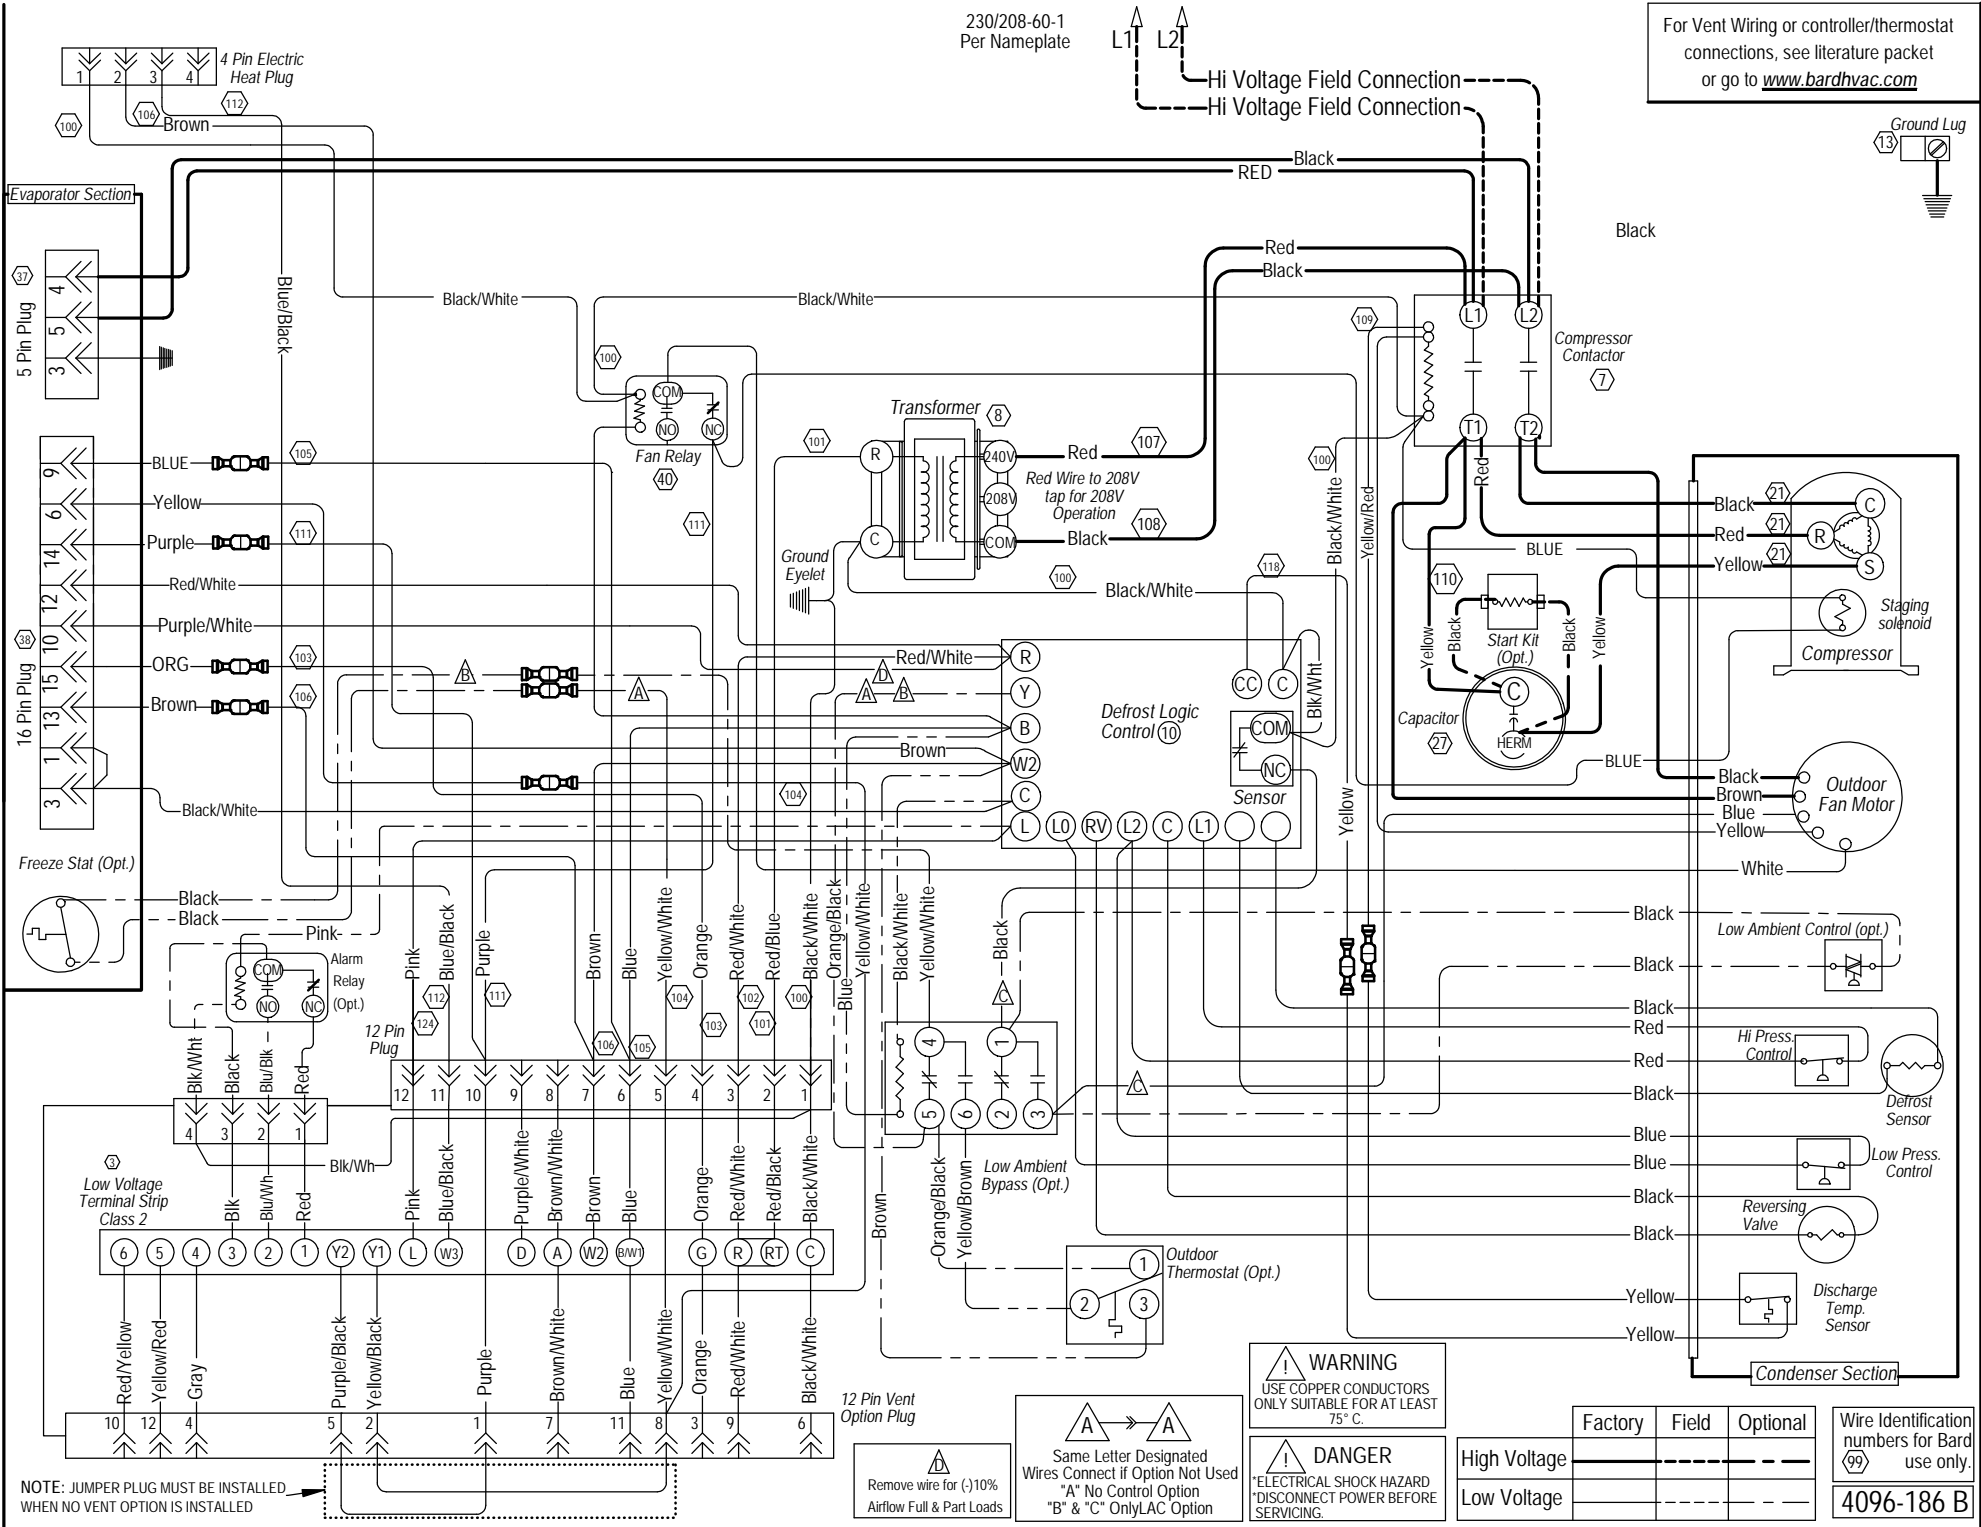

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

Remove wire for (-)10%  
Airflow Full & Part Loads

Same Letter Designated  
Wires Connect if Option Not Used  
"A" No Control Option  
"B" & "C" Only LAC Option

**WARNING**  
USE COPPER CONDUCTORS  
ONLY SUITABLE FOR AT LEAST  
75° C.

**DANGER**  
ELECTRICAL SHOCK HAZARD  
DISCONNECT POWER BEFORE  
SERVICING.

High Voltage	Factory	Field	Optional
Low Voltage			

Wire Identification  
numbers for Bard  
(99) use only.  
**4096-186 B**