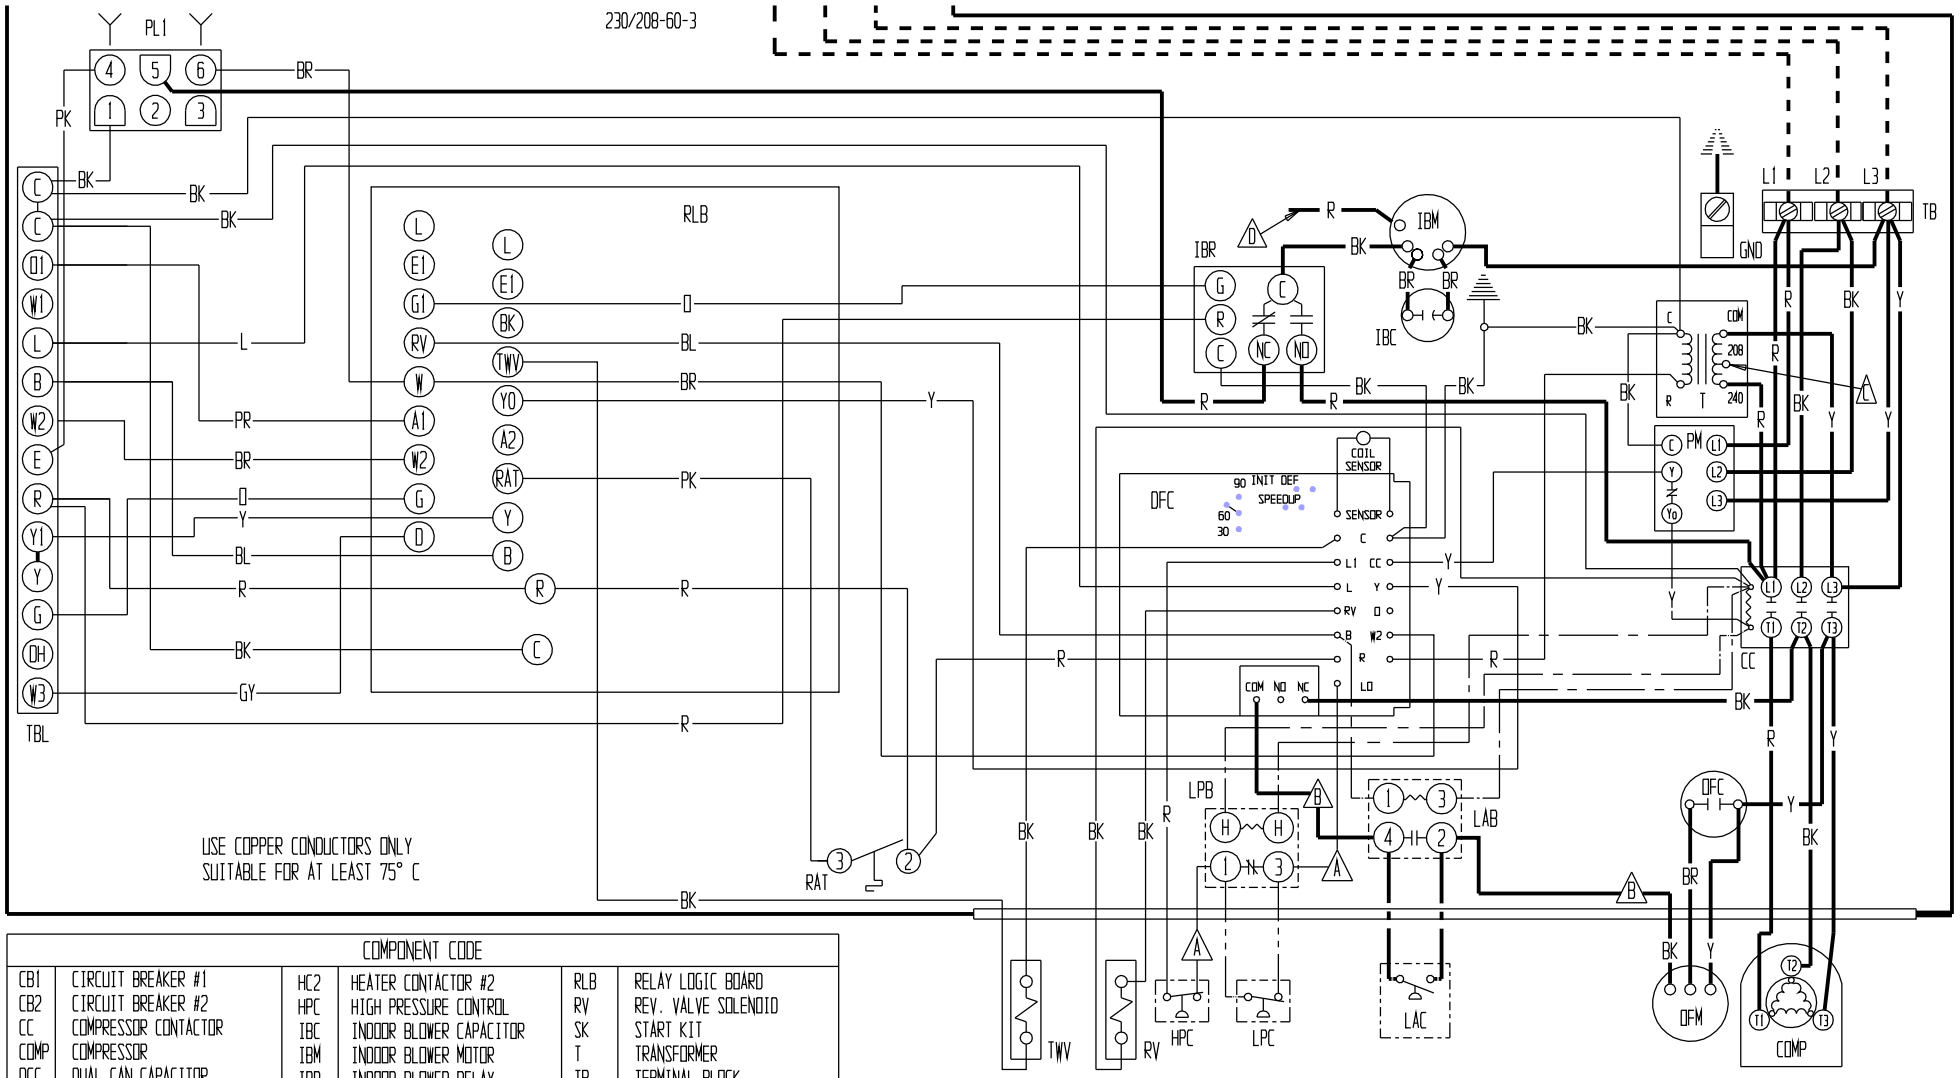


| COMPONENT CODE | | | | | |
|---|---|---|---|---|---|
| CB1 | CIRCUIT BREAKER #1 | HC2 | HEATER CONTACTOR #2 | RLB | RELAY LOGIC BOARD |
| CB2 | CIRCUIT BREAKER #2 | HPC | HIGH PRESSURE CONTROL | RV | REV. VALVE SOLENOID |
| CC | COMPRESSOR CONTACTOR | IBC | INDOOR BLOWER CAPACITOR | SK | START KIT |
| COMP | COMPRESSOR | IBM | INDOOR BLOWER MOTOR | T | TRANSFORMER |
| DCC | DUAL CAN CAPACITOR | IBR | INDOOR BLOWER RELAY | TB | TERMINAL BLOCK |
| DFC | DEFROST CONTROL | LAB | LOW AMBIENT BYPASS CONTROL | TBL | LOW VOLTAGE TERMINAL BLOCK |
| EMR | EMERGENCY HEAT RELAY | LAC | LOW AMBIENT CONTROL | TCO | THERMAL CUTOFF |
| ERV | ENERGY RECOVERY VENTILATOR | LPB | LOW PRESSURE BYPASS | TWV | THREE WAY VALVE |
| FT | FREEZE T-STAT | LPC | LOW PRESSURE CONTROL | | |
| GND | EQUIPMENT GROUND | LS | LIMIT SWITCH | | |
| H1 | HEAT STRIP #1 | OFM | OUTDOOR FAN MOTOR | | |
| H2 | HEAT STRIP #2 | PL1 | PLUG #1 | | |
| HC1 | HEATER CONTACTOR #1 | RAT | RETURN AIR THERMOSTAT | | |

A, B LABELED WIRES CONNECT IF NO OPTIONS USED. C MOVE RED WIRE TO 208V TAP FOR 208V OPERATION D RED (LOW) BLACK (HIGH) WHERE APPLICABLE

| | FACTORY STD. | FIELD | OPTIONAL |
|---|---|---|---|
| HIGH VOLTAGE | ——— | — — — | —·—·— |
| LOW VOLTAGE | ——— | — — — | —·—·— |
| ACCESSORY | | | —··—··— |

| COLOR CODE | | | | | | | |
|---|---|---|---|---|---|---|---|
| BK | BLACK | Y | YELLOW | V | VIOLET | T | TAN |
| BR | BROWN | G | GREEN | (PR) | PURPLE | PK | PINK |
| R | RED | BL | BLUE | GY | GRAY | L | LAVENDER |
| O | ORANGE | W | WHITE | (S) | SLATE | | |

BARD MFG. CO.

4096-239 C