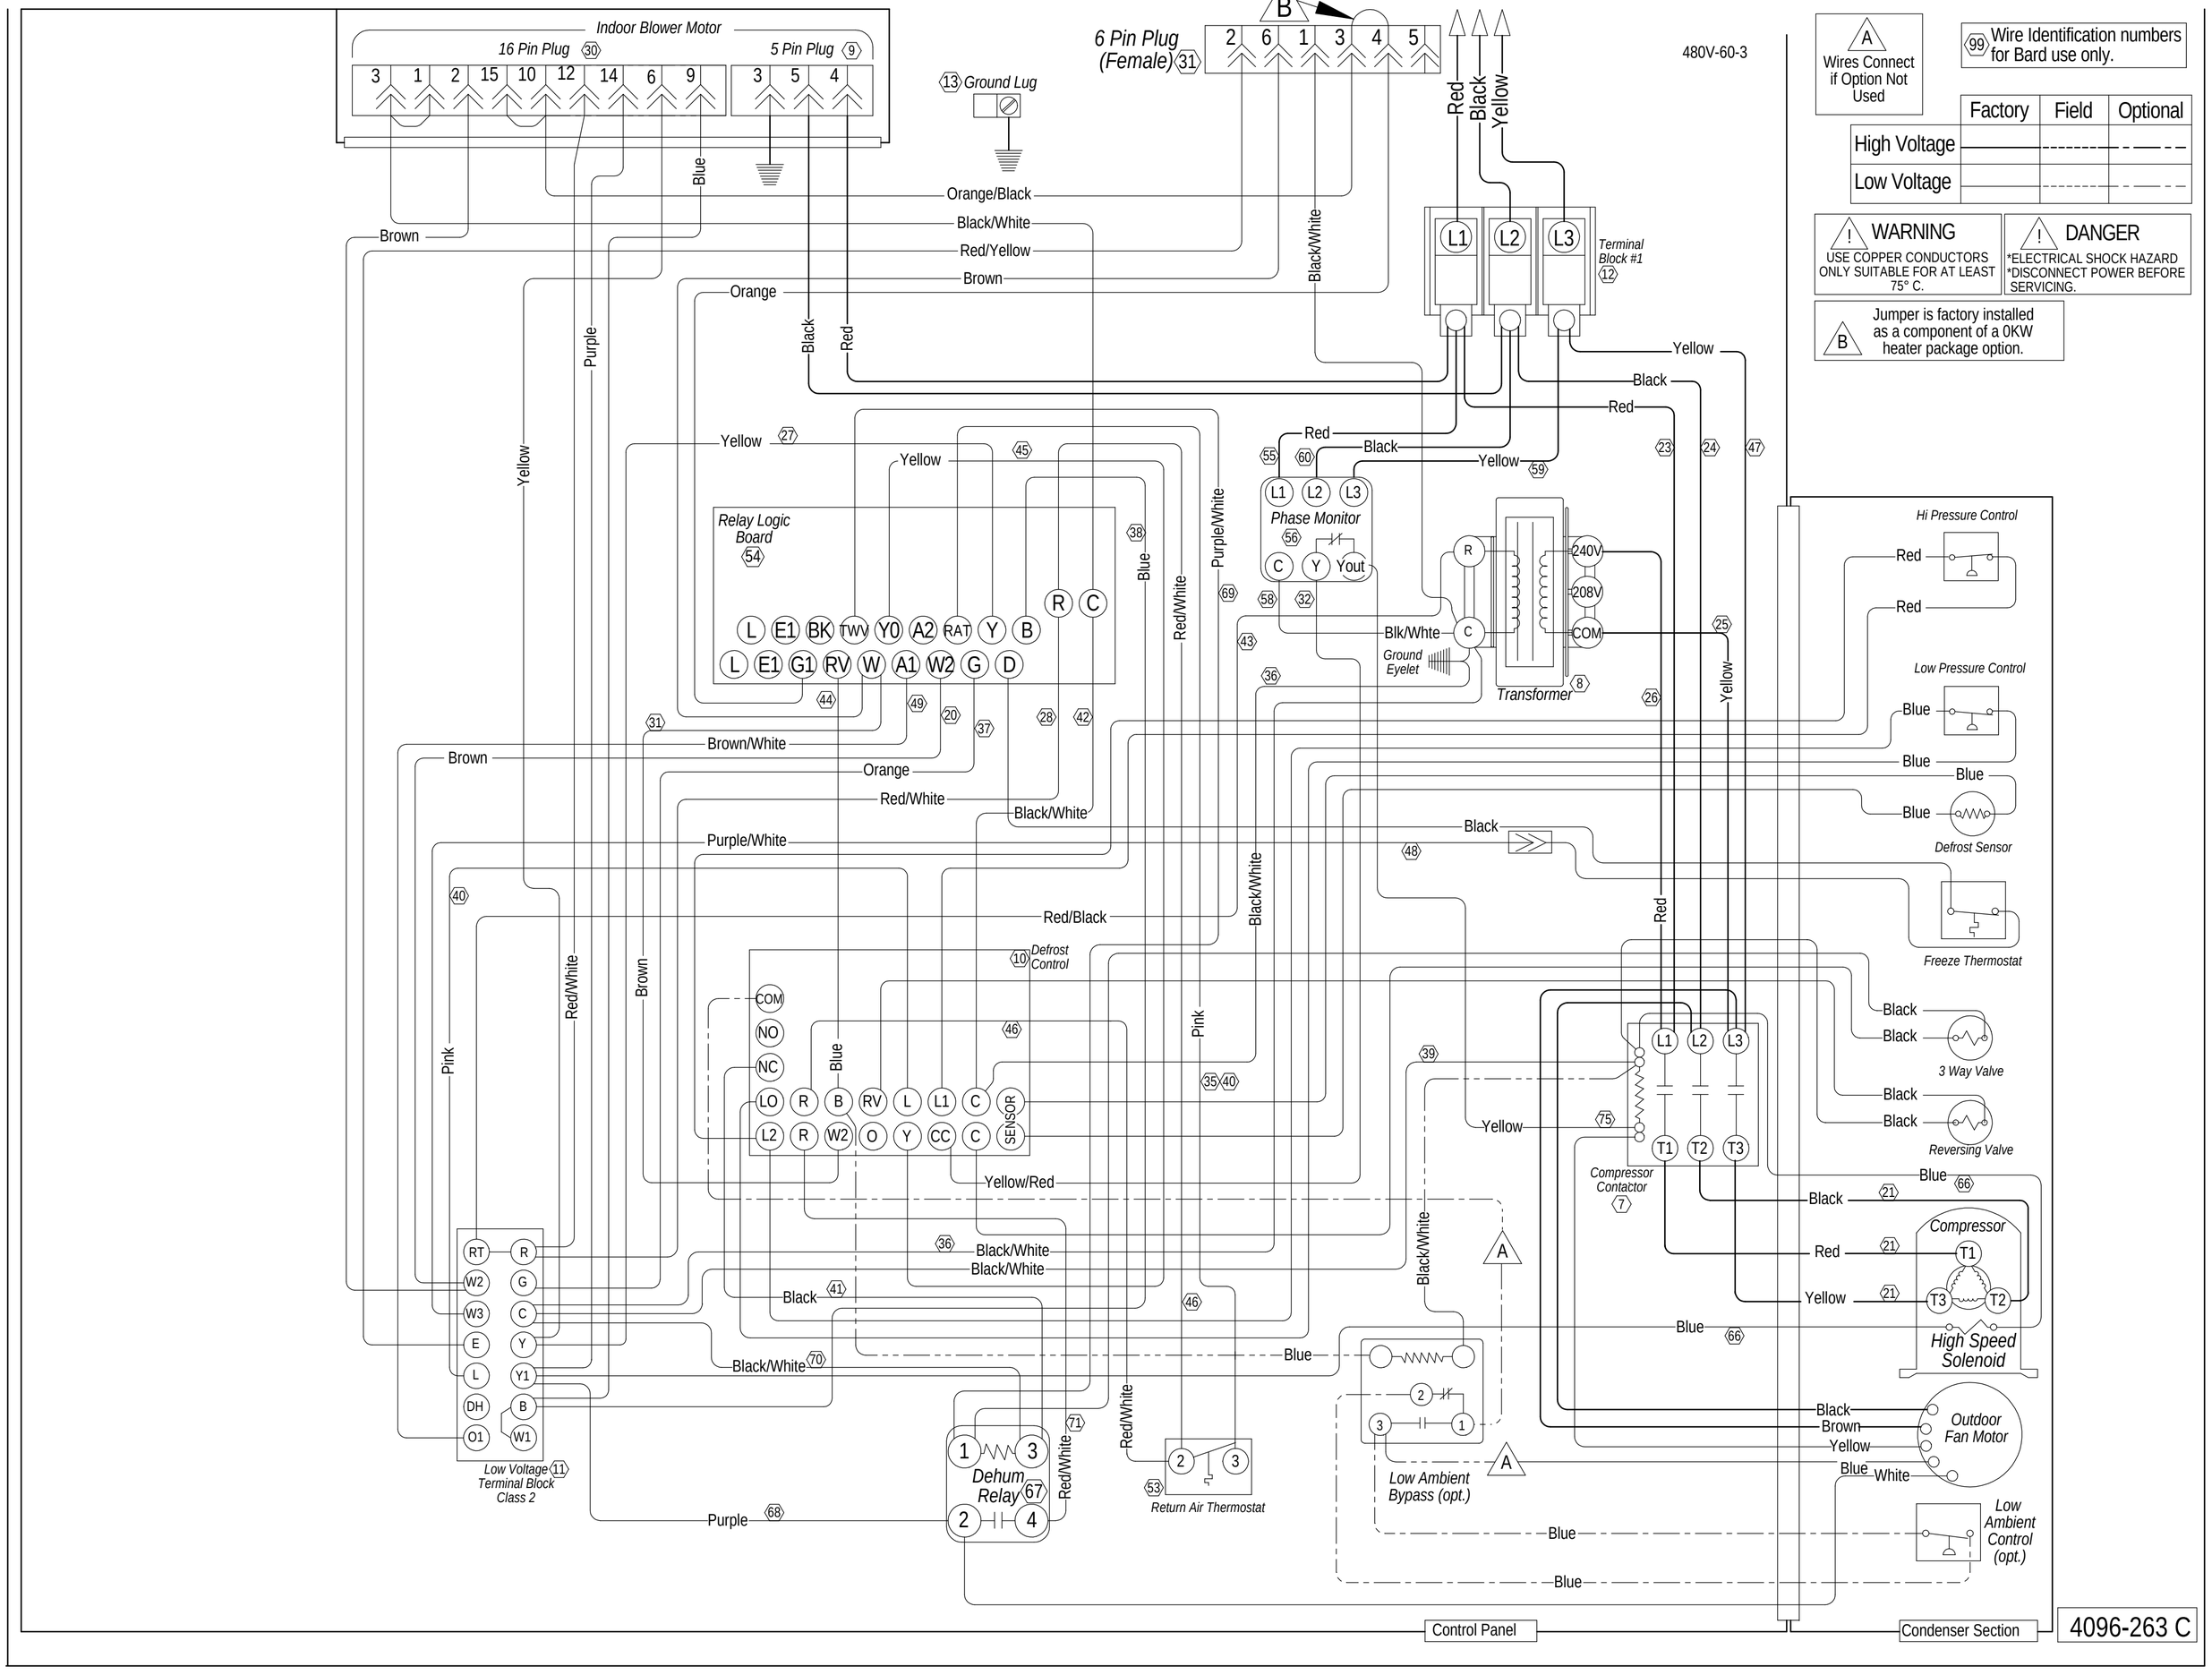
Indoor Blower Motor
16 Pin Plug 30
5 Pin Plug 9
6 Pin Plug (Female) 31
13 Ground Lug
480V-60-3
Wires Connect if Option Not Used
99 Wire Identification numbers for Bard use only.
Factory
Field
Optional
High Voltage
Low Voltage
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
Jumper is factory installed as a component of a 0KW heater package option.
Terminal Block #1 12
Relay Logic Board 54
Phase Monitor 56
Transformer 8
Ground Eyelet
Hi Pressure Control
Low Pressure Control
Defrost Sensor
Freeze Thermostat
3 Way Valve
Reversing Valve
Compressor Contactor 7
Compressor
High Speed Solenoid
Outdoor Fan Motor
Defrost Control 10
Low Voltage Terminal Block Class 2 11
Dehum Relay 67
Return Air Thermostat 53
Low Ambient Bypass (opt.)
Low Ambient Control (opt.)
Control Panel
Condenser Section
4096-263 C