


For Vent Wiring or controller/thermostat connections, see literature packet or go to [www.bardhvac.com](http://www.bardhvac.com)

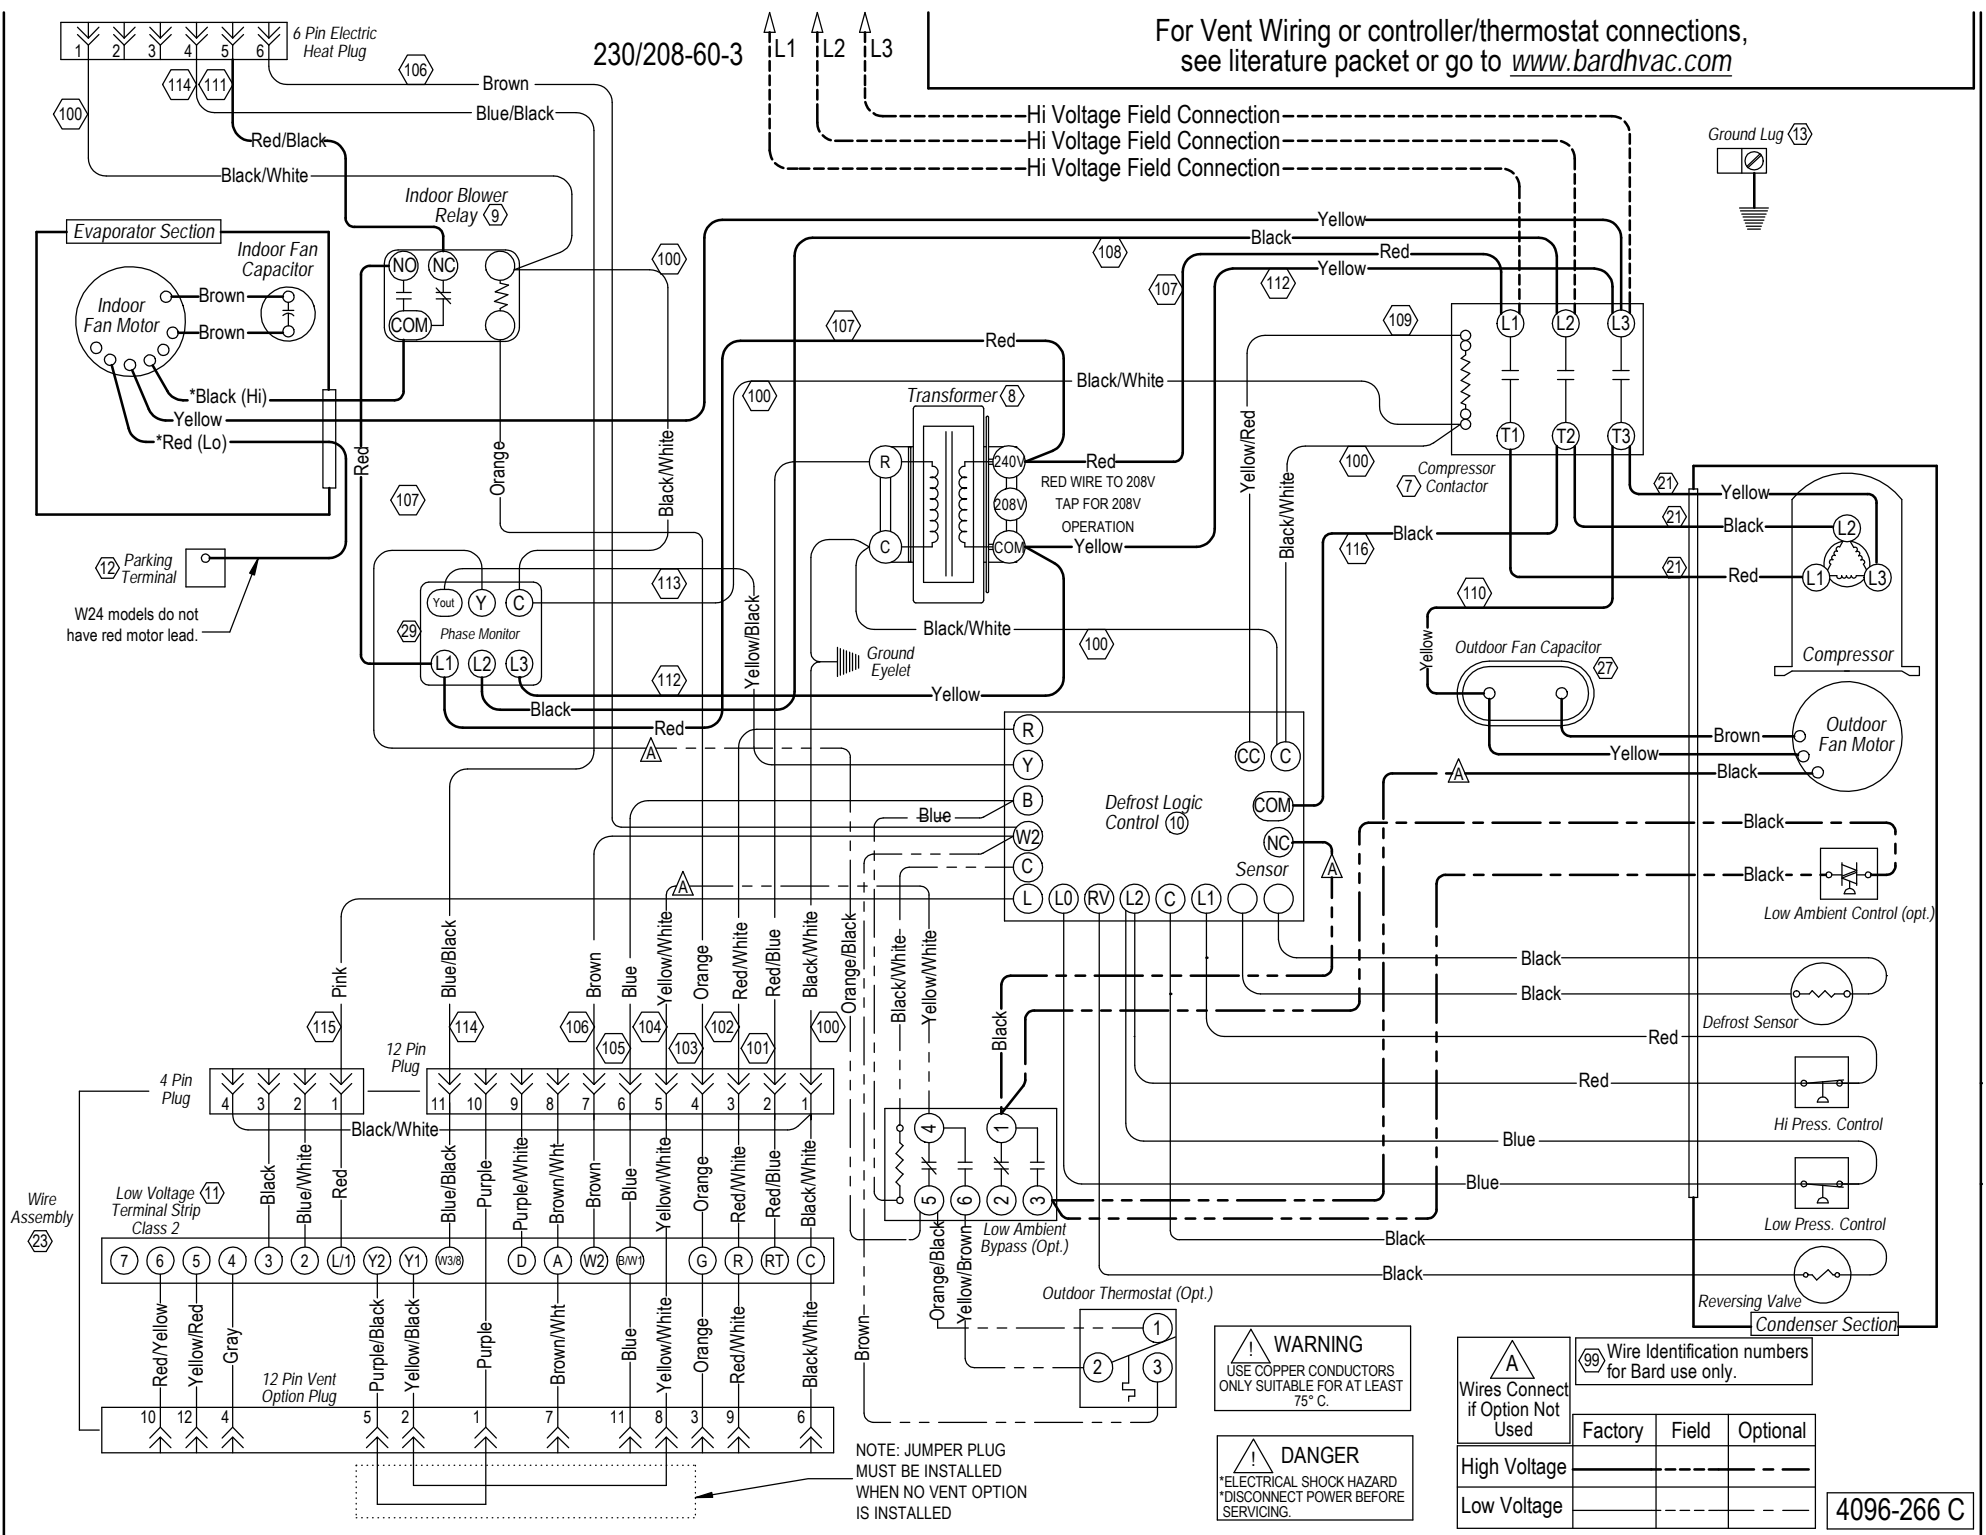

99 Wire Identification numbers for Bard use only.

	Factory	Field	Optional
Wires Connect if Option Not Used			
High Voltage			
Low Voltage			

4096-266 C