


230/208-60-3

For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

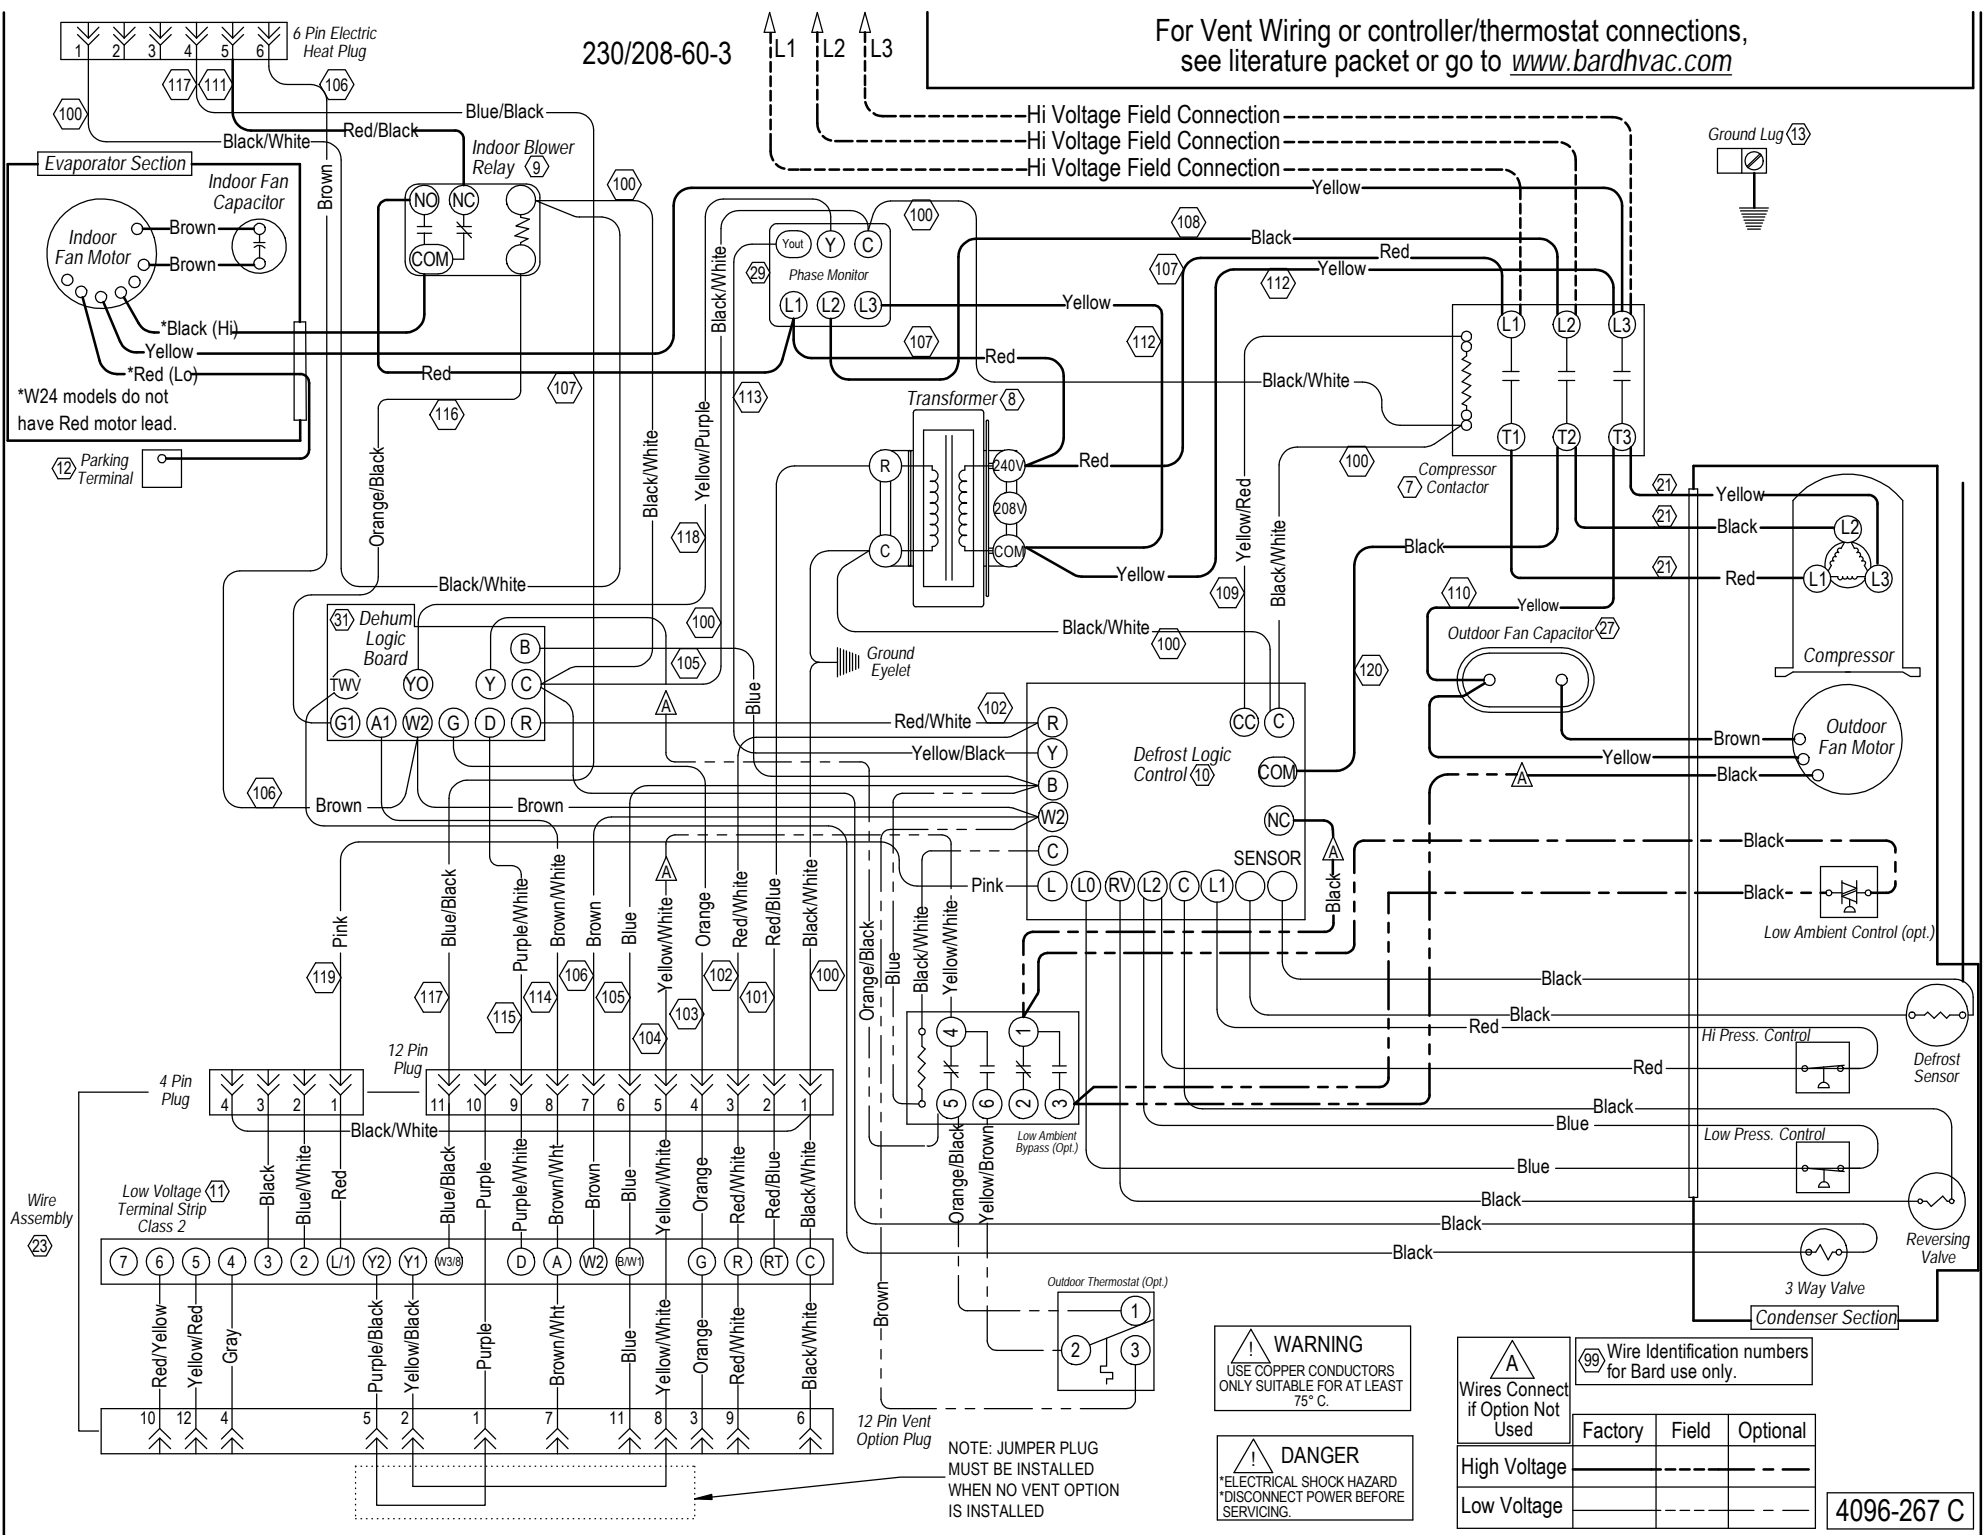

Wire Assembly (23)

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.

DANGER
ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING.

<p>A Wires Connect if Option Not Used</p>	<p>(99) Wire Identification numbers for Bard use only.</p>		
	Factory	Field	Optional
High Voltage			
Low Voltage			

4096-267 C