


For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

230/208-60-3 Per Nameplate

L1 L2 L3
 - - - - Hi Voltage Field Connection
 - - - - Hi Voltage Field Connection
 - - - - Hi Voltage Field Connection

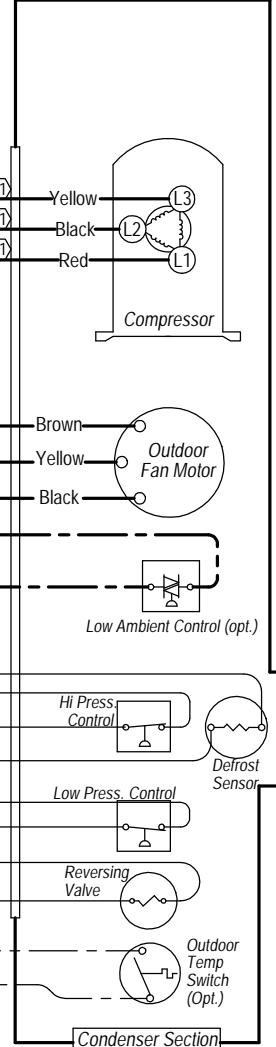

WARNING
 USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75°C.

DANGER
 ELECTRICAL SHOCK HAZARD
 DISCONNECT POWER BEFORE SERVICING.

High Voltage	Factory	Field	Optional
Low Voltage			

Wire Identification numbers for Bard (99) use only.
4096-270 D

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

