


230/208-60-3  
Per Nameplate

L1 L2 L3  
Hi Voltage Field Connection  
Hi Voltage Field Connection  
Hi Voltage Field Connection

For Vent Wiring or controller/thermostat connections, see literature packet or go to [www.bardhvac.com](http://www.bardhvac.com)

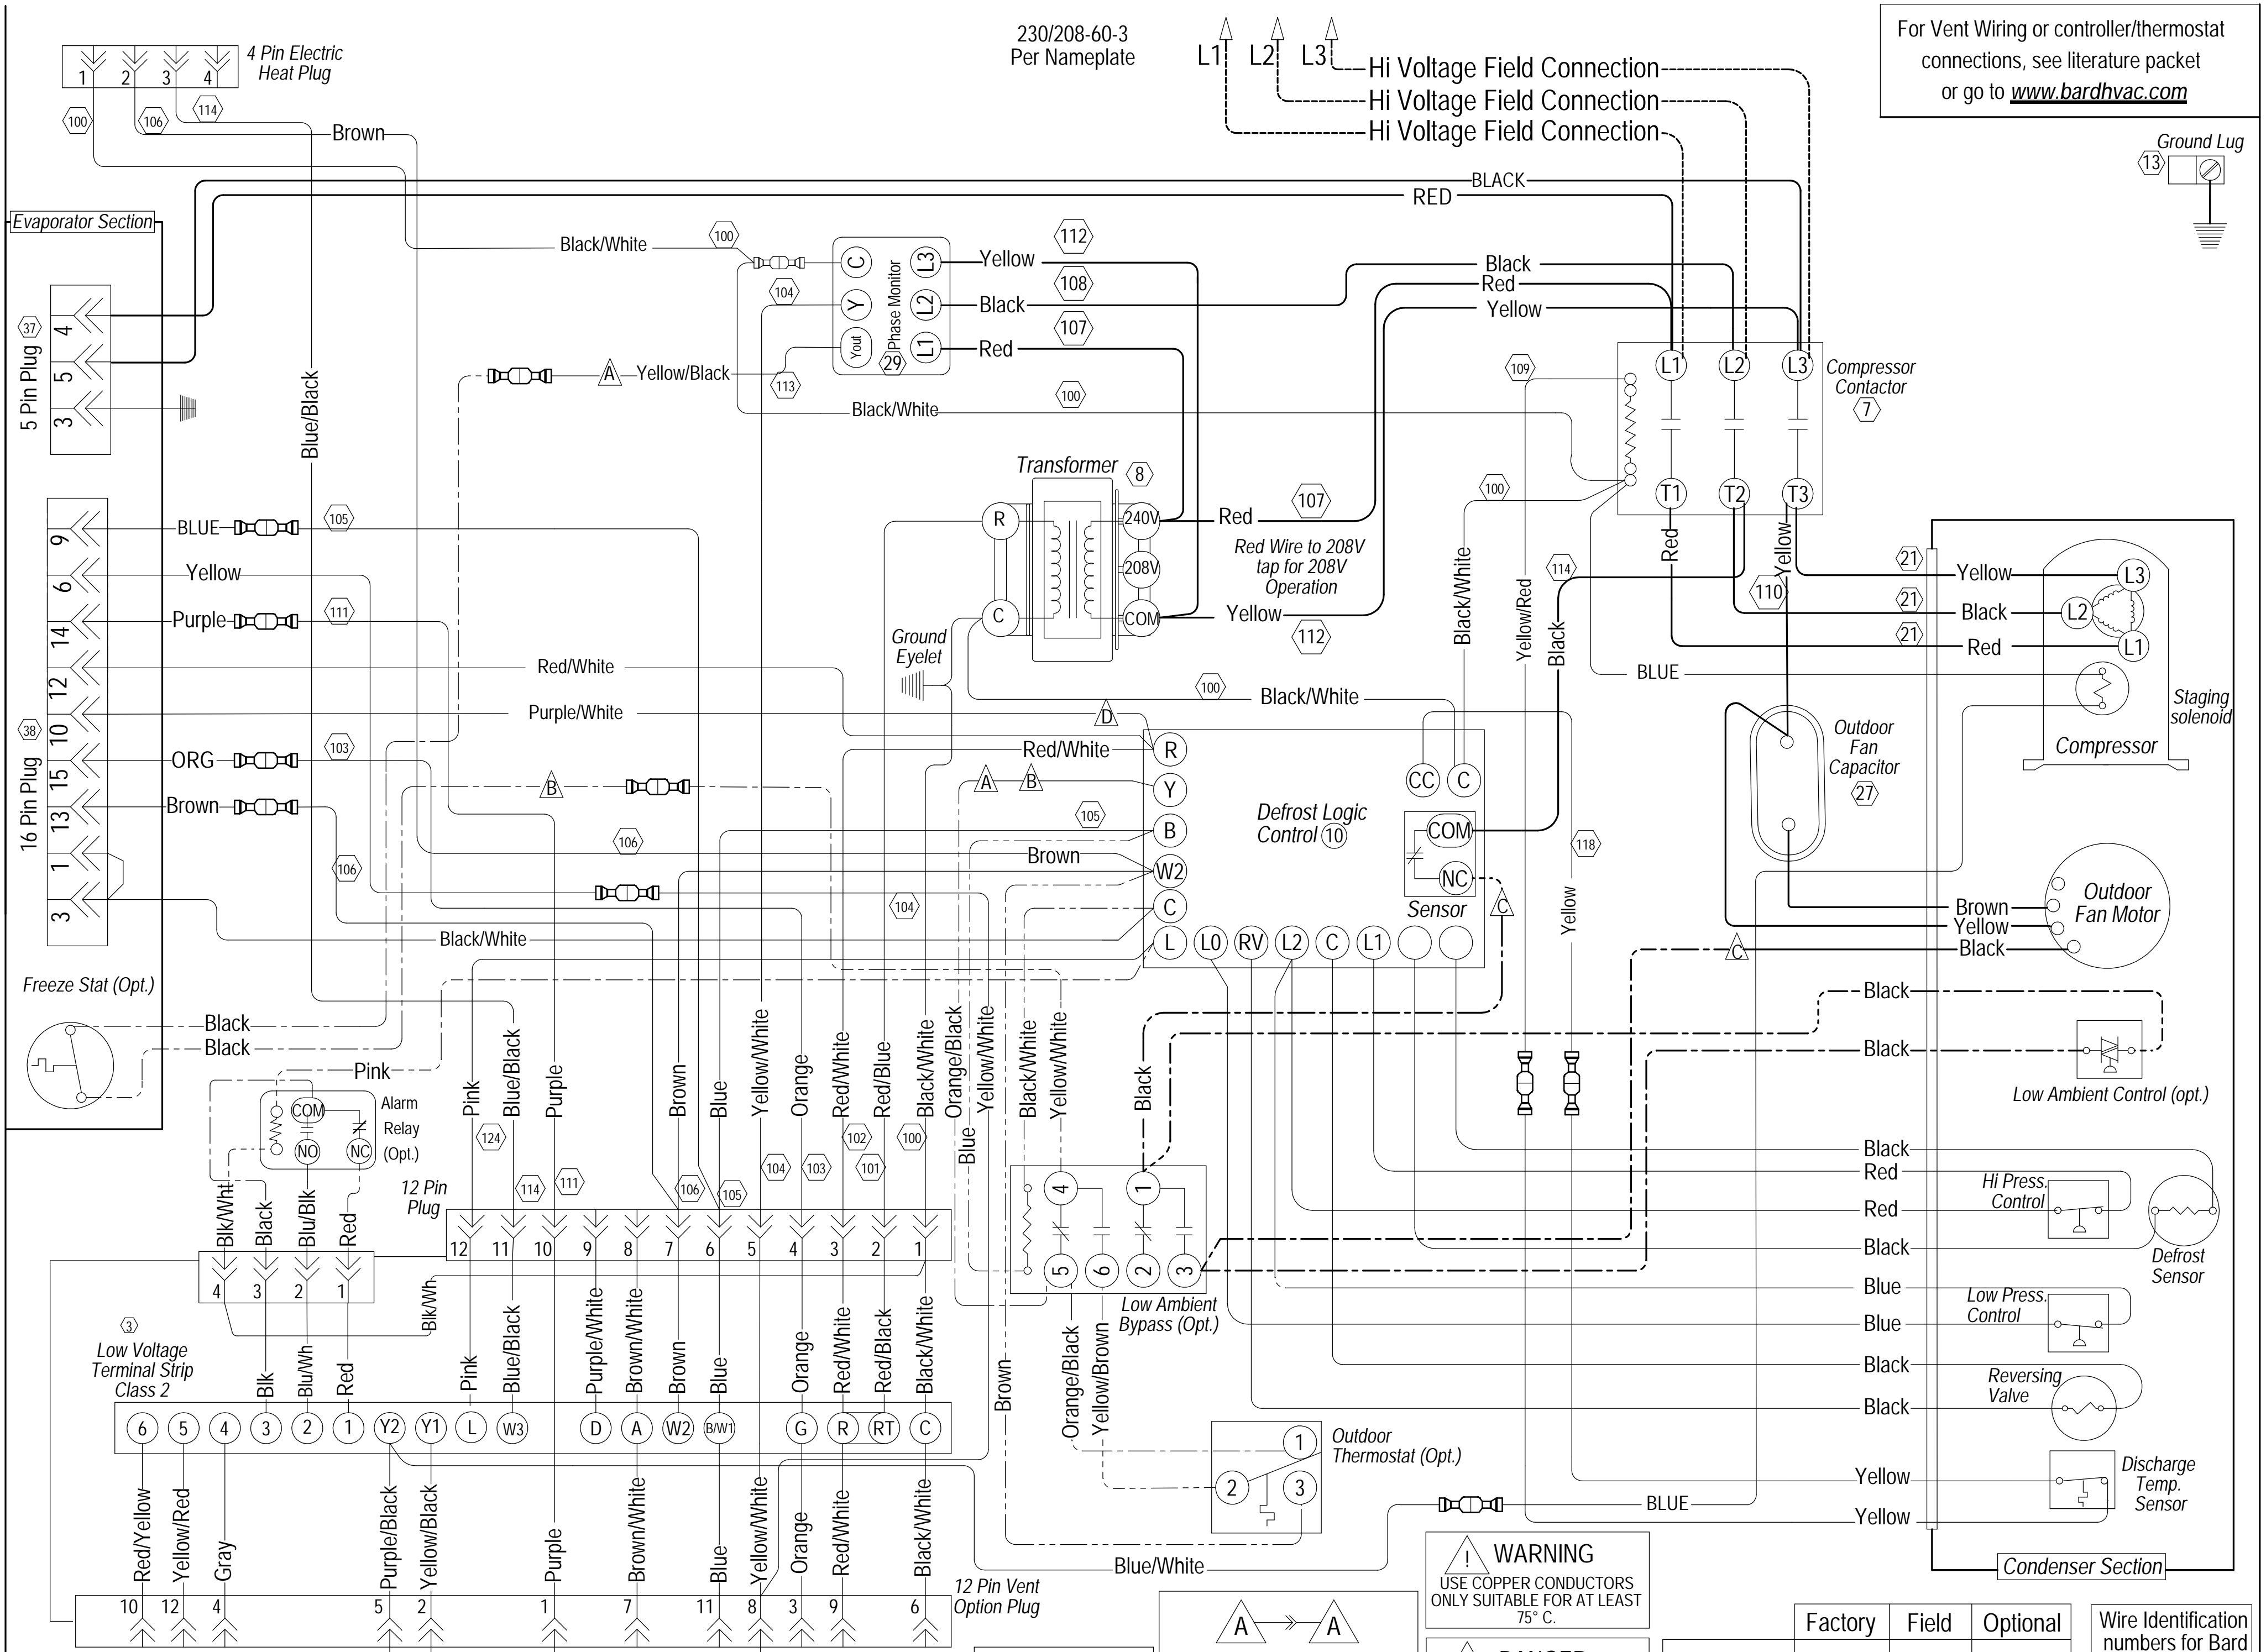

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

**D**  
Remove wire for (-)10%  
Airflow Full & Part Loads

**A** → **A**  
Same Letter Designated  
Wires Connect if Option Not Used  
"A" No Control Option  
"B" & "C" Only LAC Option

**WARNING**  
USE COPPER CONDUCTORS  
ONLY SUITABLE FOR AT LEAST  
75° C.

**DANGER**  
"ELECTRICAL SHOCK HAZARD"  
"DISCONNECT POWER BEFORE  
SERVICING."

	Factory	Field	Optional
High Voltage			
Low Voltage			

Wire Identification  
numbers for Bard  
use only.  
**4096-285 A**