


230/208-60-3  
Per Nameplate

L1 L2 L3  
-Hi Voltage Field Connection  
-Hi Voltage Field Connection  
-Hi Voltage Field Connection

For Vent Wiring or controller/thermostat connections, see literature packet or go to [www.bardhvac.com](http://www.bardhvac.com)

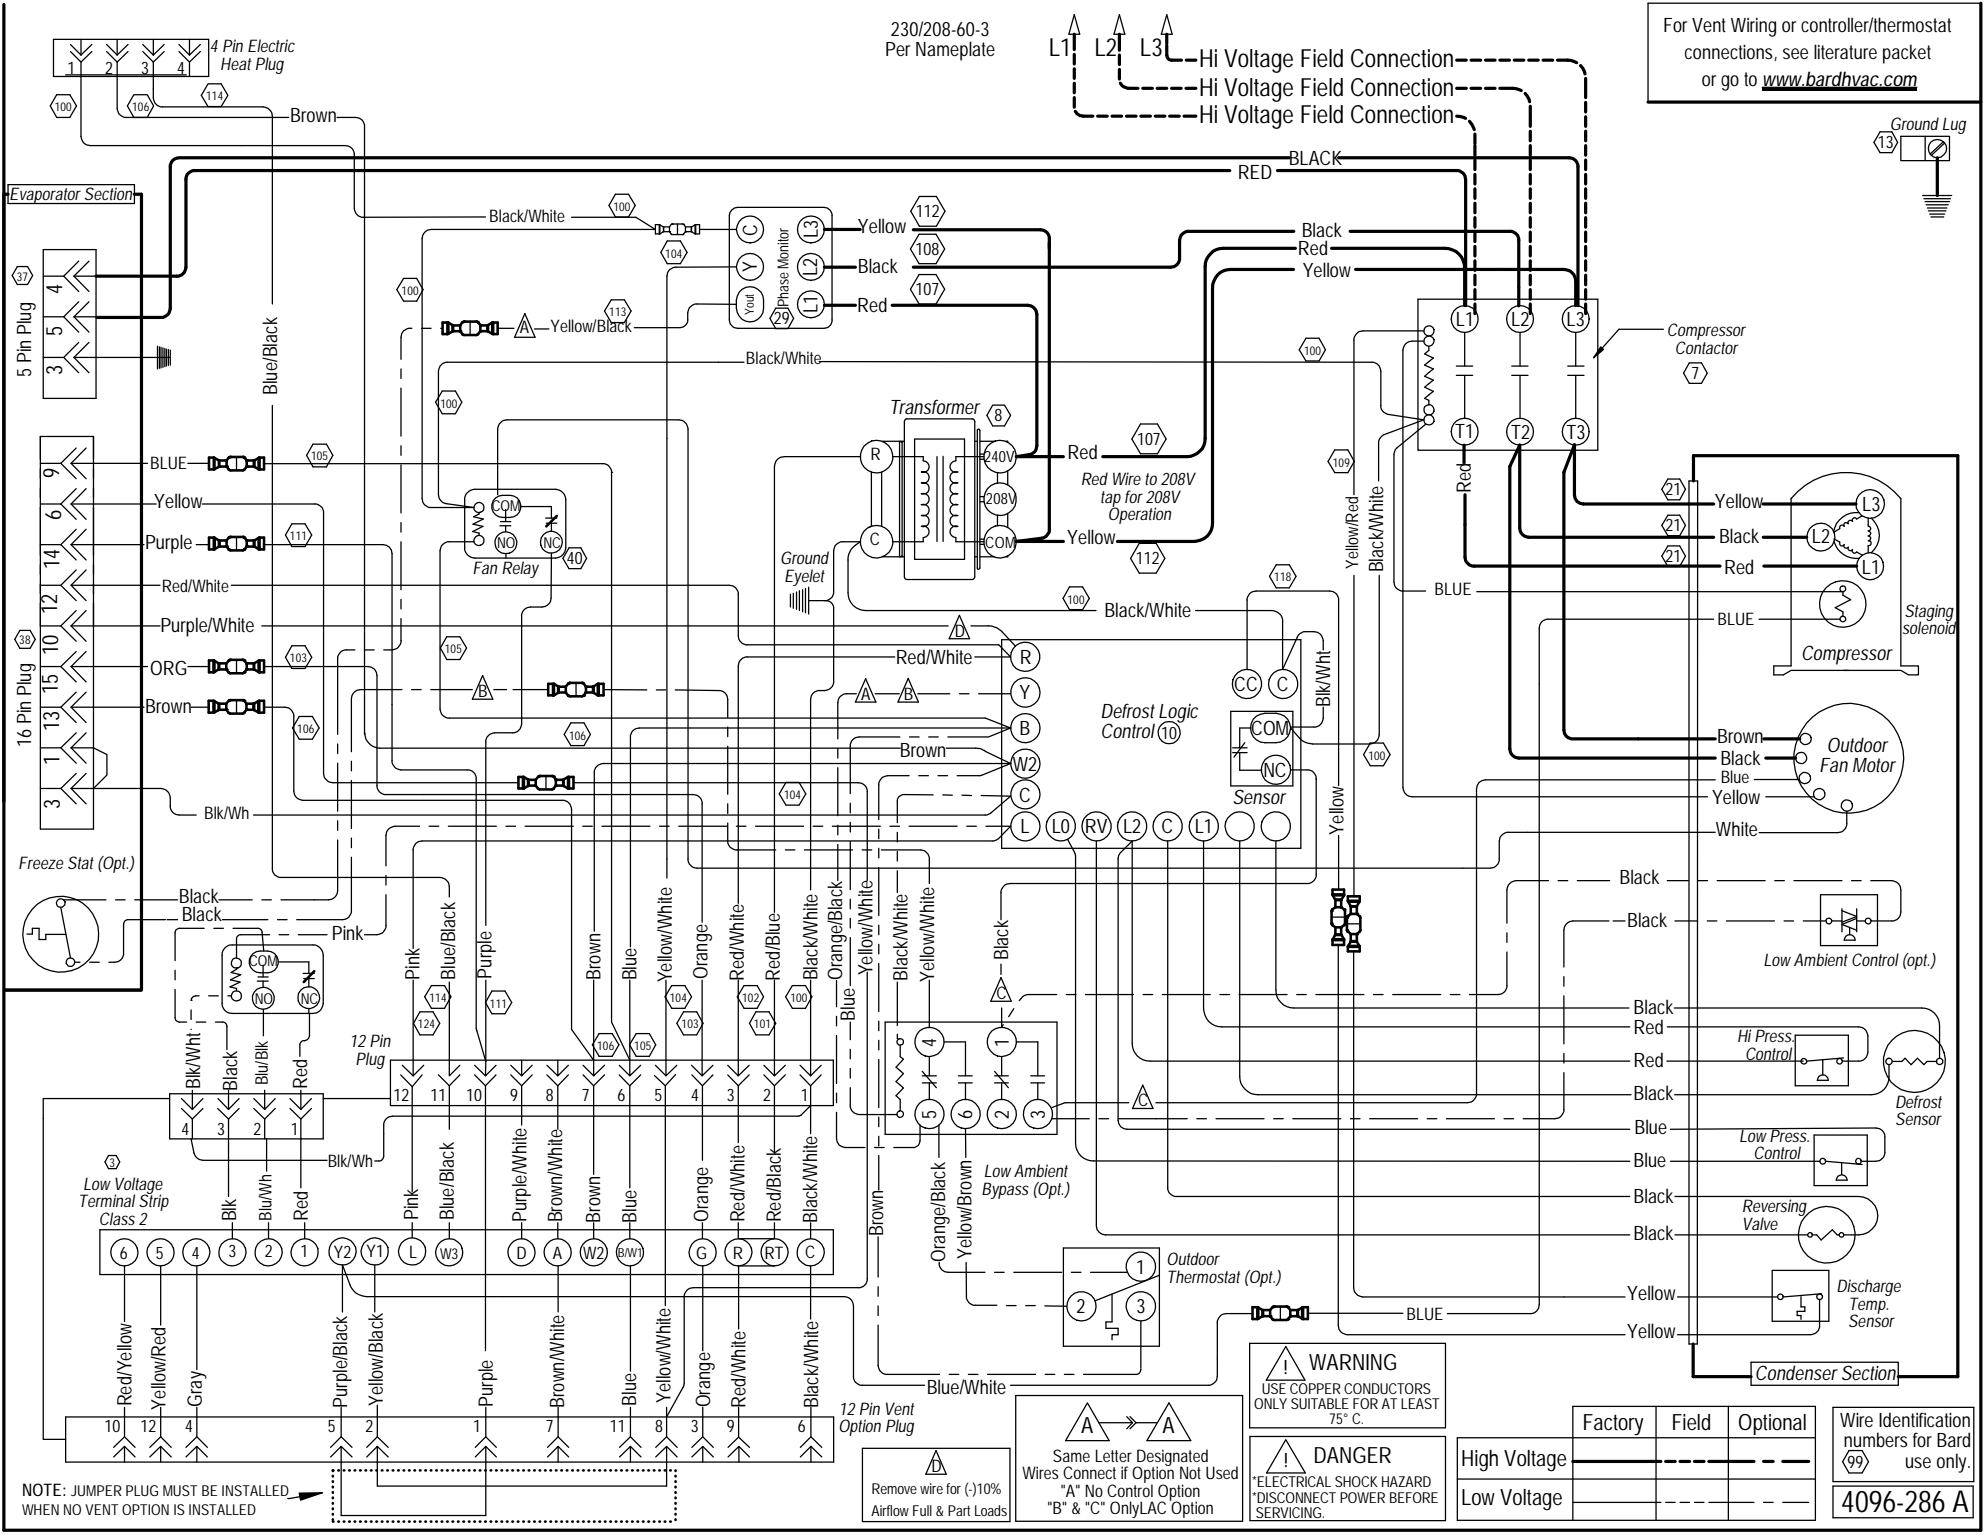

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

Remove wire for (-10% Airflow Full & Part Loads)

Same Letter Designated Wires Connect if Option Not Used  
"A" No Control Option  
"B" & "C" Only LAC Option

**WARNING**  
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.

**DANGER**  
ELECTRICAL SHOCK HAZARD  
DISCONNECT POWER BEFORE SERVICING.

High Voltage  
Low Voltage

	Factory	Field	Optional
High Voltage			
Low Voltage			

Wire Identification numbers for Bard use only.  
**4096-286 A**