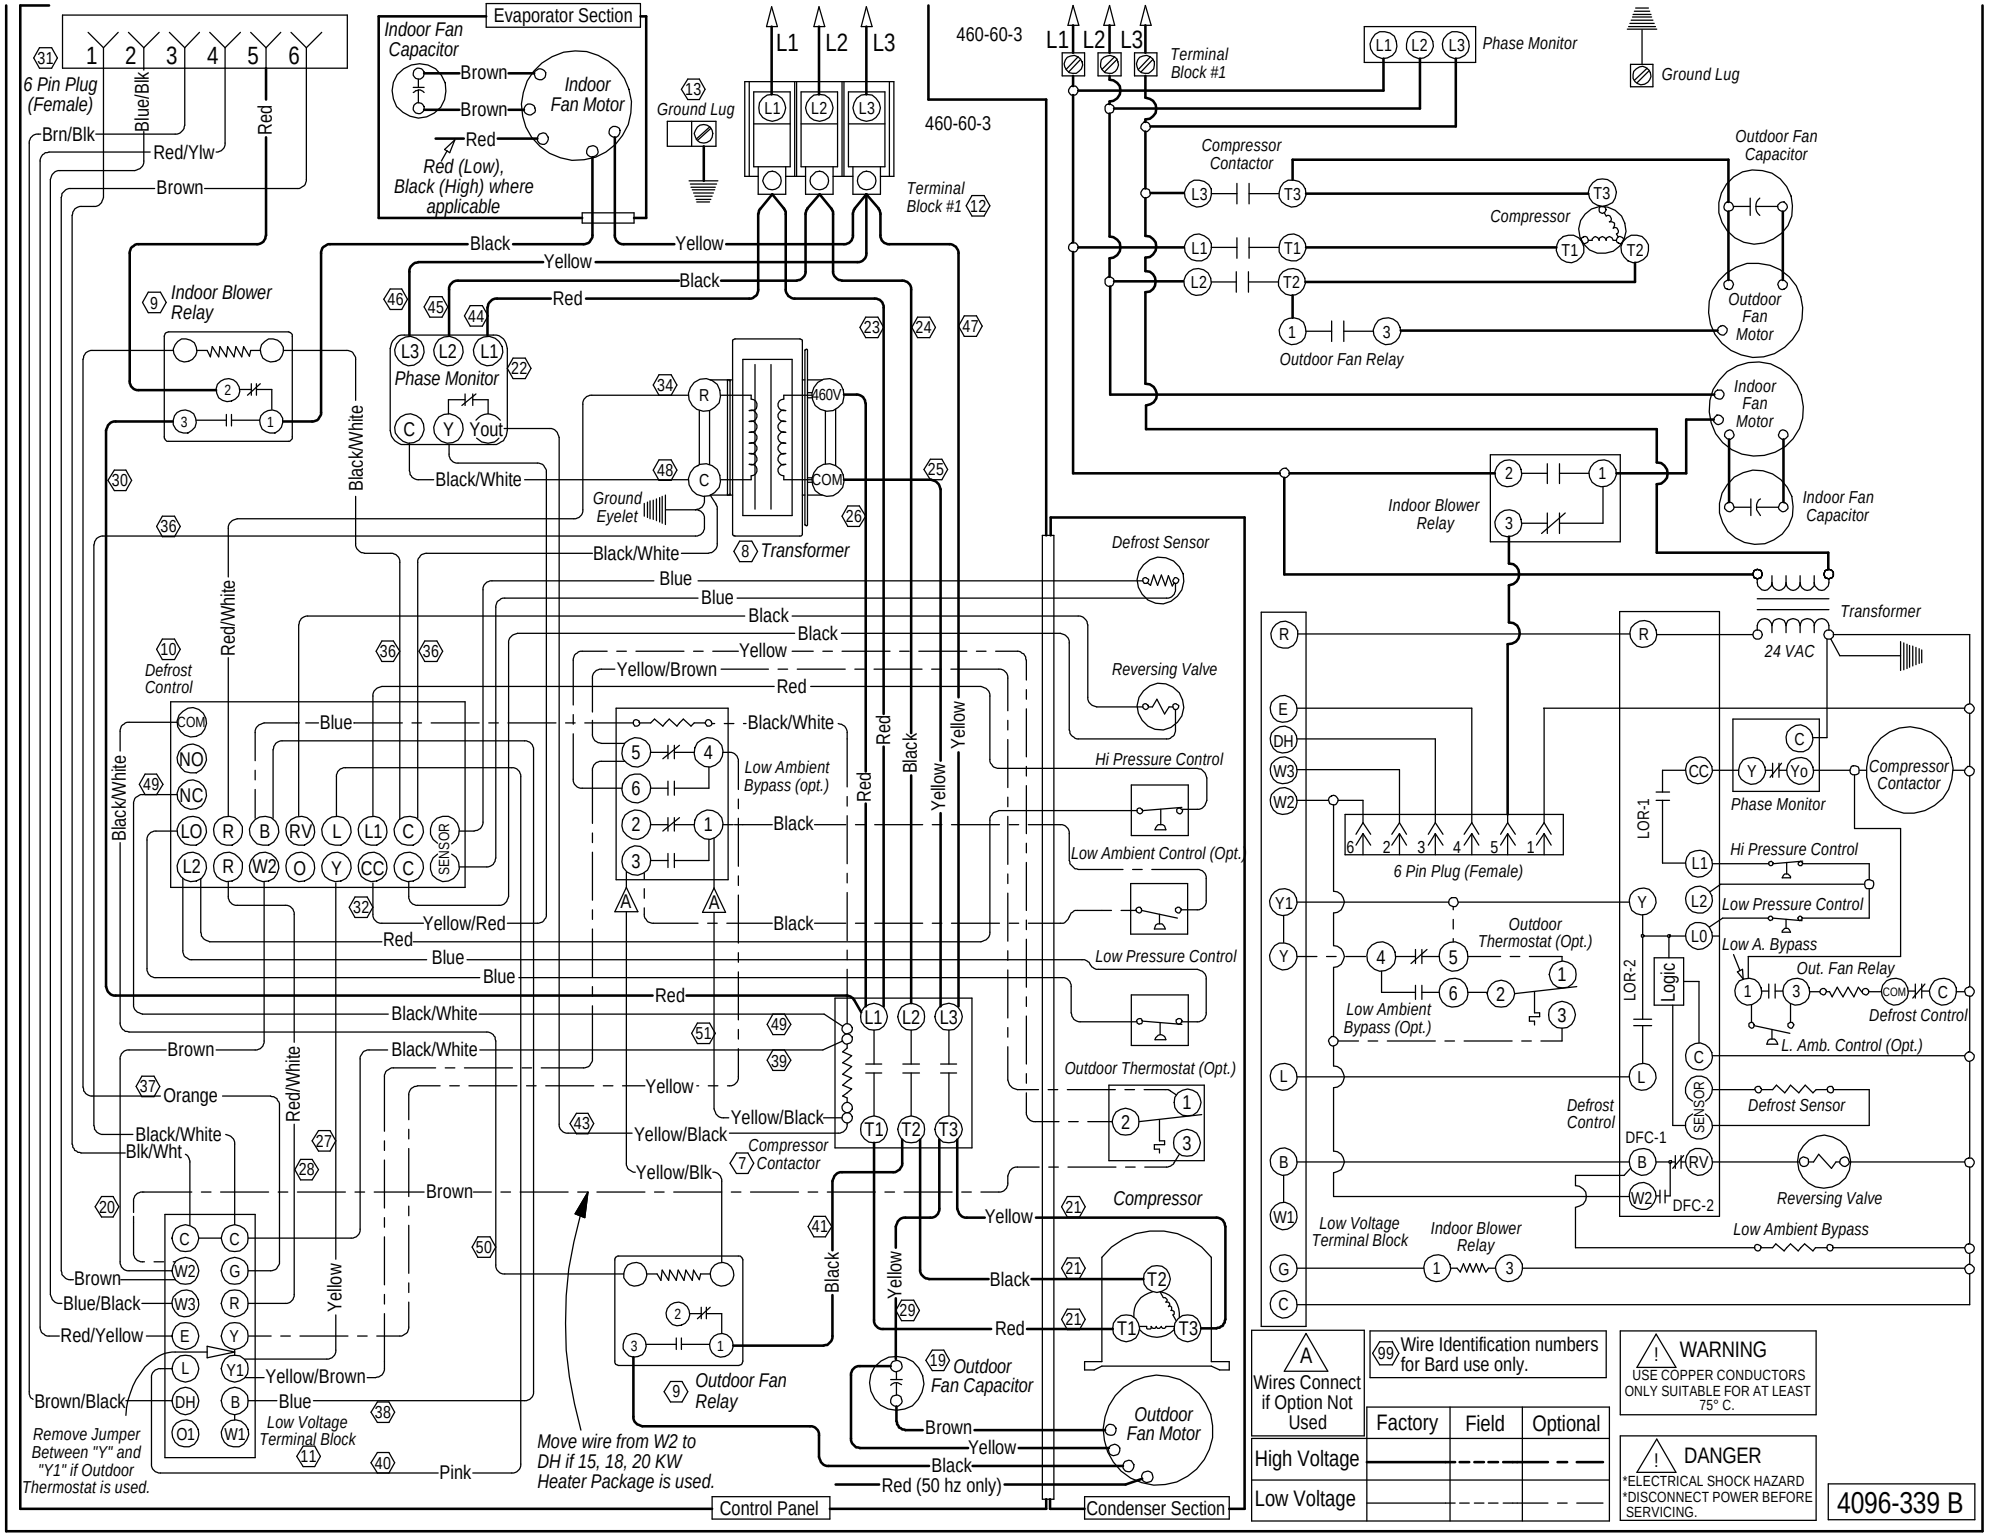
Evaporator Section
Indoor Fan Capacitor
Indoor Fan Motor
Red (Low), Black (High) where applicable
6 Pin Plug (Female)
Ground Lug
460-60-3
Terminal Block #1
Phase Monitor
Compressor Contactor
Compressor
Outdoor Fan Capacitor
Outdoor Fan Motor
Outdoor Fan Relay
Indoor Blower Relay
Indoor Fan Capacitor
Transformer
24 VAC
Defrost Sensor
Reversing Valve
Hi Pressure Control
Low Ambient Control (Opt.)
Low Pressure Control
Outdoor Thermostat (Opt.)
Low Ambient Bypass (Opt.)
Defrost Control
Low Voltage Terminal Block
Out. Fan Relay
L. Amb. Control (Opt.)
Low A. Bypass
Remove Jumper Between "Y" and "Y1" if Outdoor Thermostat is used.
Move wire from W2 to DH if 15, 18, 20 KW Heater Package is used.
Control Panel
Condenser Section
Wires Connect if Option Not Used
Wire Identification numbers for Bard use only.
Factory
Field
Optional
High Voltage
Low Voltage
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
4096-339 B