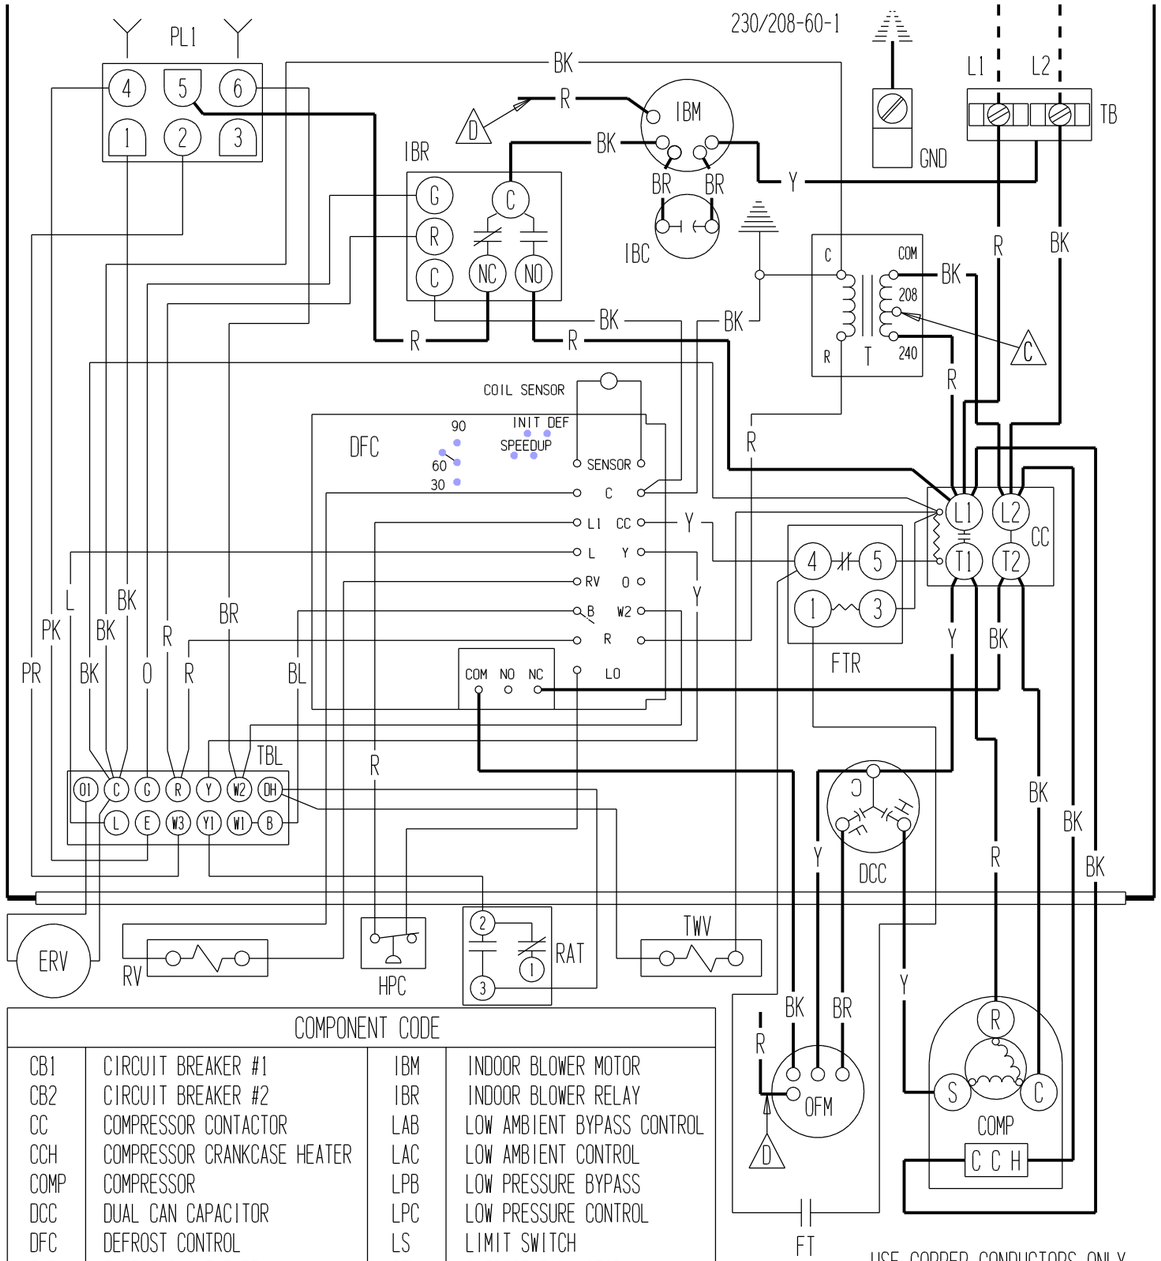

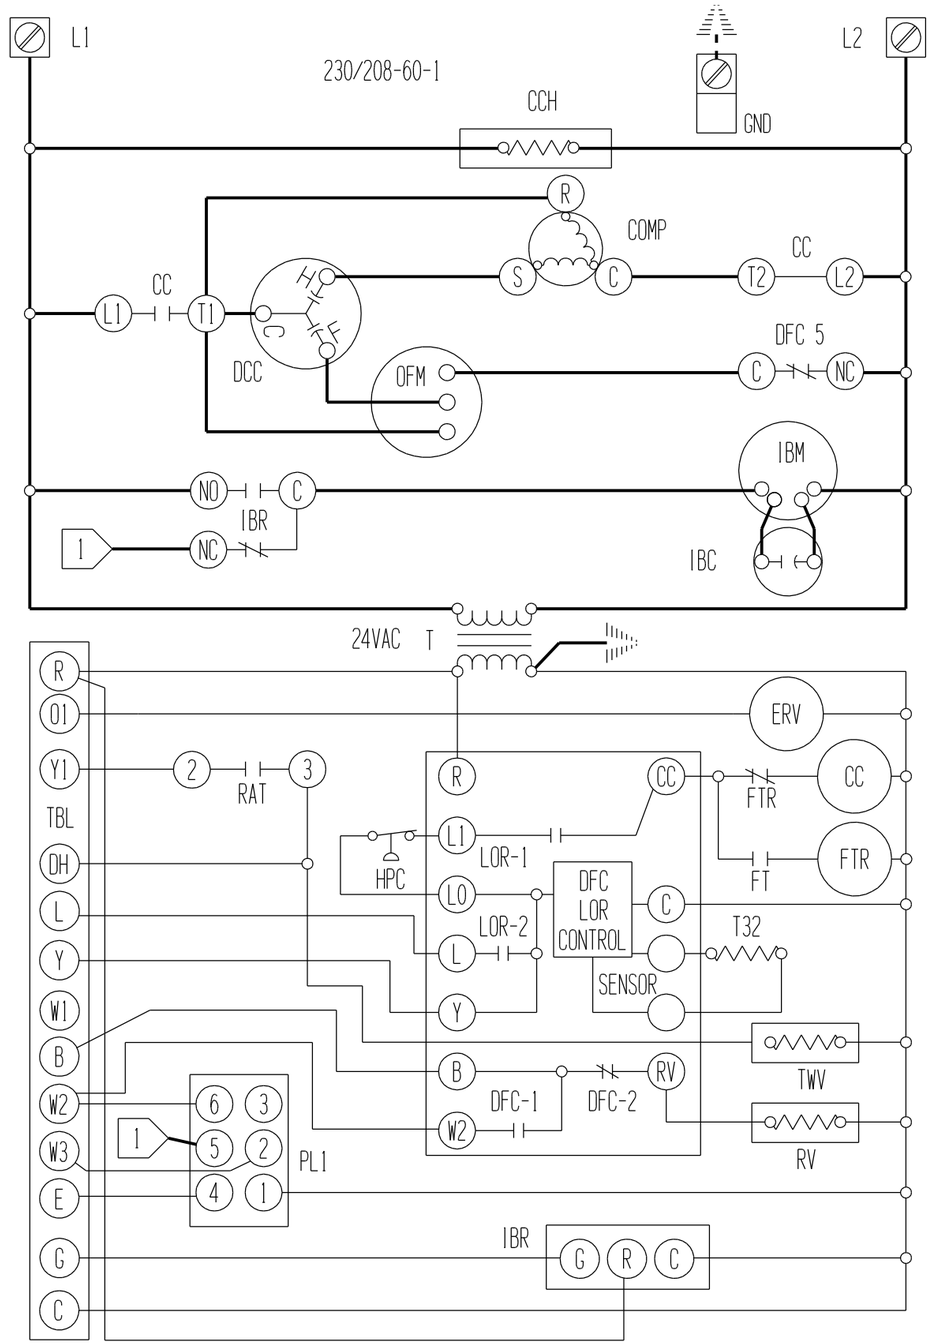

COMPONENT CODE

CB1	CIRCUIT BREAKER #1	IBM	INDOOR BLOWER MOTOR
CB2	CIRCUIT BREAKER #2	IBR	INDOOR BLOWER RELAY
CC	COMPRESSOR CONTACTOR	LAB	LOW AMBIENT BYPASS CONTROL
CCH	COMPRESSOR CRANKCASE HEATER	LAC	LOW AMBIENT CONTROL
COMP	COMPRESSOR	LPB	LOW PRESSURE BYPASS
DCC	DUAL CAN CAPACITOR	LPC	LOW PRESSURE CONTROL
DFC	DEFROST CONTROL	LS	LIMIT SWITCH
EHR	EMERGENCY HEAT RELAY	OFM	OUTDOOR FAN MOTOR
ERV	ENERGY RECOVERY VENTILATOR	PL1	PLUG #1
FT	FREEZE T-STAT	RAT	RETURN AIR THERMOSTAT
FTR	FREEZE T-STAT RELAY	RV	REV. VALVE SOLINOID
GND	EQUIPMENT GROUND	SK	START KIT
H1	HEAT STRIP #1	T	TRANSFORMER
H2	HEAT STRIP #2	TB	TERMINAL BLOCK
HC1	HEATER CONTACTOR #1	TBL	LOW VOLTAGE TERMINAL BLOCK
HC2	HEATER CONTACTOR #2	TCO	THERMAL CUTOFF
HPC	HIGH PRESSURE CONTROL	TWV	THREE WAY VALVE
IBC	INDOOR BLOWER CAPACITOR		

USE COPPER CONDUCTORS ONLY
SUITABLE FOR AT LEAST 75° C

A, B LABELED WIRES CONNECT IF NO OPTIONS USED.

C MOVE RED WIRE TO 208V TAP FOR 208V OPERATION

D RED (LOW) BLACK (HIGH) WHERE APPLICABLE

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE	———	- - - - -	—·—
LOW VOLTAGE	———	- - - - -	—·—
ACCESSORY			—··—

COLOR CODE

BK	BLACK	Y	YELLOW	V	VIOLET	T	TAN
BR	BROWN	G	GREEN	(PR)	PURPLE	PK	PINK
R	RED	BL	BLUE	GY	GRAY	L	LAVENDER
O	ORANGE	W	WHITE	(S)	SLATE		

BARD MFG. CO.

4096-802