


For Vent Wiring or controller/thermostat connections, see literature packet or go to [www.bardhvac.com](http://www.bardhvac.com)

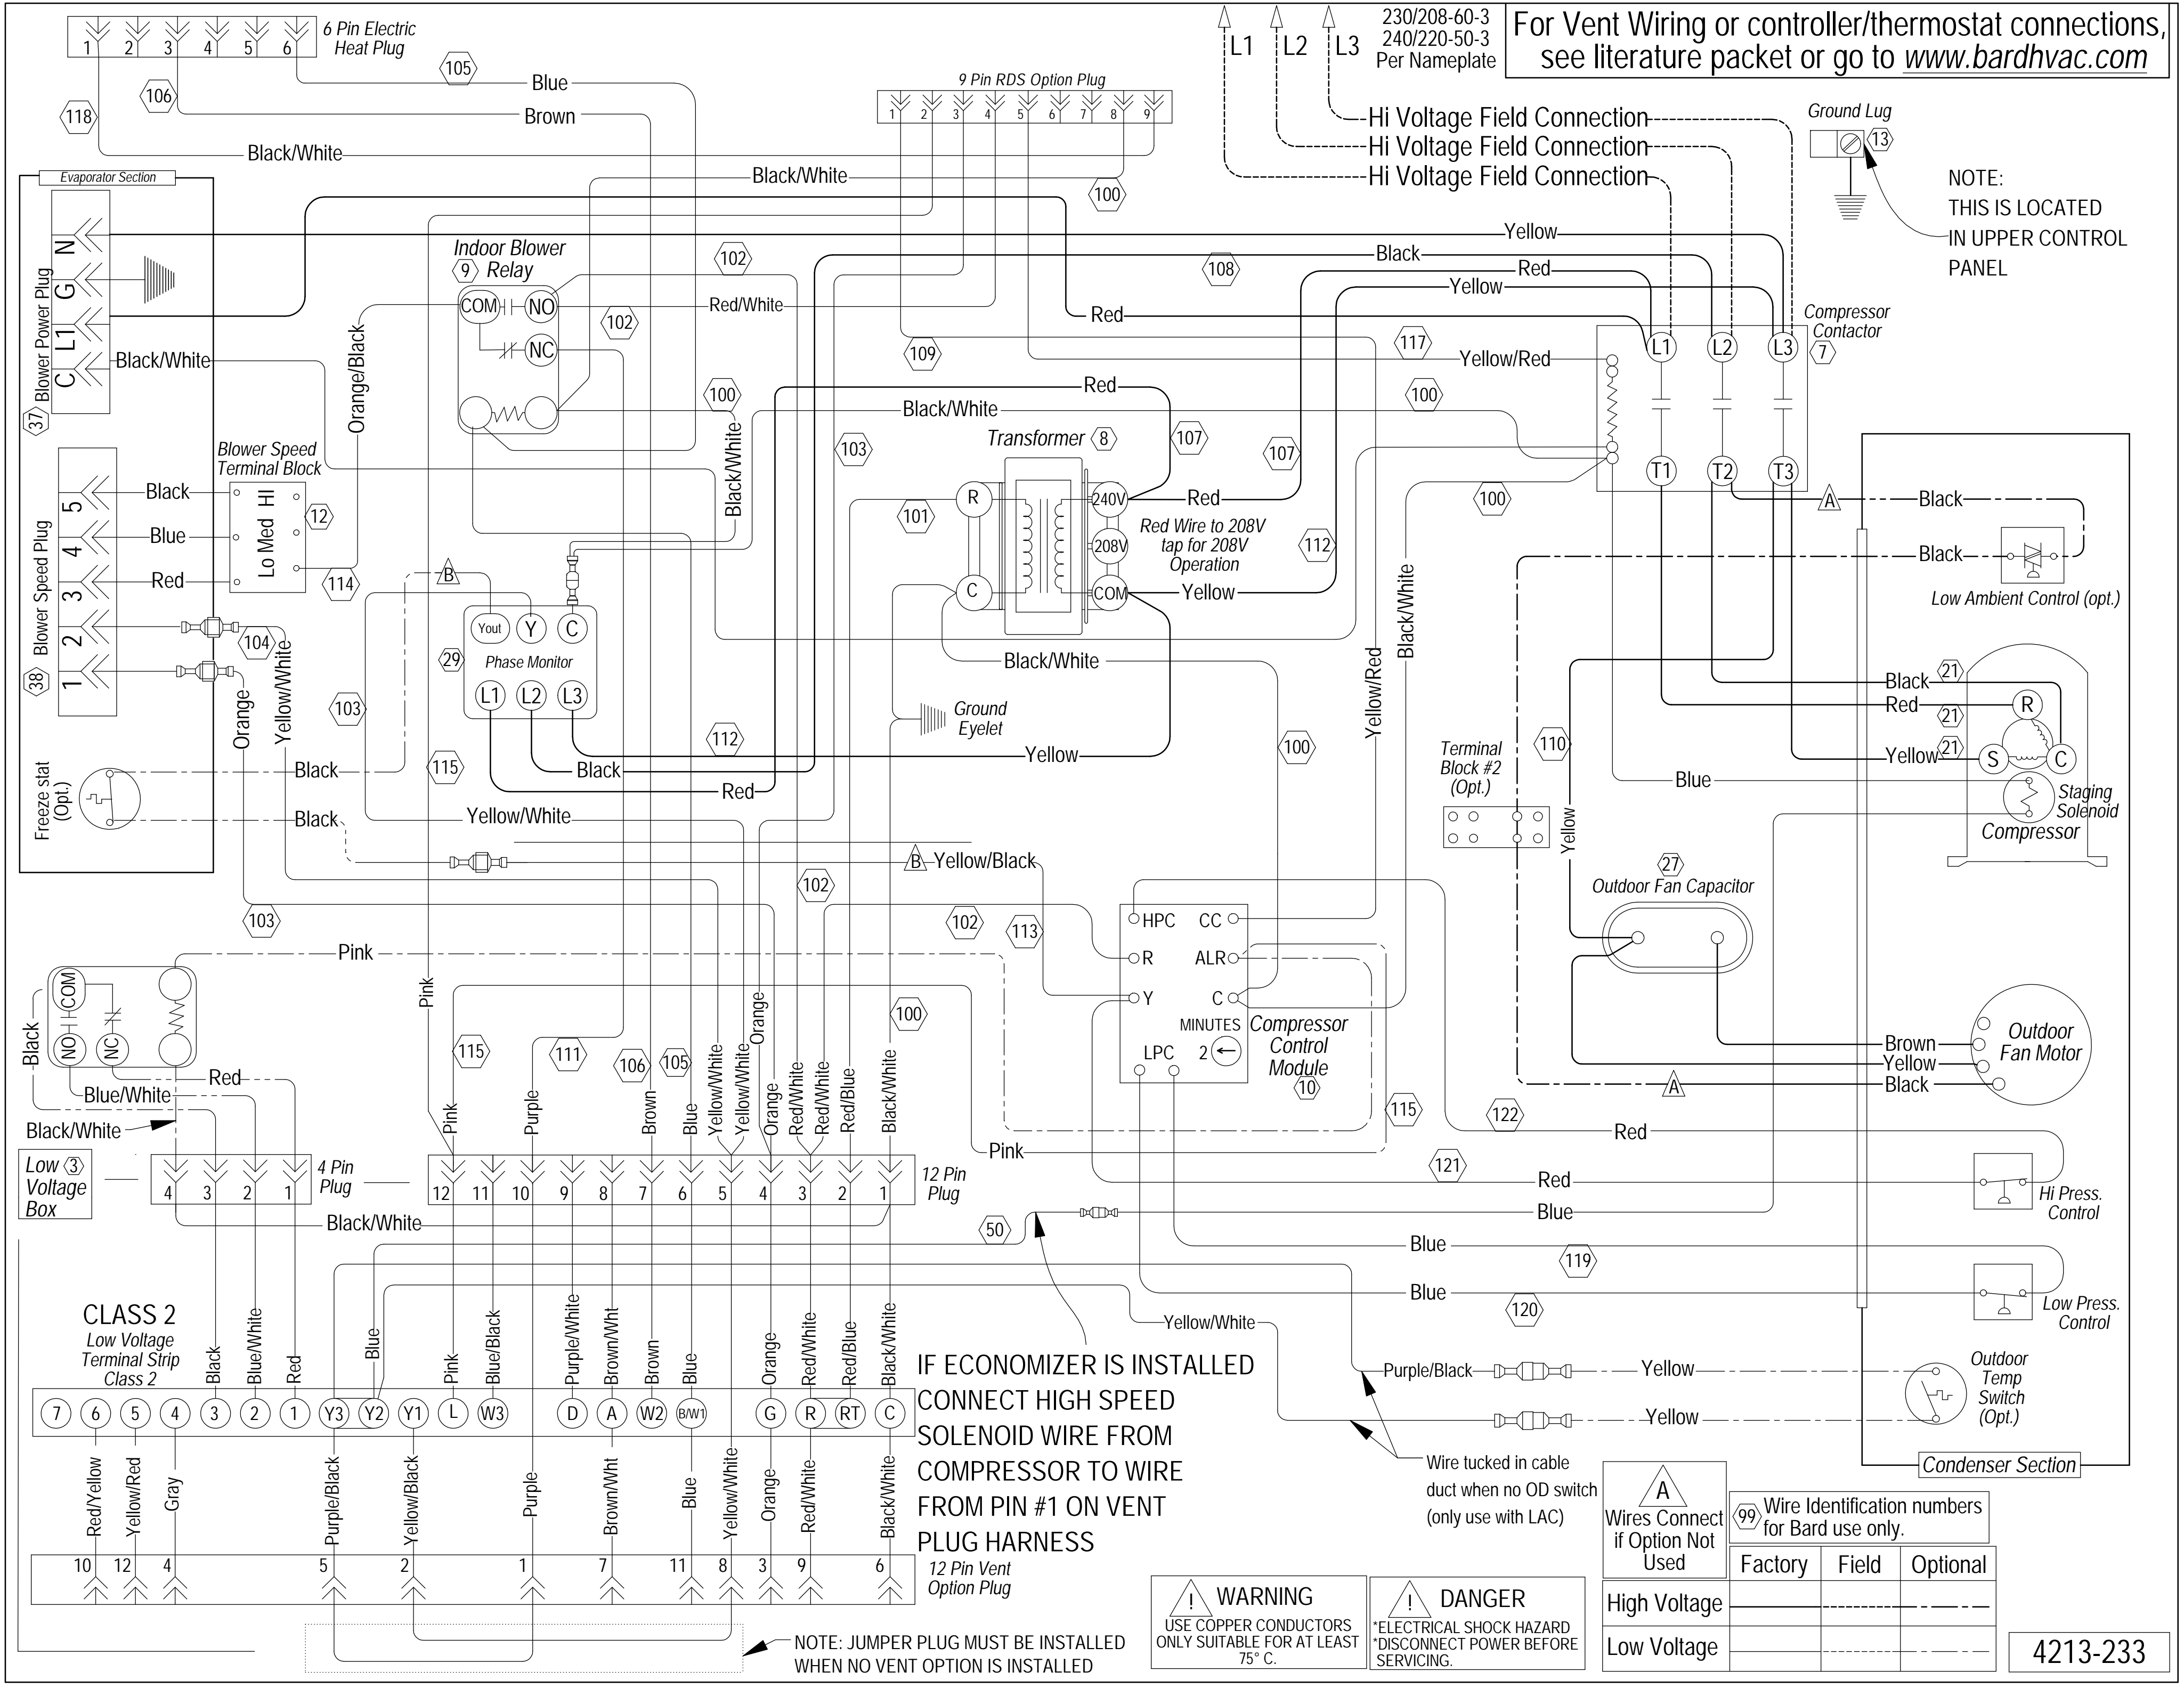

230/208-60-3  
240/220-50-3  
Per Nameplate

NOTE:  
THIS IS LOCATED  
IN UPPER CONTROL  
PANEL

IF ECONOMIZER IS INSTALLED  
CONNECT HIGH SPEED  
SOLENOID WIRE FROM  
COMPRESSOR TO WIRE  
FROM PIN #1 ON VENT  
PLUG HARNESS

NOTE: JUMPER PLUG MUST BE INSTALLED  
WHEN NO VENT OPTION IS INSTALLED

**WARNING**  
USE COPPER CONDUCTORS  
ONLY SUITABLE FOR AT LEAST  
75° C.

**DANGER**  
ELECTRICAL SHOCK HAZARD  
DISCONNECT POWER BEFORE  
SERVICING.

A Wires Connect if Option Not Used	99 Wire Identification numbers for Bard use only.		
	Factory	Field	Optional
High Voltage			
Low Voltage			