


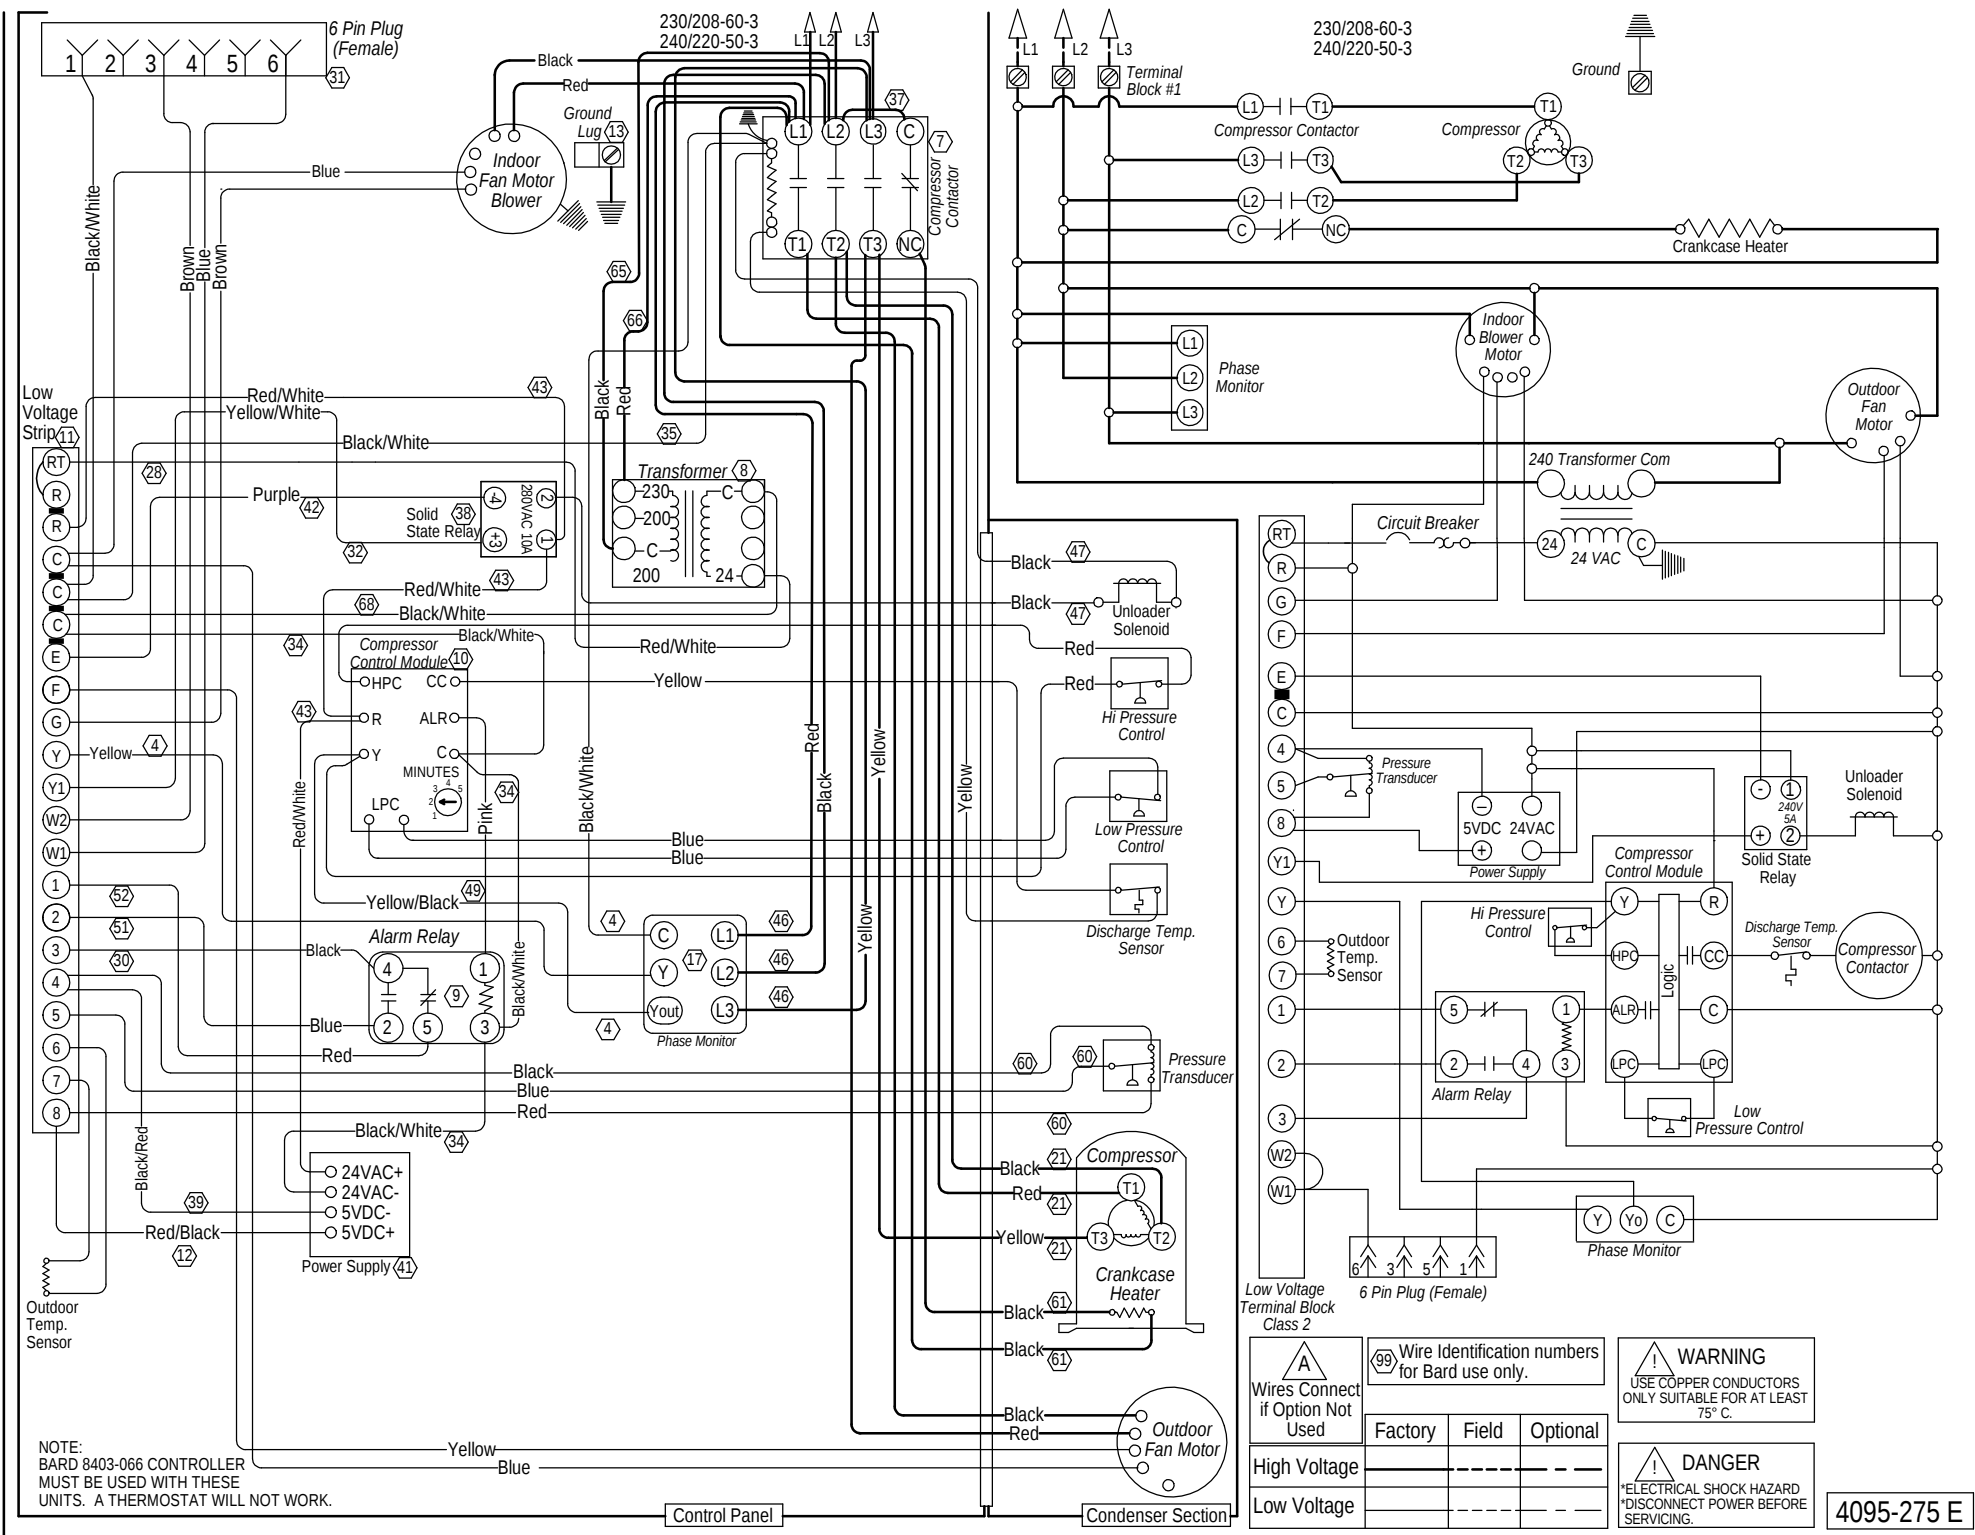

NOTE:
BARD 8403-066 CONTROLLER
MUST BE USED WITH THESE
UNITS. A THERMOSTAT WILL NOT WORK.

A Wires Connect if Option Not Used	99 Wire Identification numbers for Bard use only.		
	Factory	Field	Optional
High Voltage		---	---
Low Voltage		---	---

WARNING
USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

DANGER
ELECTRICAL SHOCK HAZARD
DISCONNECT POWER BEFORE
SERVICING.