

INSTALLATION INSTRUCTIONS

SPLIT SYSTEM AIR CONDITIONER COIL ONLY INDOOR SECTION

FOR USE WITH:

**OIL
GAS
FURNACES**

MANUAL 2100-123 REV. C
SUPERSEDES REV. B
FILE VOL. I, TAB 6

COPYRIGHT JUNE, 1989
BARD MANUFACTURING COMPANY
BRYAN, OHIO

TABLE OF CONTENTS

I. Application and Location	1
General	1
Application	3
Airflow Pressure Drop Measurement	4
CFM For Add-On Coils	4
Condensate Drain Trap	6
II. Wiring	7
Control Circuit Wiring	7
Wall Thermostats	7
Wiring Diagram	8-9

FIGURES AND TABLES

Figure 1	1
Figure 2	3
Figure 3	3
Figure 4	4
Figure 5	6

Table 1	1
Table 2	2
Table 3	5
Table 4	7
Table 5	7

I. APPLICATION AND LOCATION

GENERAL

The model indoor cooling coils are designed for use with outdoor section air conditioners listed in Table 2. They are designed for use with gas or oil furnaces. Optional coil casing plenums are also available.

These instructions cover the indoor coil sections listed in Table 2, all of which are supplied less blower. The outdoor compressor units shown can also be matched with blower coil indoor sections, and those are covered by separate installation manuals shipped with the respective blower coil units.

TABLE 1

COIL DIMENSIONS (Inches)					
Coil	A	B	C	Drain Pan Opening (W&L)	Coil Type
24QS1	13	20-1/2	16-1/4	None	Slant
2ACQ2	18	20-1/2	10-3/4	12-1/4 & 15-1/4	"A"
3ACQ3	18	20-1/2	14	12-1/2 & 15-3/4	"A"
4ACQ2	22	20-1/2	17	14-3/4 & 15-1/4	"A"
5ACQ1	22	28	17	15-1/2 & 23-1/2	"A"
5ACQ2	22	20-1/2	24	14-3/4 & 15-1/4	"A"
3HCQ1	7	31-1/2	16-3/4		"H"
4HCQ	9-1/8	40-3/4	19-1/2		"H"
5HCQ	9-1/8	40-3/4	19-1/2		"H"

FIGURE 1

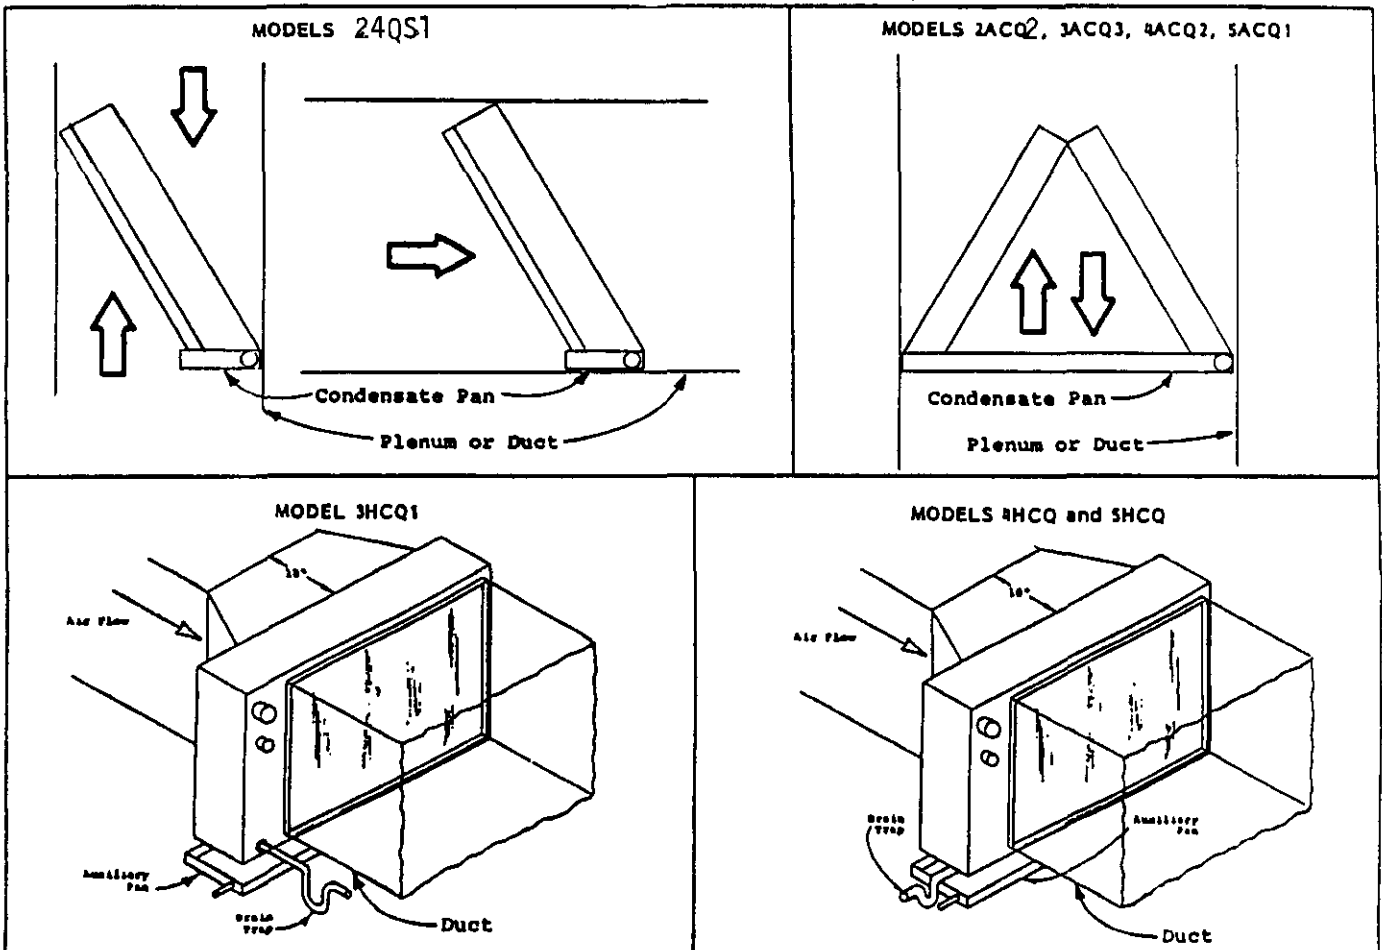


TABLE 2

APPROVED MATCHED COMBINATIONS, RATED CFM STATIC PRESSURE DROP ①				
Condensing Unit Model Number	Evaporator Coil Model Number	CFM	Rated Airflow	Recommended Air Flow Range
			Pressure Drop "H ₂ O" ②	
18ECQ4	24QS1	650	.20	550 - 700
	2ACQ2	650	.30	550 - 700
24ECQ5	24QS1	775	.30	700 - 850
	2ACQ2	800	.30	720 - 950
30ECQ5	3ACQ3	1075	.30	975 - 1225
	3HCQ1	1025	.27	925 - 1175
31ECQ2	3ACQ3	1050	.25	900 - 1150
	3HCQ1	1035	.30	885 - 1135
36ECQ5	3ACQ3	1180	.30	1000 - 1300
	3HCQ1	1000	.30	850 - 1100
37ECQ1	3ACQ3	1180	.30	1000 - 1300
	3HCQ1	1000	.30	850 - 1100
42ECQ1	4ACQ2	1450	.23	1230 - 1600
	5ACQ1	1600	.14	1375 - 1750
	4HCQ	1500	.30	1275 - 1650
48ECQ2	4ACQ2	1690	.30	1565 - 1950
	5ACQ1	1800	.18	1600 - 1850
	5ACQ2	1600	.15	1375 - 1750
	4HCQ	1600	.30	1375 - 1750
60ECQ1	5ACQ1	1990	.28	1705 - 2190
	5ACQ2	1900	.30	1615 - 2100
	5HCQ	1650	.30	1525 - 1910

IMPORTANT INSTALLER NOTE:

① All coils are suitable for up or down airflow direction.

② Measured across the evaporator coil assembly, including drain pan.

APPLICATION

FIGURE 2
TYPICAL APPLICATION OF
COIL TO HIGHBOY FURNACE


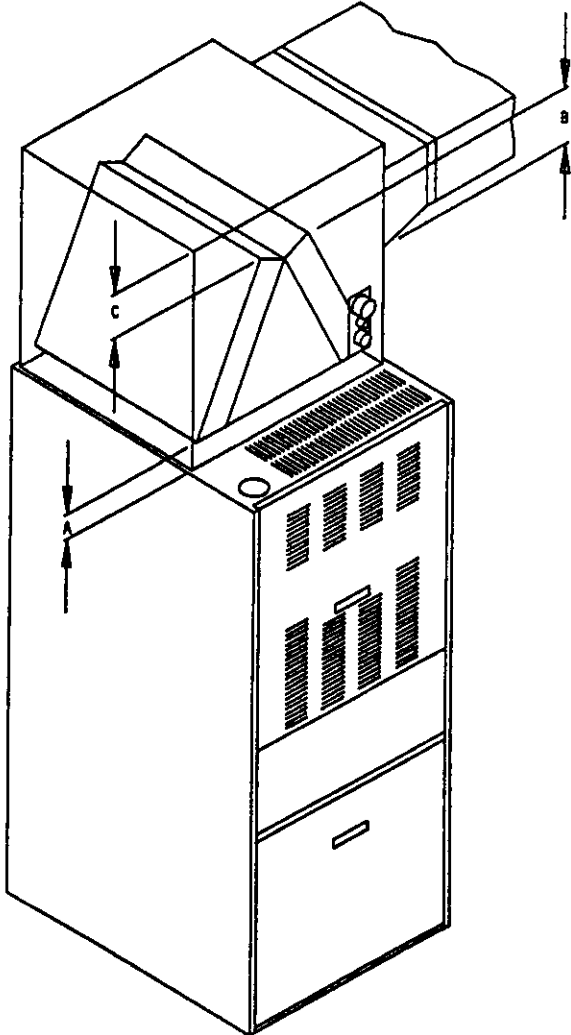


FIGURE 3
TYPICAL APPLICATION OF COIL
COUNTERFLOW FURNACE

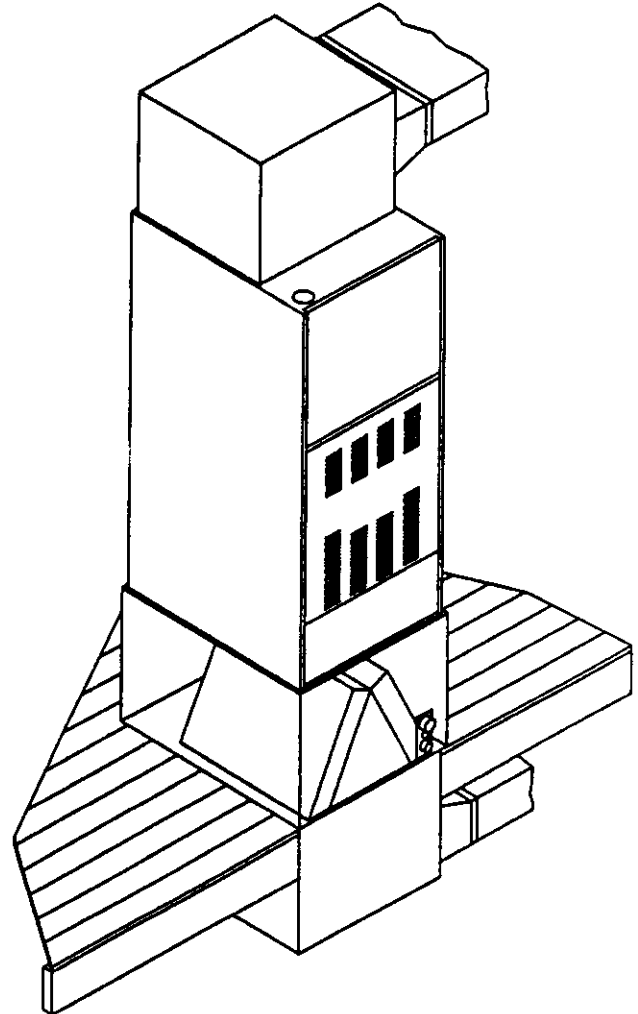

Every coil must have the required two inch minimum clearance between furnace heater exchanger and bottom of coil (Figure 2, dimension A), and not exceed a maximum of two inches between the top of coil and bottom of horizontal ductwork (Figure 2, dimension B).

When the ductwork takes off from only one side of the plenum, the minimum distance from top of coil to top of plenum is six inches (Figure 2, dimension C).

A duct should never be located between the coil and the source of air supply. If your coil is larger than the top of your furnace, a transition is required with a minimum of three inches.

CAUTION: Be sure to seal area on all sides between coil drain pan and plenum to prevent air from bypassing coil.


It is important to provide a removable access door in the plenum slightly larger than the coil for servicing or cleaning the coil.

AIRFLOW PRESSURE DROP MEASUREMENT

A manometer or air draft gauge is required to check the air pressure drop across the indoor evaporator coil section.

The pressure (or positive) side of the gauge should connect to the air inlet (entering) side of the coil, and the suction (or negative) side of the gauge to the downstream (leaving) side of the coil. See Figure 4.

FIGURE 4

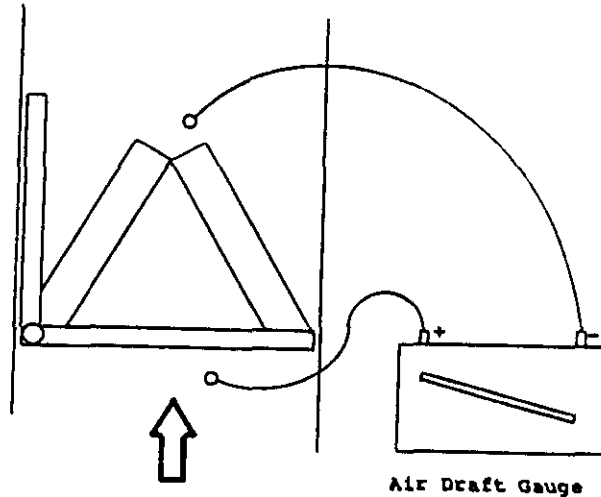

CFM FOR ADD-ON COILS

The furnace that you are going to add a coil to must be able to deliver enough air to satisfy the airflow listed in Table 2 for the coil being used. In a heat pump application, the indoor coil becomes the condensing coil, this is why the amount of air is so critical. Not enough air results in too high of high side pressures and temperatures.

The furnace CFM can be calculated by using the following formula:

$$\text{CFM} = \frac{\text{Output (BTU/H)}}{1.08 \times \text{Temp. Rise}}$$

When adding a coil to an existing GAS FURNACE, proceed as follows to determine the gas input to the furnace. Shut off all other gas appliances in the home, then set the indoor wall thermostat to call for heat. Go to the gas meter and clock the fastest moving dial, then refer to the chart below.

EXAMPLE: Most gas utilities use 1000 BTU per cubic foot of gas. If you were to clock the one cubic foot dial and found it took 36 seconds for one revolution, then in one hour the furnace would use 100,000 BTU, but we all know that no furnace is 100 percent efficient, so suppose we assume this furnace to be 70 percent efficient, then we should have approximately 70,000 BTU per hour output. Using the figure our formula would look like this:

$$\text{CFM} = \frac{70,000}{1.08 \times \text{T.R}} \quad \text{or} \quad \text{CFM} = \frac{70,000}{1.08 \times ?}$$

We must still obtain a temperature rise through the furnace. This is done by measuring the return air temperature and the supply air temperature. Let's again assume we were able to measure a 60 degree F temperature rise through the furnace. Now we can complete our formula.

$$CFM = \frac{70,000}{1.08 \times 60} \quad \text{or} \quad CFM = \frac{70,000}{65}$$

Then, our CFM for this furnace would be 1076 CFM.

TABLE 3

Seconds For One Rev.	SIZE OF TEST DIAL					Seconds For One Rev.	SIZE OF TEST DIAL				
	1/4 Cu. Ft.	1/2 Cu. Ft.	1 Cu. Ft.	2 Cu. Ft.	5 Cu. Ft.		1/4 Cu. Ft.	1/2 Cu. Ft.	1 Cu. Ft.	2 Cu. Ft.	5 Cu. Ft.
10	90	180	360	720	1800	36	25	50	100	200	500
11	82	164	327	655	1636	37	--	--	97	195	486
12	75	150	300	600	1500	38	23	47	95	189	474
13	69	138	277	555	1385	39	--	--	92	185	462
14	64	129	257	514	1286	40	22	45	90	180	450
15	60	120	240	480	1200	41	--	--	--	176	439
16	56	113	225	450	1125	42	21	43	86	172	429
17	53	106	212	424	1059	43	--	--	--	167	419
18	50	100	200	400	1000	44	--	41	82	164	409
19	47	95	189	379	947	45	20	40	80	160	400
20	45	90	180	360	900	46	--	--	78	157	391
21	43	86	171	343	857	47	19	38	76	153	383
22	41	82	164	327	818	48	--	--	75	150	375
23	39	78	157	313	783	49	--	--	--	147	367
24	37	75	150	300	750	50	18	36	72	144	360
25	36	72	144	288	720	51	--	--	--	141	355
26	34	69	138	277	692	52	--	--	69	138	346
27	33	67	133	267	667	53	17	34	--	136	340
28	32	64	129	257	643	54	--	--	67	133	333
29	31	62	124	248	621	55	--	--	--	131	327
30	30	60	120	240	600	56	16	32	64	129	321
31	--	--	116	232	581	57	--	--	--	126	316
32	28	56	113	225	563	58	--	31	62	124	310
33	--	--	109	218	545	59	--	--	--	122	305
34	26	53	106	212	529	60	15	30	60	120	300
35	--	--	103	206	514						

If the furnace is equipped with a direct drive motor, make sure you have it wired to high speed tap. If it is a belt drive motor, then read the motor's nameplate amps. Then hook on an amp probe and see if it is possible to speed the blower up by adjusting the variable pulley.

If you are at the limits of the motor, then check with the furnace manufacturer to see if a larger horsepower motor can be installed and also if the blower will give you the needed CFM with a larger motor.

When you have determined that your furnace can handle the required CFM for your coil, the indoor coil must be installed and your CFM calculation must be rechecked with the coil in place.

When adding to an OIL FURNACE, you must determine what size nozzle the unit has in the burner and then install a pressure gauge in the oil delivery pumps discharge port and set the pressure at 100 psig. An example might be that we find the burner equipped with a one gallon per hour nozzle, operating at 100 psi. This nozzle will deliver one G.P.H. and a gallon of No. 2 fuel oil has approximately 140,000 BTU of heat.

The 140,000 BTU is our input and again let us assume that this furnace is operating at 70 percent efficiency.

Then our BTU output is 98,000 BTU, and if we use the rule of thumb that an oil furnace should operate with an 85 degree F temperature rise, then our formula would look like this:

$$\text{CFM} = \frac{98,000 \text{ BTU/H}}{1.08 \times 85 \text{ degree F}} \quad \text{or} \quad \frac{98,000 \text{ BTU/H}}{92} = 1065 \text{ CFM}$$

When adding on to an electric furnace, we must also take one more thing into consideration and that is the heat pump coil must be installed on the return side of the electric furnace. To find out what CFM the electric furnace can deliver, we must measure the voltage and amperage of each heating element or Volts x Amp - Watts. The total Watts x 3.4 BTU = BTU Output. An example might look like this with a 15kw electric furnace.

$$\begin{aligned} 240 \text{ Volts} \times 21 \text{ Amps} &= 5,040 \text{ Watts} \\ 5,040 \text{ Watts} \times 3 \text{ Elements} &= 15,120 \text{ Watts} \\ 15,120 \text{ Watts} \times 3.4 \text{ BTU/Watt} &= 51,408 \text{ BTU} \end{aligned}$$

One word of caution, never go by nameplate rating. Always measure volts and amps.

One more item that is different with an electric furnace and that is, never obtain a supply air temperature reading in sight of the electric element (because of the radiant affect). Now our formula looks like this again:


$$\text{CFM} = \frac{51408 \text{ BTU/H}}{1.08 \times 44 \text{ degree F}} \quad \text{or} \quad \frac{51408 \text{ BTU/H}}{48} = 1071 \text{ CFM}$$

CONDENSATE DRAIN TRAP

It is very important to provide a trap in the condensate drain line to allow a positive liquid seal in the line and assure correct drainage from the coil condensate pan.

Install condensate drain trap shown below. Use drain connection size or larger. Do not operate unit without trap. Unit must be level or slightly inclined toward drain.

FIGURE 5

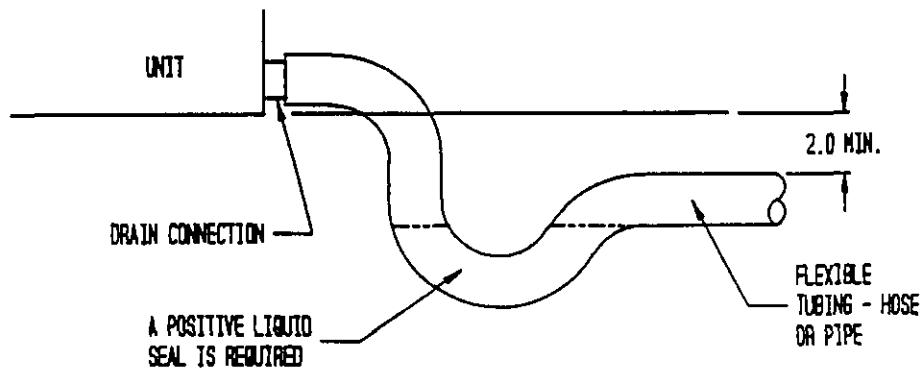

II. WIRING

CONTROL CIRCUIT WIRING

There are two (2) separate control diagrams for fossil fuel furnaces with air conditioning.

TABLE 4

Air Conditioning System	Gas Furnace Control Diagram	Oil Furnace Control Diagram
All	4091-100	4091-101

WALL THERMOSTATS

The following wall thermostats and subbases should be used as indicated, depending on the application.

TABLE 5

AIR CONDITIONING THERMSTATS		
Part No.	Model No.	Description
8403-017	T874R1129	THERMOSTAT--1 stg. cool, 2 stg. heat, 1st stage fixed, 2nd stg. adj. heat anticipators
8404-009	Q674L1181	SUBBASE --System switch: Em. Heat-Heat-Off-Cool Fan switch: On-Auto SPECIAL FEATURE: Manual Changeover (Non-Cycling Rev. Valve) Em. heat light and System check light
8403-018	T874N1024	THERMOSTAT--1 stg. cool, 2 stg. heat, 1st stage fixed, 2nd stg. adj., heat anticipators
8404-010	Q674F1261	SUBBASE --System switch: Off-Cool-Auto-Heat-Em.Ht. Fan switch: On-Auto SPECIAL FEATURE: Auto system changeover, Em. heat light and System check light
8403-024	IF58-45	THERMOSTAT--1 stg. cool, 2 stg. heat, 1st stage fixed, 2nd stg. adj. heater System switch: Em. Heat-Heat-Off-Cool Fan Switch: On-Auto

