INSTALLATION INSTRUCTIONS

TWO STAGE HEAT PUMPS **LOW VOLTAGE CONTROL CIRCUIT WIRING**

Models:

T**S T**S*D C**H



Bard Manufacturing Company, Inc. Bryan, Ohio 43506

www.bardhvac.com

Manual: 2100-554F Supersedes: 2100-554E Date: 7-28-15

CONTENTS

Installatio Low Volta	on ge Wiring3			
Figures		Tables		
Figure 1	Basic HP w/Opt. Elec. Heat5	Table 1	Diagram to Use w/Unit and Vents	3
Figure 2	HP w/Opt. MFAD, CRV & ERV Vent. Pkg w/Programmable T-Stat6	Table 2 Table 3	Operating Voltage RangeWall Thermostat	
Figure 3	HP w/Opt. Economizer7	Table 4	Humidity Controls	
Figure 4	HP w/Dehumidification Sequence & No Vent Pkg. Using T-Stat Comb8	Table 5 Table 6	CO ₂ Controller	
Figure 5	HP w/Dehumidification Sequence & Opt. MFAD, CRV, & ERV Vent Pkg. Using Elec. T-Stat w/Combination Temp. & Humidity Control9			
Figure 6	Dehum. HP with Opt. Economizer10			
Figure 7	2 Stage HP w/Opt. Elec. Heat w/ ECONWM* Style Economizer11			
Figure 8	2 Stage HP w/Dehum. & Opt. Elec. Heat w/ECONWM* Style Economizer			
Figure 9	2 Stage HP w/CHCRV-5 or CRVMWH-3 Vent Opt Pkg. w/Prog. T-Stat w/Opt. On/Off CO ₂ Controller13			
Figure 10	2 Stage HP w/CHCRV-5 or CRVMWH-3 Vent Opt. Pkg. w/Prog. T-Stat w/Opt. Modulating CO ₂ Controller14			

TABLE 1
Diagram to Use With Unit and Vents

Model Series	No Vents	ERV MFAD CRV	CRVMWH-3 CHCRV-5	Economizer "E" Vent Option	T, W, S ECONWMT
Vent Code	Х	R, M, V, P	С	E	T, W, S
T**S / C**H	1	2	9 & 10	3	7
T**S*D	4	5	9 & 10	6	8

LOW VOLTAGE WIRING

230/208V, 1 phase and 3 phase equipment dual primary voltage transformers. All equipment leaves the factory wired on 240V tap. For 208V operation, reconnect from 240V to 208V tap. The acceptable operating voltage range for the 240V and 208V taps are:

TABLE 2
Operating Voltage Range

Тар	Range	
240V	253 - 216	
208V	220 - 187	

NOTE: The voltage should be measured at the field power connection point in the unit and while the unit is operating at full load (maximum amperage operating condition).

An 18 gauge copper, color-coded thermostat cable is recommended. The connection points are shown in Table 2.

Low Voltage Connection

These units use a grounded 24-volt AC low voltage circuit.

The "R" terminal is the *hot* terminal and the "C" terminal is *grounded*.

- "G" terminal is the fan input.
- "Y" terminal is the compressor input Stage 1.
- "B" terminal is the *reversing valve input*. The reversing valve must be energized for heating mode.
- "R" terminal is the 24 VAC hot.
- "RT" terminal is the 24 VAC hot from transformer (used with "R" for fire/smoke shutdown).
- "C" terminal is the 24 VAC grounded.
- "Y1" terminal is the compressor input Stage 2.

- "L" terminal is *compressor lockout output*. This terminal is activated on a high or low pressure trip by the electronic heat pump control. This is a 24 VAC output.
- "W2" terminal is second stage heat (if equipped).
- "01" terminal is the *ventilation input*. This terminal energizes any factory installed ventilation option.
- "E" terminal is the *emergency heat input*. This terminal energizes the emergency heat relay.
- "W3" terminal is the *dehumidification input*. This terminal energizes compressor, blower and threeway valve. This applies only to models equipped for dehumidification sequence.

LOW VOLTAGE CONNECTIONS FOR DDC CONTROL			
Fan Only	Energize G		
Cooling Mode 1st Stage	Energize Y, G		
Cooling Mode 2 nd Stage	Energize Y, Y1, G		
Heat Pump Heating 1st Stage	Energize Y, G, B		
Heat Pump Heating 2 nd Stage	Energize Y, Y1, B, G		
3 rd Stage Heating w/Heat Pump (if employed)	Energize G, W2, Y, B, Y1		
Ventilation	Energize G, 01		
Emergency Heat	Energize B, W2, E, G		
Dehumidification	Energize W3		

TABLE 3 Wall Thermostat

Part Number	Predominate Features	
8403-060 (1120-445)	3 stage Cool; 3 stage Heat Programmable/Non-Programmable Electronic HP or Conventional Auto or Manual changeover Dehumidification Output	

TABLE 4 Humidity Controls

Part Number	Predominate Features
	SPDT switching, pilot duty 50VA @ 24V Humidity range 20-80% RH
8403-047 (H200-10-21-10)	Electronic dehumidistat SPST closes-on-rise Humidity range 10-90% with adjustable stops


TABLE 5 CO₂ controller

Part Number	Predominate Features		
8403-067	Normally Open SPST relay closes-on-rise 24V dual wave length sensor. Default setting 950ppm, adjustable to 0-2000ppm Default off setting 1000ppm, adjustable to 0-200 ppm can be calibrated		

TABLE 6 Thermostat Wire Size


Transformer VA	FLA	Wire Gauge	Maximum Distance In Feet
55	2.3	20 gauge 18 gauge 16 gauge 14 gauge 12 gauge	45 60 100 160 250

FIGURE 1 Low Voltage Wiring Diagram: **Heat Pump With Optional Electric Heat** No Economizer or Ventilation Packages

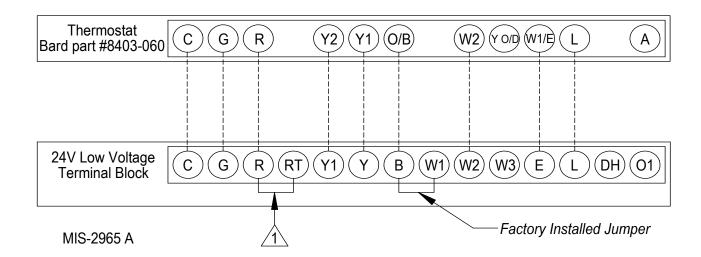

Factory installed jumper (on applicable models). Remove jumper and connect to N.C fire alarm circuit if emergency shutdown required.

FIGURE 2 Low Voltage Wiring Diagram: Heat Pump With Optional MFAD, CRV & ERV Ventilation Packaging With Programmable Thermostat

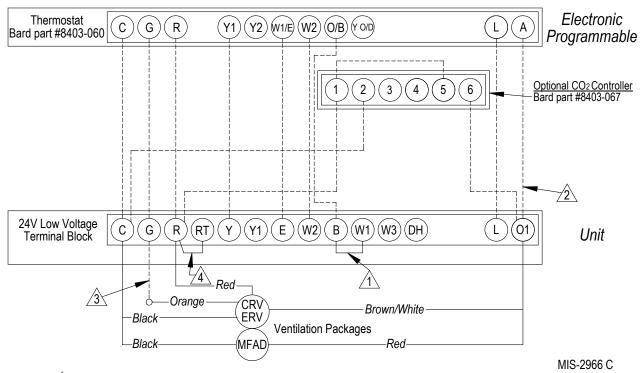

1 Factory Jumper Installed

Factory installed jumper (on applicable models).
Remove jumper and connect to N.C fire alarm circuit if emergency shutdown required.

FIGURE 3 Low Voltage Wiring Diagram: Heat Pump With Optional Economizer


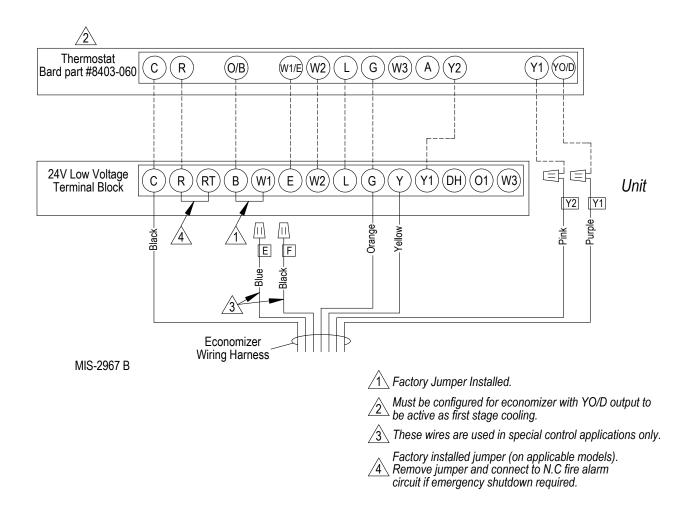


FIGURE 4

Low Voltage Wiring Diagram:

Heat Pump With Dehumidification Sequence and No Ventilation Package Using Thermostat #8403-060 Combination Temperature & Humidity Controller

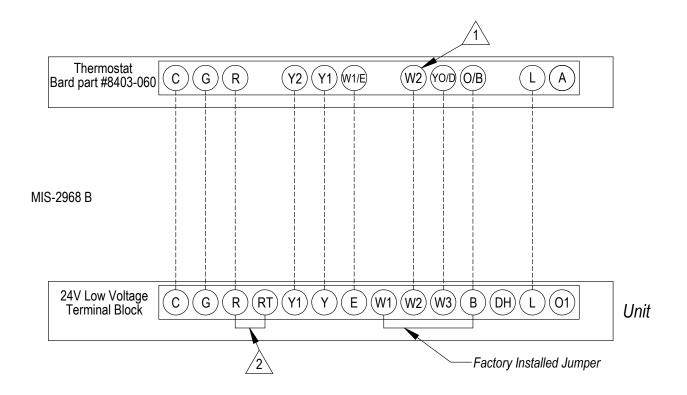


Must be configured for "no economizer" to make YO/D output active for humidity control.

Factory installed jumper (on applicable models). Remove jumper and connect to N.C fire alarm circuit if emergency shutdown required.

FIGURE 5 Low Voltage Wiring Diagram:

Heat Pump With Dehumidification Sequence & Optional MFAD, CRV & ERV Ventilation Packaging Using Electronic Thermostat With Combination Temperature & Humidity Control With Optional CO₂ Controller

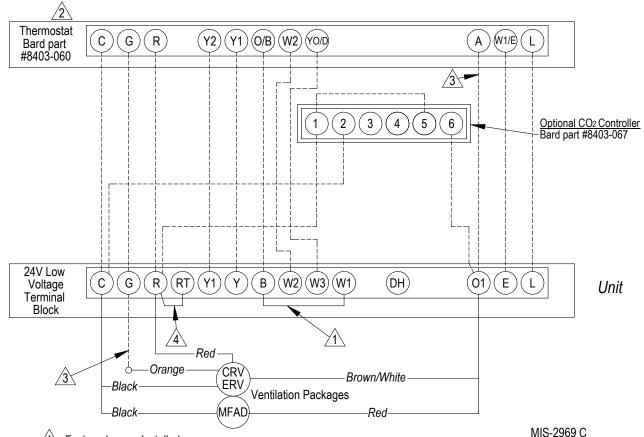

1 Factory Jumper Installed

Must be configured for "no economizer" to make YO/D output active for humidity control.

Do not connect "A" from thermostat if optional CO₂ controller is used. Connect orange wire to "G" only when optinal CO₂ controller is used.

Factory installed jumper (on applicable models).
Remove jumper and connect to N.C fire alarm circuit if emergency shutdown required.

FIGURE 6
Low Voltage Wiring Diagram:
Dehumidification Heat Pump With Optional Economizer


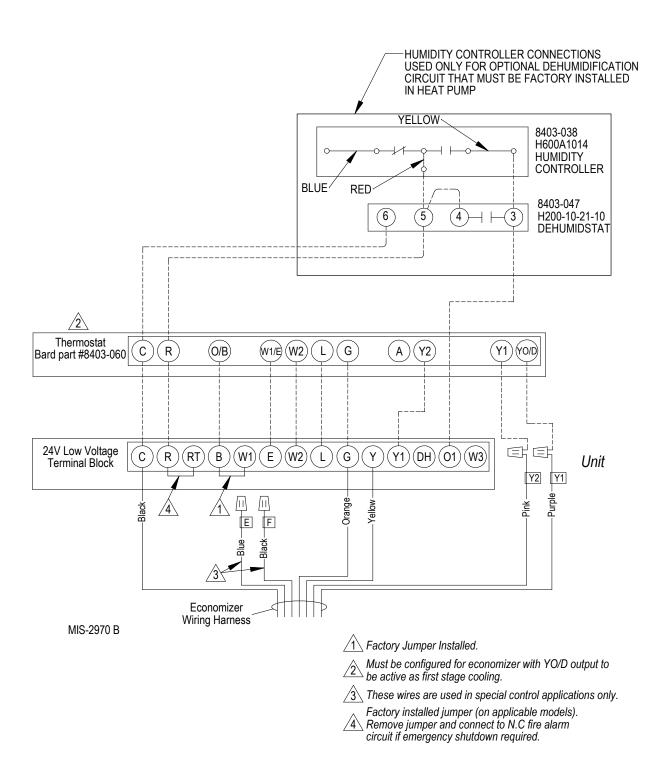


FIGURE 7 Low Voltage Wiring Diagram: 2 Stage Heat Pump With Optional Electric Heat With ECONWM* Style Economizer

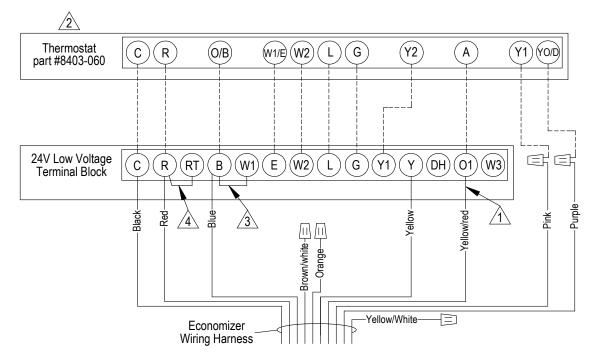

Must be energized to enable minimum position. NOTE: Economizer Control Default Setting is 10V (100%). Depending upon application may require setting to lower value.

Must be configured for heat pump and economizer to enable YO/D output to be active as 1st-stage cooling


3 Factory Jumper Installed.

Factory installed jumper (on applicable models).
Remove jumper and connect to N.C fire alarm circuit if emergency shutdown required.

MIS-2982 C

FIGURE 8

Low Voltage Wiring Diagram: 2 Stage Heat Pump With Dehumidification & Optional Electric Heat With ECONWM★ Style Economizer

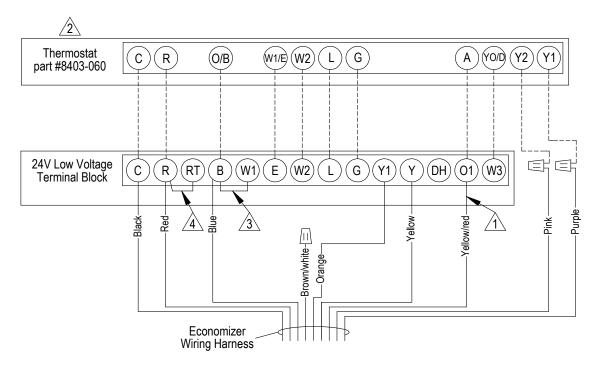

Must be energized to enable minimum position. NOTE: Economizer Control Default Setting is 10V (100%). Depending upon application may require setting to lower value.

Must be configured for heat pump to enable YO/D output to be active dehumidification output


3 Factory Jumper Installed.

Factory installed jumper (on applicable models).

Remove jumper and connect to N.C fire alarm circuit if emergency shutdown required.

MIS-2999 A

FIGURE 9 Low Voltage Wiring Diagram: 2 Stage Heat Pump With CHCRV-5 or CRVMWH-3 Vent Option Package With Programmable Thermostat With Optional On/Off CO₂ Controller

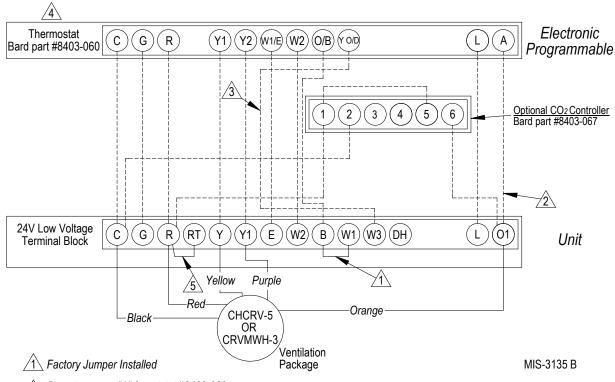


3 Wire only needed for dehumidification units

Must be configured to programmable and fan set to programmed for the "A" output to function during scheduled occupied periods

Factory installed jumper (on applicable models). Remove jumper and connect to N.C fire alarm circuit if emergency shutdown required.

FIGURE 10

Low Voltage Wiring Diagram: 2 Stage Heat Pump With CHCRV-5 or CRVMWH-3 Vent Option Package With Programmable Thermostat With Optional Modulating CO₂ Controller

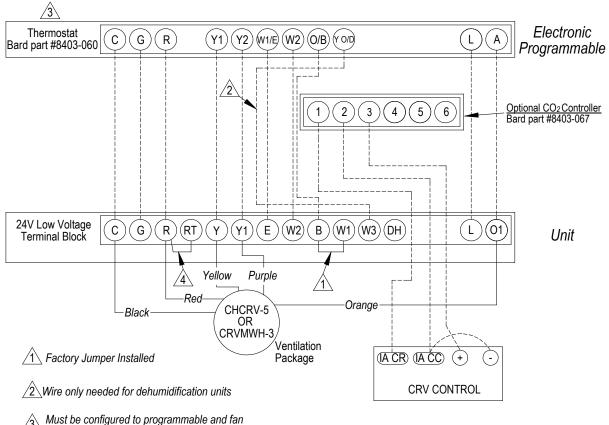

Must be configured to programmable and fan set to programmed for the "A" output to function during scheduled occupied periods

MIS-3334 A

Factory installed jumper (on applicable models). Remove jumper and connect to N.C fire alarm circuit if emergency shutdown required.