

---

# INSTALLATION INSTRUCTIONS

---

## WALL MOUNTED PACKAGED HEAT PUMP & LOW VOLTAGE CONTROL CIRCUIT WIRING

Models:

J18H2-A

J24H2-A

J30H2-A

J36H2-A

J42H2-A

J48H2-A

J60H2-A

J24H2-B

J30H2-B

J36H2-B

J42H2-B

J48H2-B

J60H2-B

J24H2-C

J30H2-C

J36H2-C

J42H2-C

J48H2-C

J60H2-C



Manual: 2100-606A  
Supersedes: 2100-606  
Date: 7-28-15

# Contents

|   |          |  |    |
|---|----------|--|----|
| <b>Getting Other Information and Publications</b>     | <b>3</b> | <b>Start Up</b>                                |    |
| <b>Wall Mount General Information</b>                 |          | General .....                                  | 18 |
| Wall Mount Model Nomenclature .....                   | 4        | Topping Off System Charge .....                | 18 |
| Shipping Damage .....                                 | 4        | Safety Practices .....                         | 18 |
| General .....   | 4        | Important Installer Note .....                 | 19 |
| Duct Work .....                                       | 5        | High & Low Pressure Switch .....               | 19 |
| Filters .....   | 5        | Three Phase Scroll Compressor .....            | 19 |
| Fresh Air Intake .....                                | 5        | Phase Monitor .....                            | 19 |
| Condensate Drain .....                                | 5        | Condenser Fan Operation .....                  | 19 |
|   |          | Service Hints .....                            | 19 |
| <b>Installation Instructions</b>                      |          | Sequence of Operation .....                    | 20 |
| Wall Mounting Information .....                       | 6        | Pressure Service Ports .....                   | 20 |
| Mounting the Unit .....                               | 6        | Defrost Cycle .....                            | 20 |
| Clearances Required .....                             | 6        | <b>Troubleshooting</b>                         |    |
| Minimum Clearances .....                              | 6        | Solid State Heat Pump Control .....            | 22 |
| Wiring – Main Power .....                             | 15       | Checking Temperature Sensor .....              | 23 |
| Wiring – Low Voltage Wiring .....                     | 15       | Fan Blade Setting Dimensions .....             | 24 |
|   |          | Removal of Fan Shroud .....                    | 24 |
|   |          | Refrigerant Charge .....                       | 24 |
| <b>Figures</b>  |          | <b>Tables</b>                                  |    |
| Figure 1 Fresh Air Damper Assembly .....              | 5        | Table 1 Diagram to Use w/Unit & Vents .....    | 15 |
| Figure 2 Unit Dimensions .....                        | 7        | Table 2 Operating Voltage Range .....          | 15 |
| Figure 3A Mounting Instructions - J18 & J24 .....     | 8        | Table 3 Thermostat Wire Size .....             | 15 |
| Figure 3B Mounting Instructions - J30 & J36 .....     | 9        | Table 4 Troubleshooting .....                  | 22 |
| Figure 3C Mounting Instructions - J42, J48, J60 ..... | 10       | Table 5 Fan Blade Dimension .....              | 24 |
| Figure 4 Electric Heat Clearance .....                | 11       | Table 6 Refrigerant Charge .....               | 24 |
| Figure 5 Wall Mounting Instructions .....             | 12       | Table 7 Cooling Pressure .....                 | 25 |
| Figure 6 Wall Mounting Instructions .....             | 12       | Table 8 Heating Pressure .....                 | 25 |
| Figure 7 Common Wall Mounting Installations .....     | 13       | Table 9 Electrical Specifications J**H .....   | 26 |
| Figure 8 Defrost Control Board .....                  | 21       | Table 10 Recommended Airflow .....             | 27 |
| Figure 9 Fan Blade Setting .....                      | 24       | Table 11 Indoor Blower Performance .....       | 27 |
| <b>Diagrams</b>                                       |          | Tables 12 Maximum ESP Electric Heat Only ..... | 28 |
| Diagram 1 HP w/Opt. Elec. Heat No Econ. ....          | 16       | Table 13 Electric Heat .....                   | 28 |
| Diagram 2 HP w/ECONWMT Economizer .....               | 17       | Table 14 Optional Accessories .....            | 29 |
|   |          | Table 15 Vent & Control Options .....          | 30 |

---

## GETTING OTHER INFORMATION AND PUBLICATIONS

---

These publications can help you install the air conditioner or heat pump. You can usually find these at your local library or purchase them directly from the publisher. Be sure to consult current edition of each standard.

National Electrical Code ..... ANSI/NFPA 70

Standard for the Installation ..... ANSI/NFPA 90A  
of Air Conditioning and Ventilating Systems

Standard for Warm Air ..... ANSI/NFPA 90B  
Heating and Air Conditioning Systems

Load Calculation for ..... ACCA Manual J  
Residential Winter and Summer Air Conditioning

Duct Design for Residential ..... ACCA Manual D  
Winter and Summer Air Conditioning and Equipment  
Selection

### FOR MORE INFORMATION, CONTACT THESE PUBLISHERS:

**ACCA**     **Air Conditioning Contractors of America**  
1712 New Hampshire Ave. N.W.  
Washington, DC 20009  
Telephone: (202) 483-9370  
Fax: (202) 234-4721


**ANSI**     **American National Standards Institute**  
11 West Street, 13th Floor  
New York, NY 10036  
Telephone: (212) 642-4900  
Fax: (212) 302-1286

**ASHRAE**   **American Society of Heating, Refrigeration  
and Air Conditioning Engineers, Inc.**  
1791 Tullie Circle, N.E.  
Atlanta, GA 30329-2305  
Telephone: (404) 636-8400  
Fax: (404) 321-5478

**NFPA**     **National Fire Protection Association**  
Batterymarch Park  
P.O. Box 9101  
Quincy, MA 02269-9901  
Telephone: (800) 344-3555  
Fax: (617) 984-7057

# WALL MOUNT GENERAL INFORMATION

## HEAT PUMP WALL MOUNT MODEL NOMENCLATURE

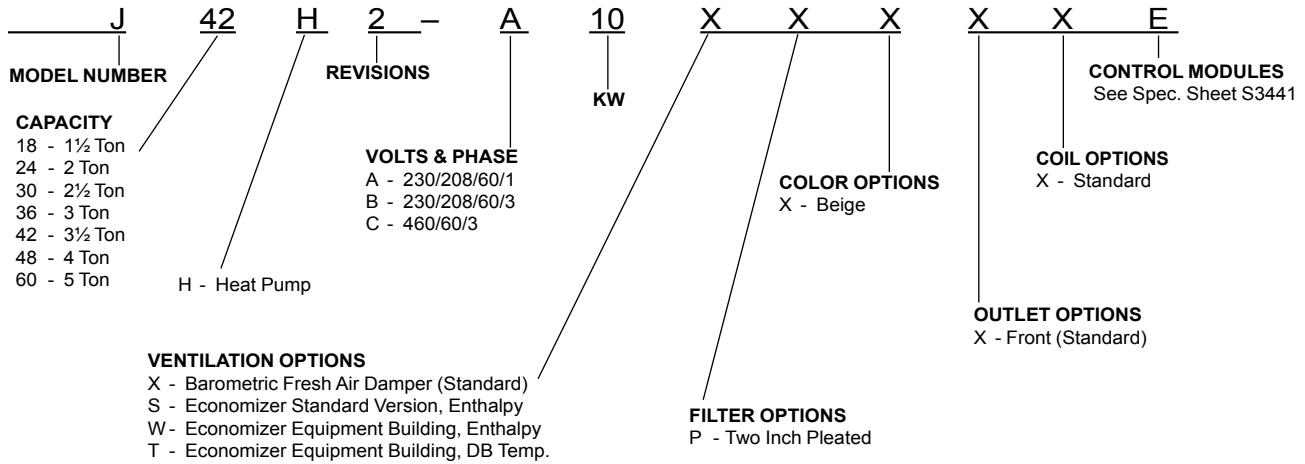

**NOTE:** Vent option X is without exhaust capability. May require separate field supplied barometric relief in building. See Table 15 for field installment options.

## SHIPPING DAMAGE

Upon receipt of equipment, the carton should be checked for external signs of shipping damage. If damage is found, the receiving party must contact the last carrier immediately, preferably in writing, requesting inspection by the carrier's agent.

## GENERAL

The equipment covered in this manual is to be installed by trained, experienced service and installation technicians.

The refrigerant system is completely assembled and charged. All internal wiring is complete.

The unit is designed for use with or without duct work. Flanges are provided for attaching the supply and return ducts.

These instructions explain the recommended method to install the air cooled self-contained unit and the electrical wiring connections to the unit.

These instructions and any instructions packaged with any separate equipment required to make up the entire air conditioning system should be carefully read before beginning the installation. Note particularly "Starting Procedure" and any tags and/or labels attached to the equipment.

While these instructions are intended as a general recommended guide, they do not supersede any national and/or local codes in any way. Authorities having jurisdiction should be consulted before the installation is made. See Page 3 for information on codes and standards.

Size of unit for a proposed installation should be based on heat loss/gain calculation made according to methods of Air Conditioning Contractors of America (ACCA). The air duct should be installed in accordance with the Standards of the National Fire Protection Association for the Installation of Air Conditioning and Ventilating Systems of Other Than Residence Type, NFPA No. 90A, and Residence Type Warm Air Heating and Air Conditioning Systems, NFPA No. 90B. Where local regulations are at a variance with instructions, installer should adhere to local codes.

## DUCT WORK

All duct work, supply and return, must be properly sized for the design airflow requirement of the equipment. Air Conditioning Contractors of America (ACCA) is an excellent guide to proper sizing. All duct work or portions thereof not in the conditioned space should be properly insulated in order to both conserve energy and prevent condensation or moisture damage.

Refer to Maximum ESP of operation Electric Heat Tables 12.

Design the duct work according to methods given by the Air Conditioning Contractors of America (ACCA). When duct runs through unheated spaces, it should be insulated with a minimum of one inch of insulation. Use insulation with a vapor barrier on the outside of the insulation. Flexible joints should be used to connect the duct work to the equipment in order to keep the noise transmission to a minimum.

Models J18 & J24 are approved for zero inch clearance to the supply duct. For model series J30, J36, J42, J48 and J60 a 1/4 inch clearance to combustible material for the first three feet of duct attached to the outlet air frame is required. See Wall Mounting Instructions and Figures 3 and 4 for further details.

Ducts through the walls must be insulated and all joints taped or sealed to prevent air or moisture entering the wall cavity.

Some installations may not require any return air duct. A metallic return air grille is required with installations not requiring a return air duct. The spacing between louvers on the grille shall not be larger than 5/8 inch.

Any grille that meets with 5/8 inch louver criteria may be used. It is recommended that Return Air Grille Kit RG2 through RG5 or RFG2 through RFG5 be installed when no return duct is used. Contact distributor or factory for ordering information. If using a return air filter grille, filters must be of sufficient size to allow a maximum velocity of 400 fpm.

*NOTE: If no return air duct is used, applicable installation codes may limit this cabinet to installation only in a single story structure.*

## FILTERS

A 1-inch throwaway filter is standard with each unit. The filter slides into position making it easy to service. This filter can be serviced from the outside by removing the filter access panel. A 1-inch washable filter and 2-inch pleated filter are also available as optional accessories. The internal filter brackets are adjustable to accommodate the 2-inch filter by bending two (2) tabs down on each side of the filter support bracket.

## FRESH AIR INTAKE

All units are built with fresh air inlet slots punched in the service door.

If the unit is equipped with a fresh air damper assembly, the assembly is shipped already attached to the unit. The damper blade is locked in the closed position. To allow the damper to operate, the maximum and minimum blade position stops must be installed. See Figure 1.


All capacity, efficiency and cost of operation information is based upon the fresh air blank-off plate in place and is recommended for maximum energy efficiency.

The blank-off plate is available upon request from the factory and is installed in place of the fresh air damper shipped with each unit.

## CONDENSATE DRAIN

A plastic drain hose extends from the drain pan at the top of the unit down to the unit base. There are openings in the unit base for the drain hose to pass through. In the event the drain hose is connected to a drain system of some type, it must be an open or vented type system to assure proper drainage.

**FIGURE 1  
FRESH AIR DAMPER**

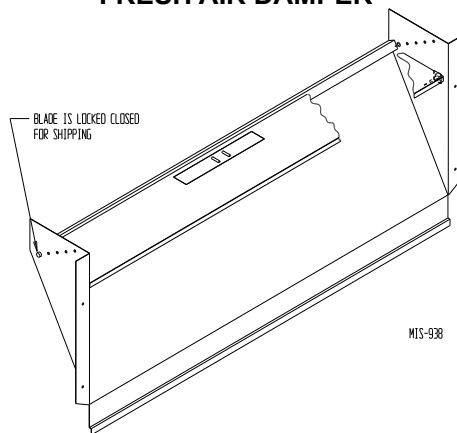

# INSTALLATION INSTRUCTIONS

## WALL MOUNTING INFORMATION

1. Two holes for the supply and return air openings must be cut through the wall as shown in Figure 3A - 3C.
2. On wood frame walls, the wall construction must be strong and rigid enough to carry the weight of the unit without transmitting any unit vibration.
3. Concrete block walls must be thoroughly inspected to insure that they are capable of carrying the weight of the installed unit.



## WARNING

*Failure to provide the 1/4 inch clearance between the supply duct and a combustible surface for the first 3 feet of duct can result in fire causing damage, injury or death.*

## MOUNTING THE UNIT

1. These units are secured by wall mounting brackets which secure the unit to the outside wall surface at both sides. A bottom mounting bracket, attached to skid for shipping, is provided for ease of installation, but is not required.
2. The unit itself is suitable for 0 inch clearance, but the supply air duct flange and the first 3 feet of supply air duct require a minimum of 1/4 inch clearance to combustible material for model series J30, J36, J42, J48 and J60. However, it is generally recommended that a 1-inch clearance is used for ease of installation and maintaining the required clearance to combustible material. See Figure 3 for details on opening sizes.
3. Locate and mark lag bolt locations and bottom mounting bracket location. See Figure 3A - 3C.
4. Mount bottom mounting bracket.
5. Hook top rain flashing, attached to front - right of supply flange for shipping, under back bend of top.
6. Position unit in opening and secure with 5/16 lag bolts; use 7/8 inch diameter flat washers on the lag bolts.
7. Secure rain flashing to wall and caulk across entire length of top. See Figure 3A - 3C.
8. For additional mounting rigidity, the return air and supply air frames or collars can be drilled and screwed or welded to the structural wall itself (depending upon wall construction). Be sure to observe required clearance if combustible wall.
9. On side-by-side installations, maintain a minimum of 20 inches clearance on right side to allow access to control panel and heat strips, and to allow proper airflow to the outdoor coil. Additional clearance may be required to meet local or national codes.

### Clearances Required for Service Access and Adequate Condenser Airflow

| MODELS                 | LEFT SIDE | RIGHT SIDE |
|------------------------|-----------|------------|
| J18H, J24H, J30H, J36H | 15"       | 20"        |
| J42H, J48H, J60H       | 20"       | 20"        |

See J\*\*H Specification S3441.

### Minimum Clearances Required to Combustible Materials

| MODELS           | SUPPLY AIR DUCT FIRST THREE FEET | CABINET |
|------------------|----------------------------------|---------|
| J18H, J24H       | 0                                | 0       |
| J30H, J36H       | 1/4"                             | 0       |
| J42H, J48H, J60H | 1/4"                             | 0       |


**FIGURE 2**

**Dimensions of Basic Unit for Architectural and Installation Requirements (Nominal)**

| MODEL          | WIDTH (W) | DEPTH (D) | HEIGHT (H) | SUPPLY |       | RETURN |       |       |       |       |       |       |       |       |       |      |       |       |       |      |       |      |
|----------------|-----------|-----------|------------|--------|-------|--------|-------|-------|-------|-------|-------|-------|-------|-------|-------|------|-------|-------|-------|------|-------|------|
|                |           |           |            | A      | B     | C      | B     | E     | F     | G     | I     | J     | K     | L     | M     | N    | O     | P     | Q     | R    | S     | T    |
| J18H2<br>J24H2 | 33.300    | 17.125    | 70.563     | 7.88   | 19.88 | 11.88  | 19.88 | 35.00 | 18.50 | 25.75 | 20.56 | 26.75 | 28.06 | 29.25 | 27.00 | 2.63 | 34.13 | 22.06 | 10.55 | 5.00 | 12.00 | 5.00 |
| J30H2<br>J36H2 | 38.200    | 17.125    | 70.563     | 7.88   | 27.88 | 13.88  | 27.88 | 40.00 | 18.50 | 25.75 | 17.93 | 26.75 | 28.75 | 29.25 | 27.00 | 2.63 | 39.13 | 22.75 | 9.14  | 5.00 | 12.00 | 5.00 |
| J42H2<br>J48H2 | 42.075    | 22.432    | 84.875     | 9.88   | 29.88 | 15.88  | 29.88 | 43.88 | 19.10 | 31.66 | 30.00 | 32.68 | 26.94 | 34.69 | 32.43 | 3.37 | 43.00 | 23.88 | 10.00 | 1.44 | 16.00 | 1.88 |
| J60H2          | 42.075    | 22.432    | 94.875     | 9.88   | 29.88 | 15.88  | 29.88 | 43.88 | 13.56 | 41.66 | 30.00 | 42.68 | 36.94 | 44.69 | 42.43 | 3.37 | 43.00 | 33.88 | 10.00 | 1.44 | 16.00 | 1.88 |

All dimensions are in inches. Dimensional drawings are not to scale.


**J\*\*H  
RIGHT  
UNIT**

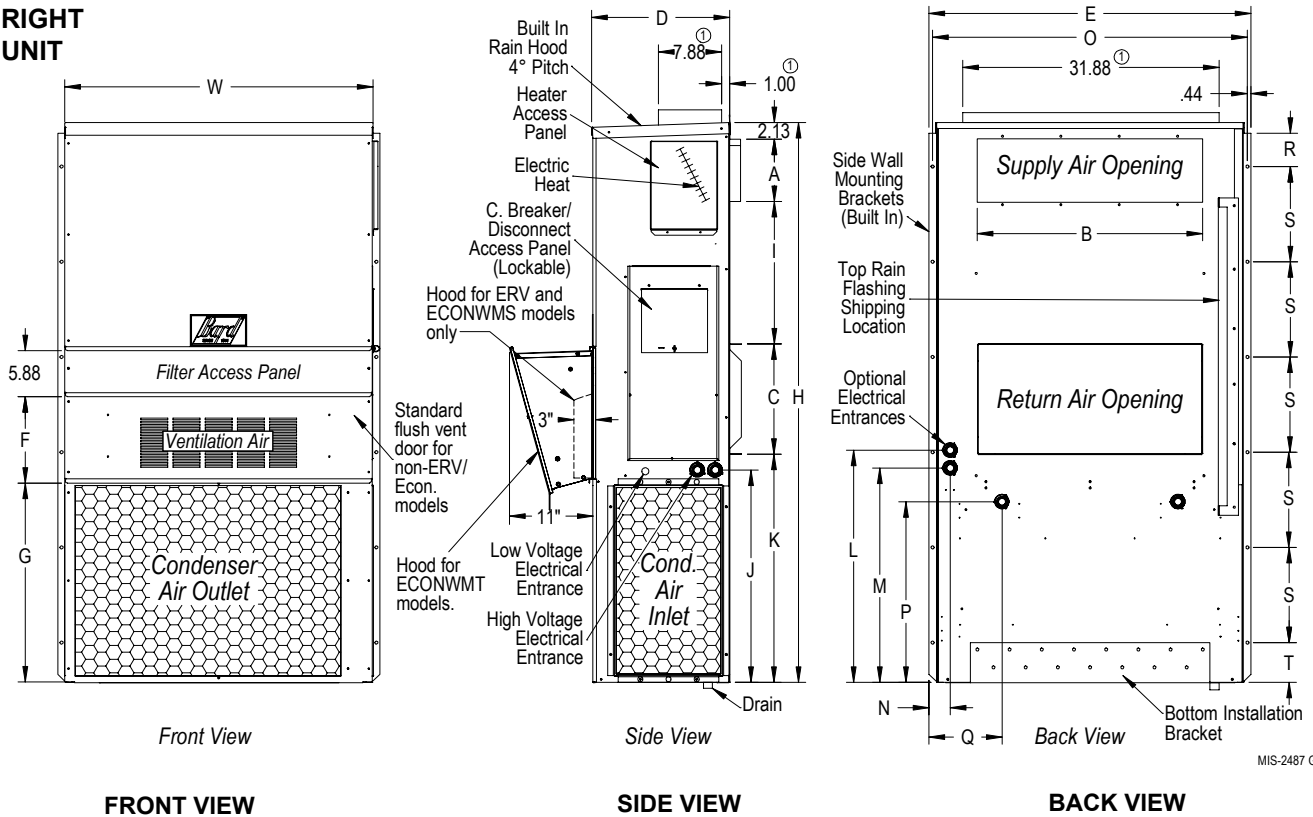

MIS-2487 G

\*Optional top outlet (factory installed only) for J30H and J36H models only.

**FIGURE 3A  
J18H, J24H  
MOUNTING INSTRUCTIONS**

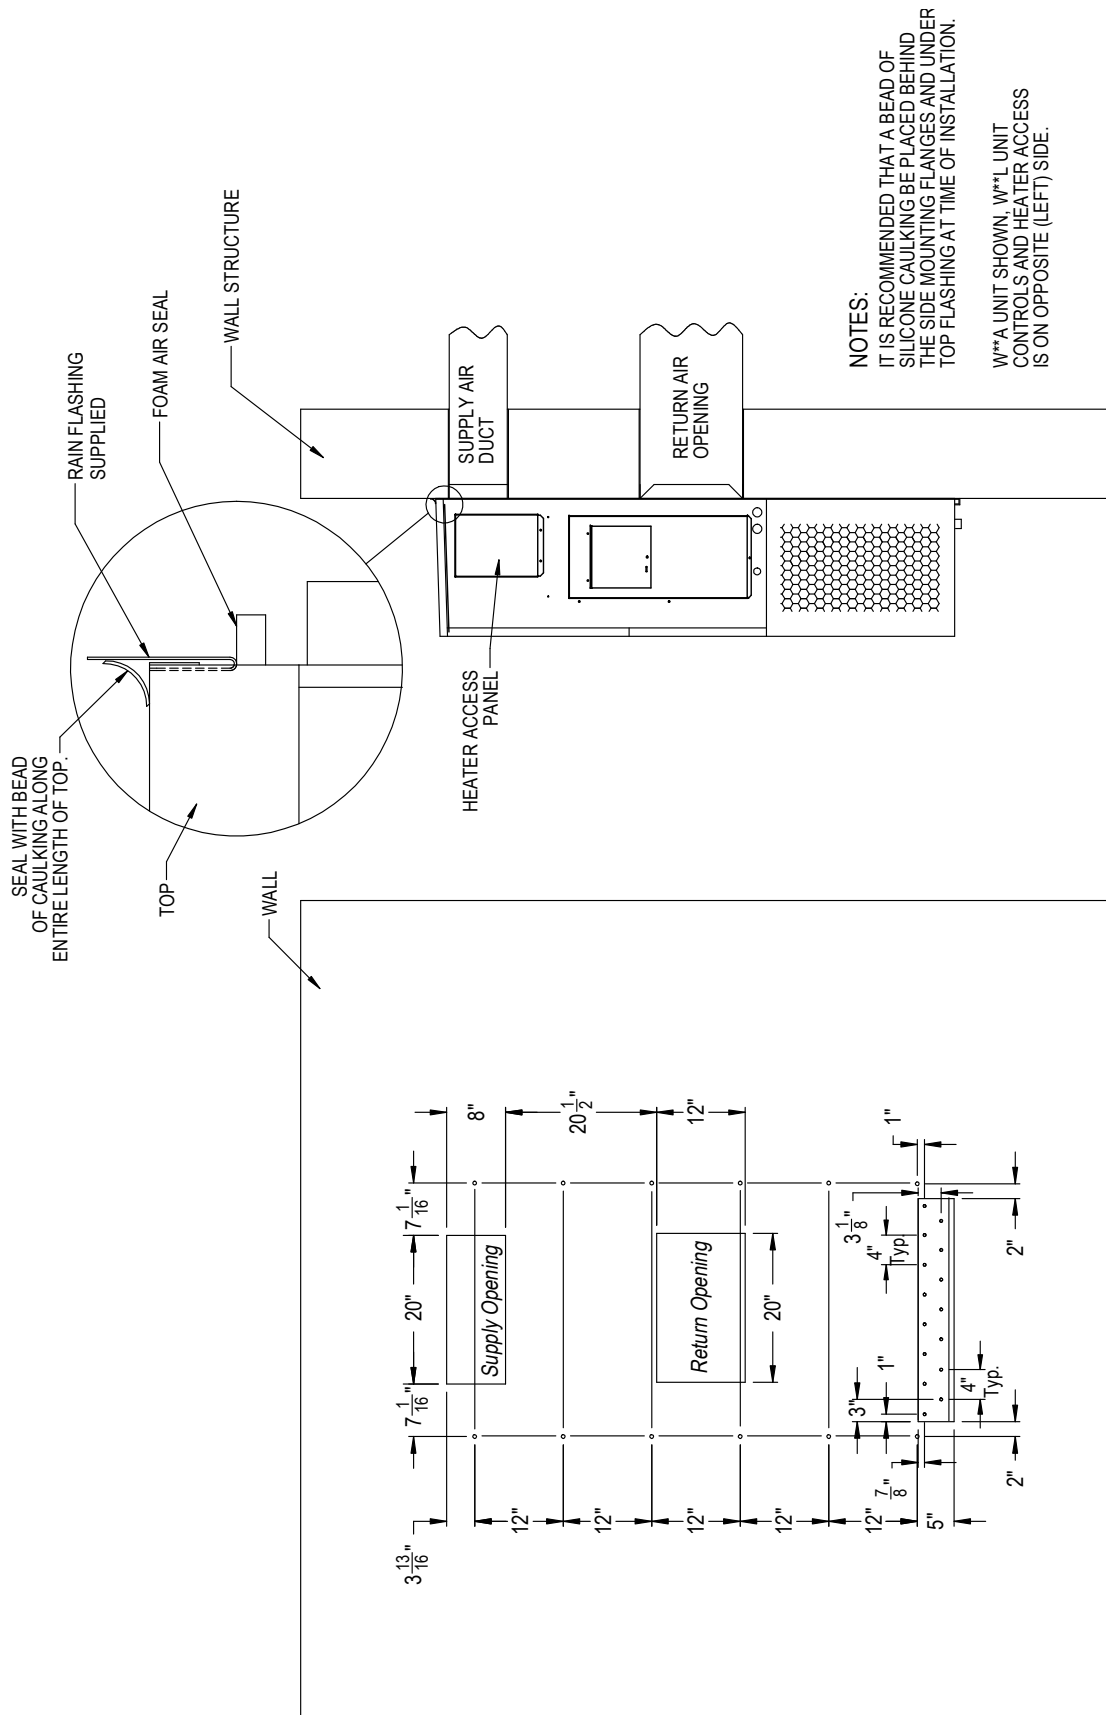

**NOTES:**  
IT IS RECOMMENDED THAT A BEAD OF SILICONE CAULKING BE PLACED BEHIND THE SIDE MOUNTING FLANGES AND UNDER TOP FLASHING AT TIME OF INSTALLATION.  
W\*\*A UNIT SHOWN, W\*\*L UNIT CONTROLS AND HEATER ACCESS IS ON OPPOSITE (LEFT) SIDE.

MIS-3157



*Right Side View*

*Wall Opening and Hole Location View*




**FIGURE 3B  
J30H, J36H  
MOUNTING INSTRUCTIONS**

|   | A      | B     | C     | D       | E      |
|---|--------|-------|-------|---------|--------|
| REQUIRED DIMENSIONS TO MAINTAIN 1/4" MIN. CLEARANCE FROM COMBUSTIBLE MATERIALS      | 28 3/8 | 8 3/8 | 5 3/8 | 3 11/16 | 17 5/8 |
| REQUIRED DIMENSIONS TO MAINTAIN RECOMMENDED 1" CLEARANCE FROM COMBUSTIBLE MATERIALS | 29 7/8 | 9 7/8 | 4 5/8 | 4 7/16  | 16 7/8 |

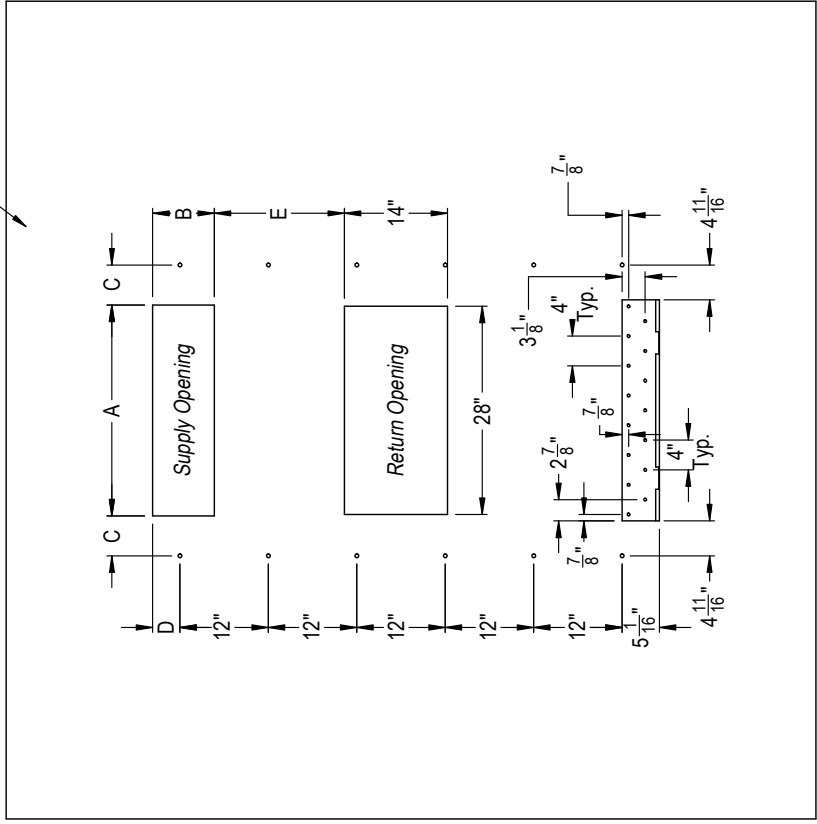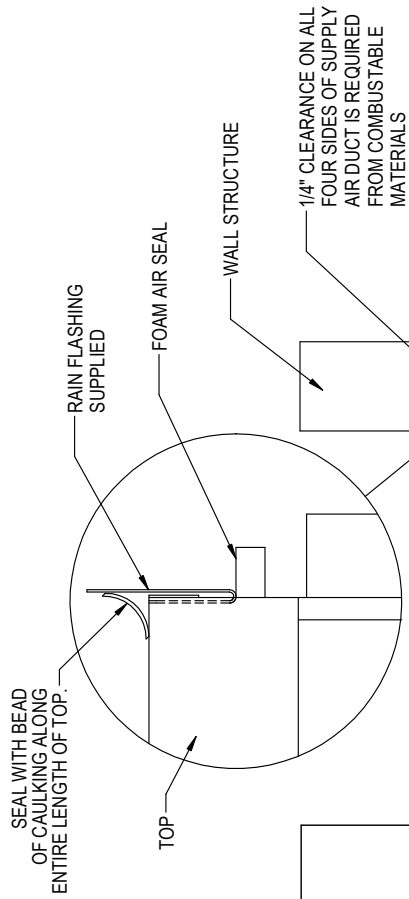


Wall Opening and Hole Location View

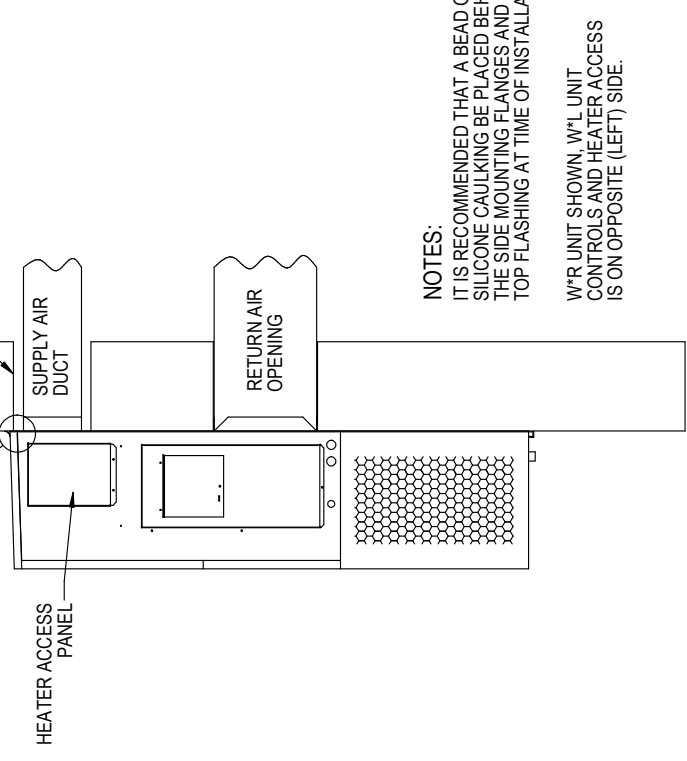


Right Side View

**NOTES:**  
IT IS RECOMMENDED THAT A BEAD OF SILICONE CAULKING BE PLACED BEHIND THE SIDE MOUNTING FLANGES AND UNDER TOP FLASHING AT TIME OF INSTALLATION.  
W/R UNIT SHOWN, W/L UNIT CONTROLS AND HEATER ACCESS IS ON OPPOSITE (LEFT) SIDE.

**FIGURE 3C**  
**J42H, J48H, J60H**  
**MOUNTING INSTRUCTIONS**

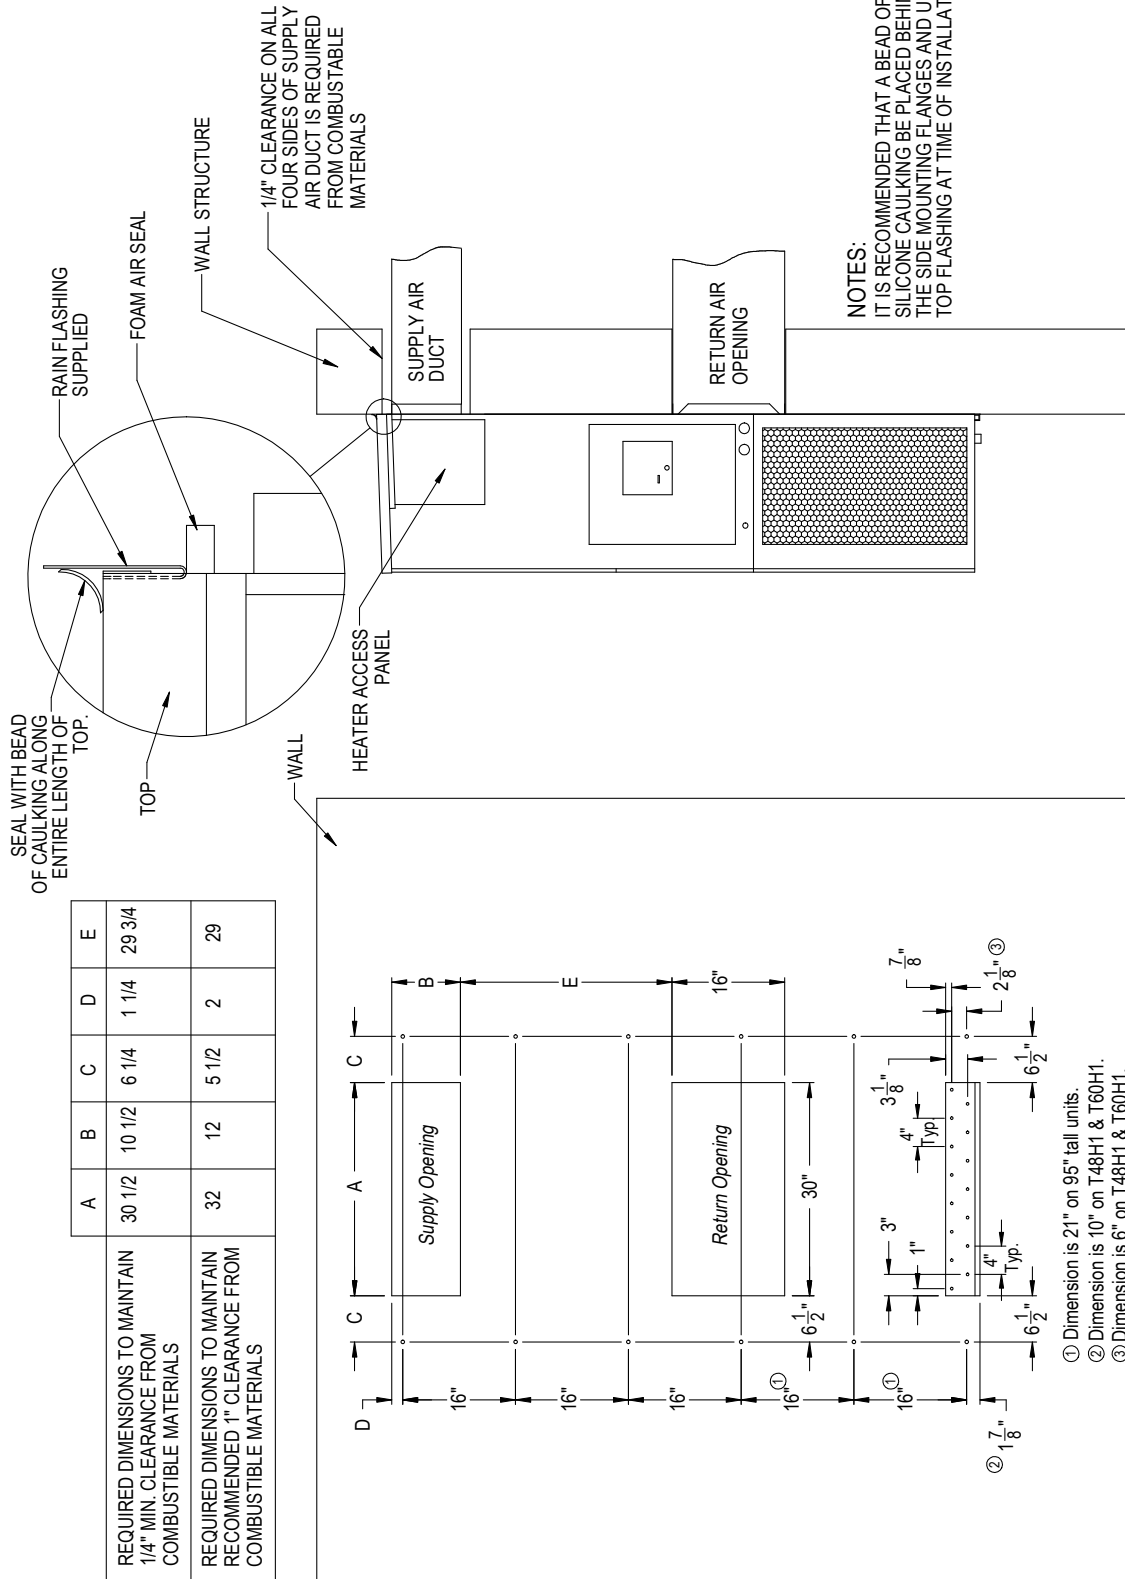

|   | A      | B      | C     | D     | E      |
|---|--------|--------|-------|-------|--------|
| REQUIRED DIMENSIONS TO MAINTAIN 1/4" MIN. CLEARANCE FROM COMBUSTIBLE MATERIALS      | 30 1/2 | 10 1/2 | 6 1/4 | 1 1/4 | 29 3/4 |
| REQUIRED DIMENSIONS TO MAINTAIN RECOMMENDED 1" CLEARANCE FROM COMBUSTIBLE MATERIALS | 32     | 12     | 5 1/2 | 2     | 29     |

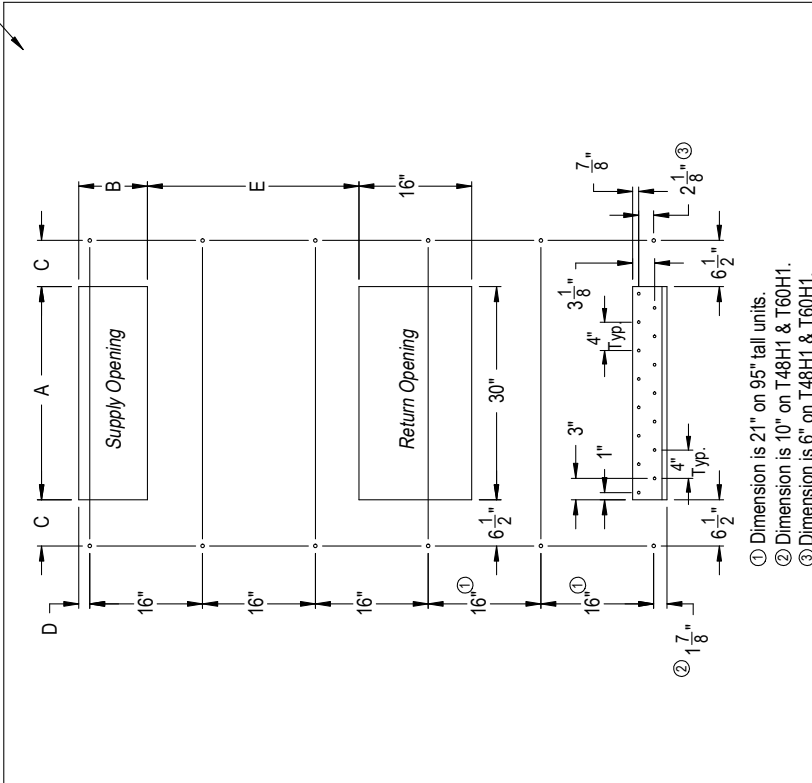


- ① Dimension is 21" on 95" tall units.
- ② Dimension is 10" on T48H1 & T60H1.
- ③ Dimension is 6" on T48H1 & T60H1.

*Wall Opening and Hole Location View*

*Right Side View*

**FIGURE 4**  
**ELECTRIC HEAT CLEARANCE**  
**J30H, J36H, J42H, J48H, J60H**

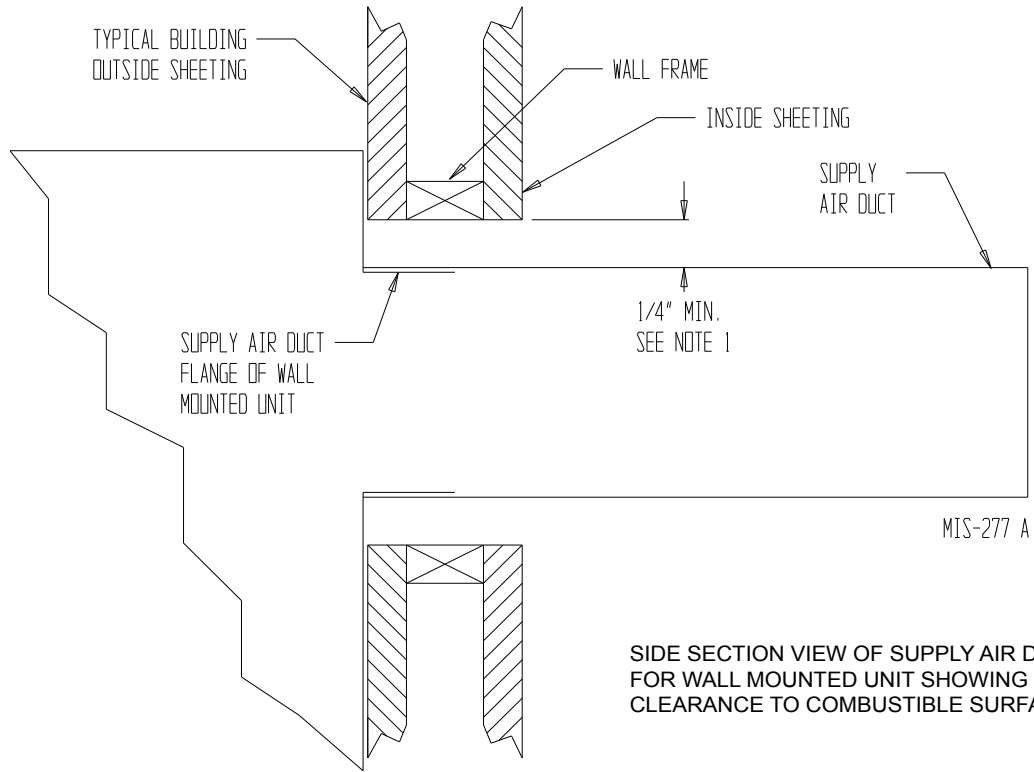

SIDE SECTION VIEW OF SUPPLY AIR DUCT FOR WALL MOUNTED UNIT SHOWING 1/4 INCH CLEARANCE TO COMBUSTIBLE SURFACES.

## **WARNING**


A *minimum* of 1/4 inch clearance must be maintained between the supply air duct and combustible materials. This is required for the first 3 feet of ducting.

It is important to insure that the 1/4 inch minimum spacing is maintained at all points.

Failure to do this could result in overheating the combustible material and may result in a fire causing damage, injury or death.


## FIGURE 5 WALL MOUNTING INSTRUCTIONS

SEE FIGURE 3 – MOUNTING INSTRUCTIONS




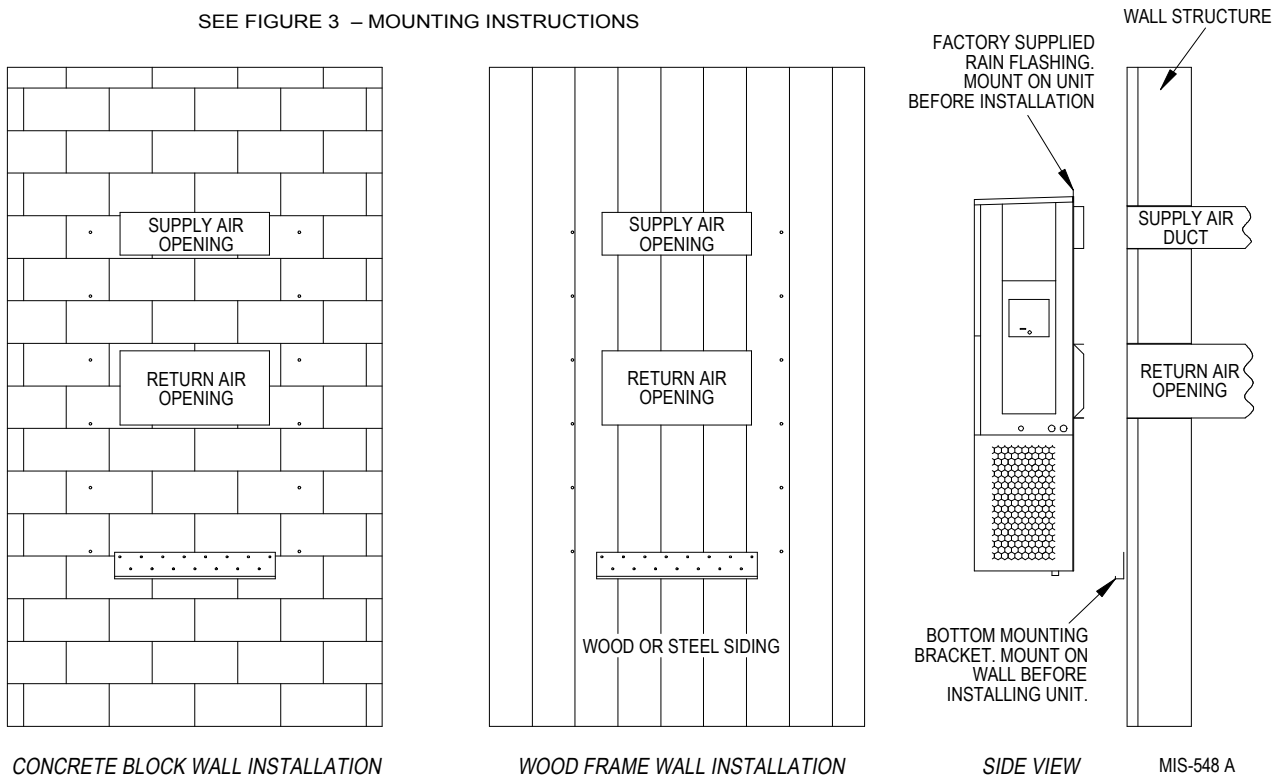


## FIGURE 6 WALL MOUNTING INSTRUCTIONS

SEE UNIT DIMENSIONS, FIGURE 2,  
FOR ACTUAL DIMENSIONS.

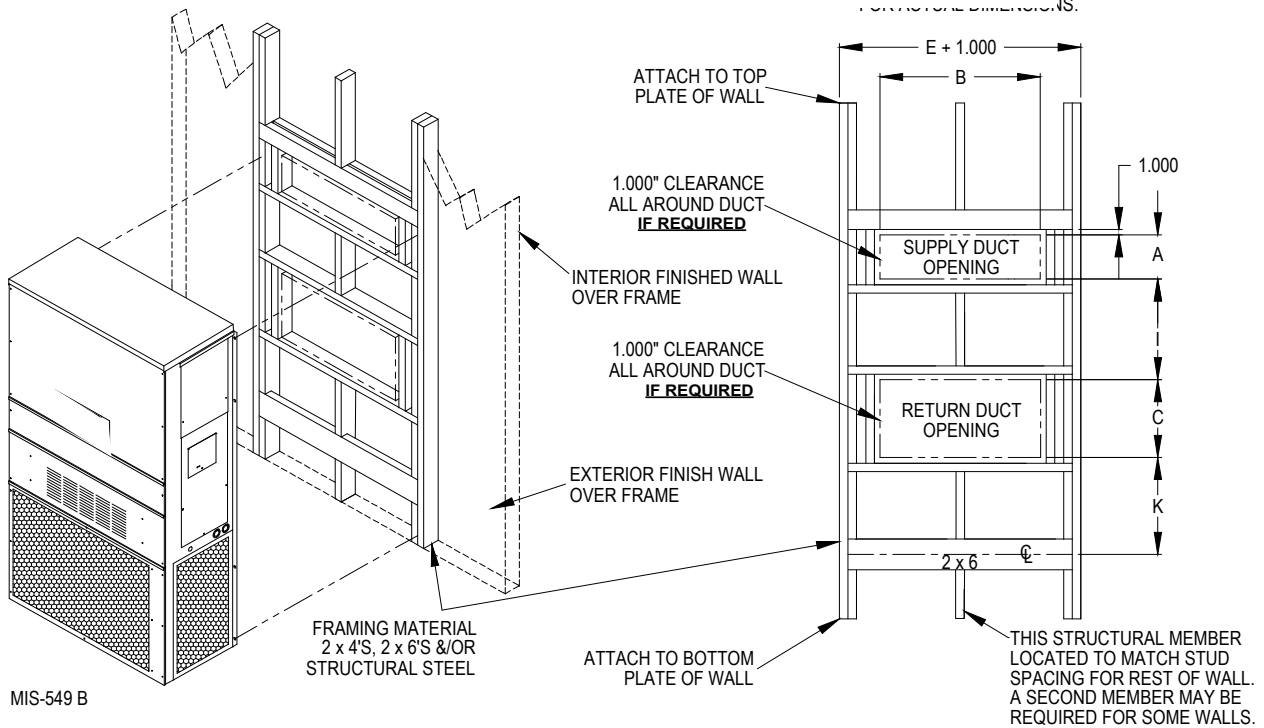

**FIGURE 7  
COMMON WALL MOUNTING INSTALLATIONS**

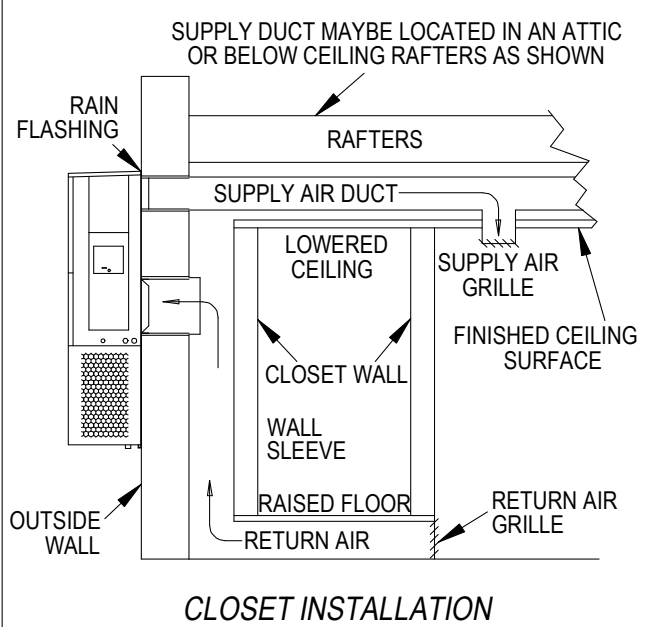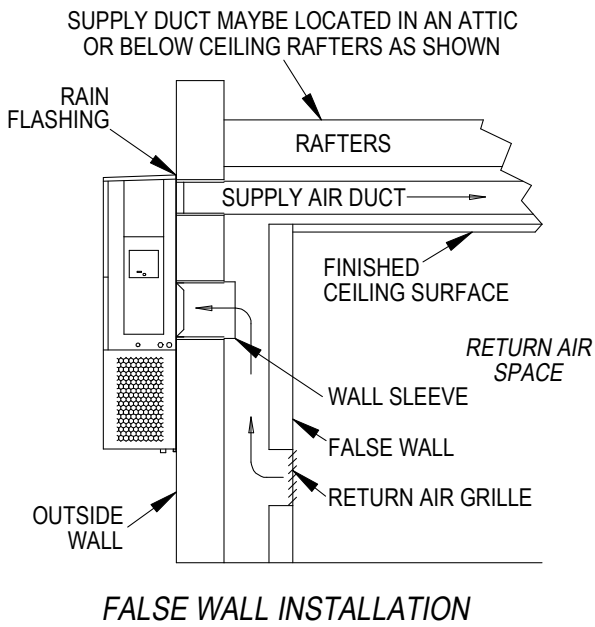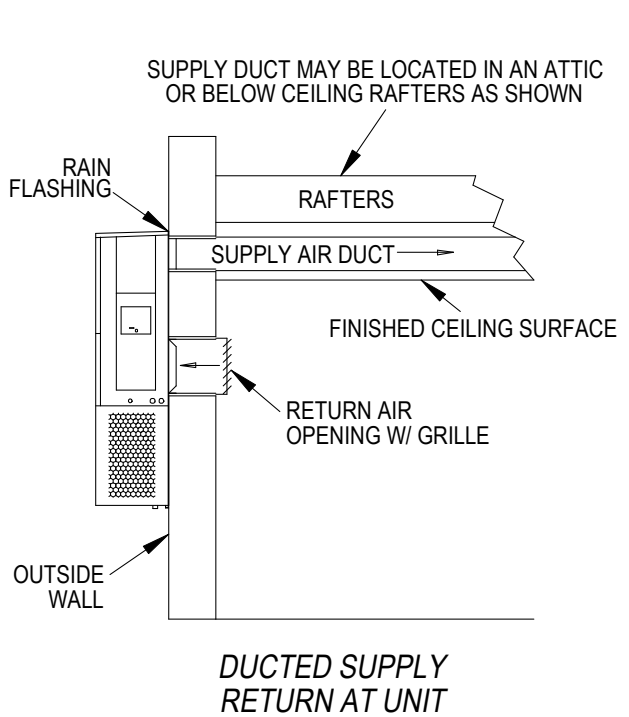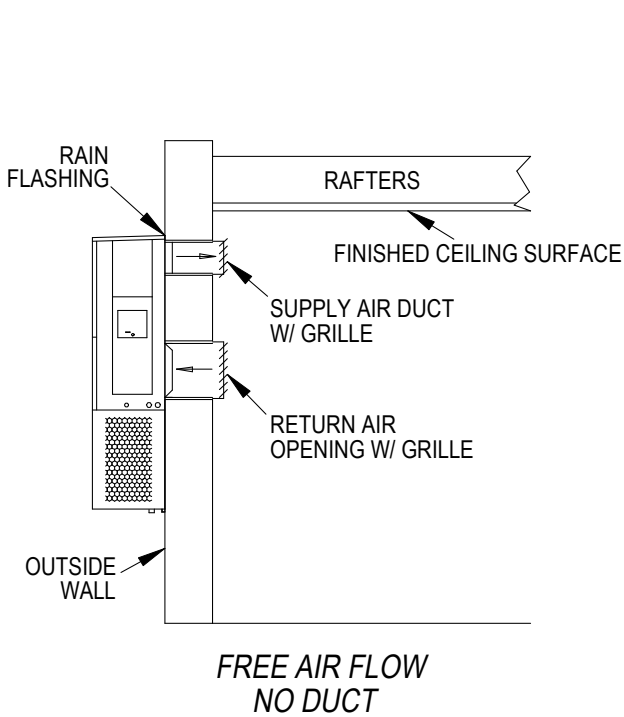

MIS-550 B

***This page intentionally left blank***

|             |              |                |           |
|-------------|--------------|----------------|-----------|
| System Type | Vent         | FAD or No Vent |           |
|             | Vent Code    | X              |           |
|             | Thermostat   | Programmable   |           |
|             | Model Series | No             | Yes       |
| Heat Pump   | J**H         | Diagram 1      | Diagram 2 |

## WIRING – MAIN POWER

Refer to the unit rating plate for wire sizing information and maximum fuse or “HACR” type circuit breaker size. Each outdoor unit is marked with a “Minimum Circuit Ampacity”. This means that the field wiring used must be sized to carry that amount of current. Depending on the installed KW of electric heat, there may be two field power circuits required. If this is the case, the unit serial plate will so indicate. All models are suitable only for connection with copper wire. Each unit and/or wiring diagram will be marked “Use Copper Conductors Only”. These instructions **must be** adhered to. Refer to the National Electrical Code (NEC) for complete current carrying capacity data on the various insulation grades of wiring material. All wiring must conform to NEC and all local codes.

The electrical data lists fuse and wire sizes (75°C copper) for all models including the most commonly used heater sizes. Also shown are the number of field power circuits required for the various models with heaters.

The unit rating plate lists a “Maximum Time Delay Relay Fuse” or “HACR” type circuit breaker that is to be used with the equipment. The correct size must be used for proper circuit protection and also to assure that there will be no nuisance tripping due to the momentary high starting current of the compressor motor.

The disconnect access door on this unit may be locked to prevent unauthorized access to the disconnect. To convert for the locking capability, bend the tab located in the bottom left-hand corner of the disconnect opening under the disconnect access panel straight out. This tab will now line up with the slot in the door. When shut, a padlock may be placed through the hole in the tab preventing entry.

See “Start Up” section for important information on three phase scroll compressor start ups.

See Table 9 for Electrical Specifications.

**TABLE 3  
THERMOSTAT WIRE SIZE**

| Transformer VA | FLA | Wire Gauge | Maximum Distance in Feet |
|----------------|-----|------------|--------------------------|
| 55             | 2.3 | 20 gauge   | 45                       |
|                |     | 18 gauge   | 60                       |
|                |     | 16 gauge   | 100                      |
|                |     | 14 gauge   | 160                      |
|                |     | 12 gauge   | 250                      |

**TABLE 1  
DIAGRAM TO USE WITH UNIT & VENTS**

## WIRING – LOW VOLTAGE WIRING

230/208V, 1 phase and 3 phase equipment contain dual primary voltage transformers. All equipment leaves the factory wired on 240V tap. For 208V operation, reconnect from 240V to 208V tap. The acceptable operating voltage range for the 240V and 208V taps are:

**TABLE 2  
OPERATING VOLTAGE RANGE**

| TAP  | RANGE     |
|------|-----------|
| 240V | 253 - 216 |
| 208V | 220 - 187 |

*NOTE: The voltage should be measured at the field power connection point in the unit and while the unit is operating at full load (maximum amperage operating condition).*

An 18 gauge copper, color-coded thermostat cable is recommended. The connection points are shown in this Manual. See Table above.

### Low Voltage Connection

These units use a grounded 24-volt AC low voltage circuit.

The “R” terminal is the *hot* terminal and the “C” terminal is *grounded*.

“G” terminal is the *fan input*.

“Y” terminal is the *compressor input*.

“B” terminal is the *reversing valve input*. The reversing valve must be energized for heating mode.

“R” terminal is the *24 VAC hot*.

“C” terminal is the *24 VAC grounded*.

“L” terminal is *compressor lockout output*. This terminal is activated on a high or low pressure trip by the electronic heat pump control. This is a 24 VAC output.

“W2” terminal is *second stage heat* (if equipped).

“W3” terminal is *spare*; use as needed.

“DH” terminal is used if outdoor thermostat installed.


“OI” terminal is the *ventilation input*. This terminal energizes any factory installed ventilation option.

“E” terminal is the *emergency heat input*. This terminal energizes the emergency heat relay.

### LOW VOLTAGE CONNECTIONS FOR DDC CONTROL

|   |                      |
|---|----------------------|
| Fan Only                                    | Energize G           |
| Cooling Mode                                | Energize Y, G        |
| Heat Pump Heating                           | Energize Y, G, B     |
| 2nd Stage Heating w/Heat Pump (if employed) | Energize G, W2, Y, B |
| Ventilation                                 | Energize G, OI       |
| Emergency Heat                              | Energize B, W2, E, G |


**DIAGRAM 1**  
**BASIC HEAT PUMP WITH OPTIONAL ELECTRIC HEAT**  
**NO ECONOMIZER**

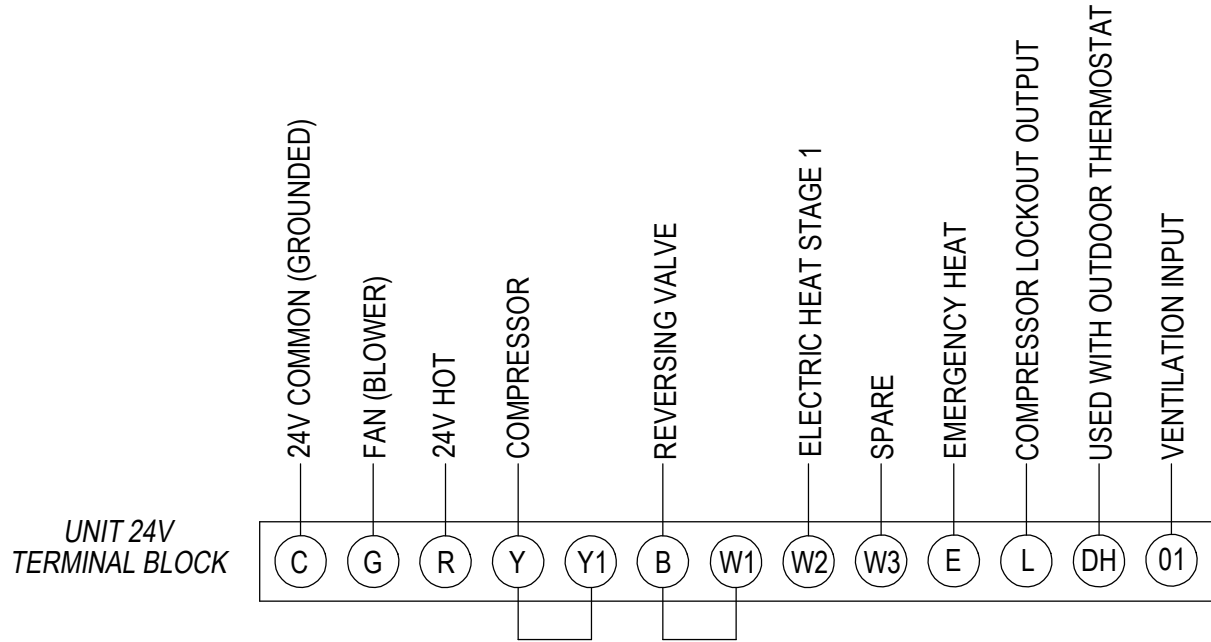

MIS-2977



**DIAGRAM 2  
BASIC HEAT PUMP WITH OPTIONAL ELECTRIC HEAT  
WITH ECONWM\* ECONOMIZER**

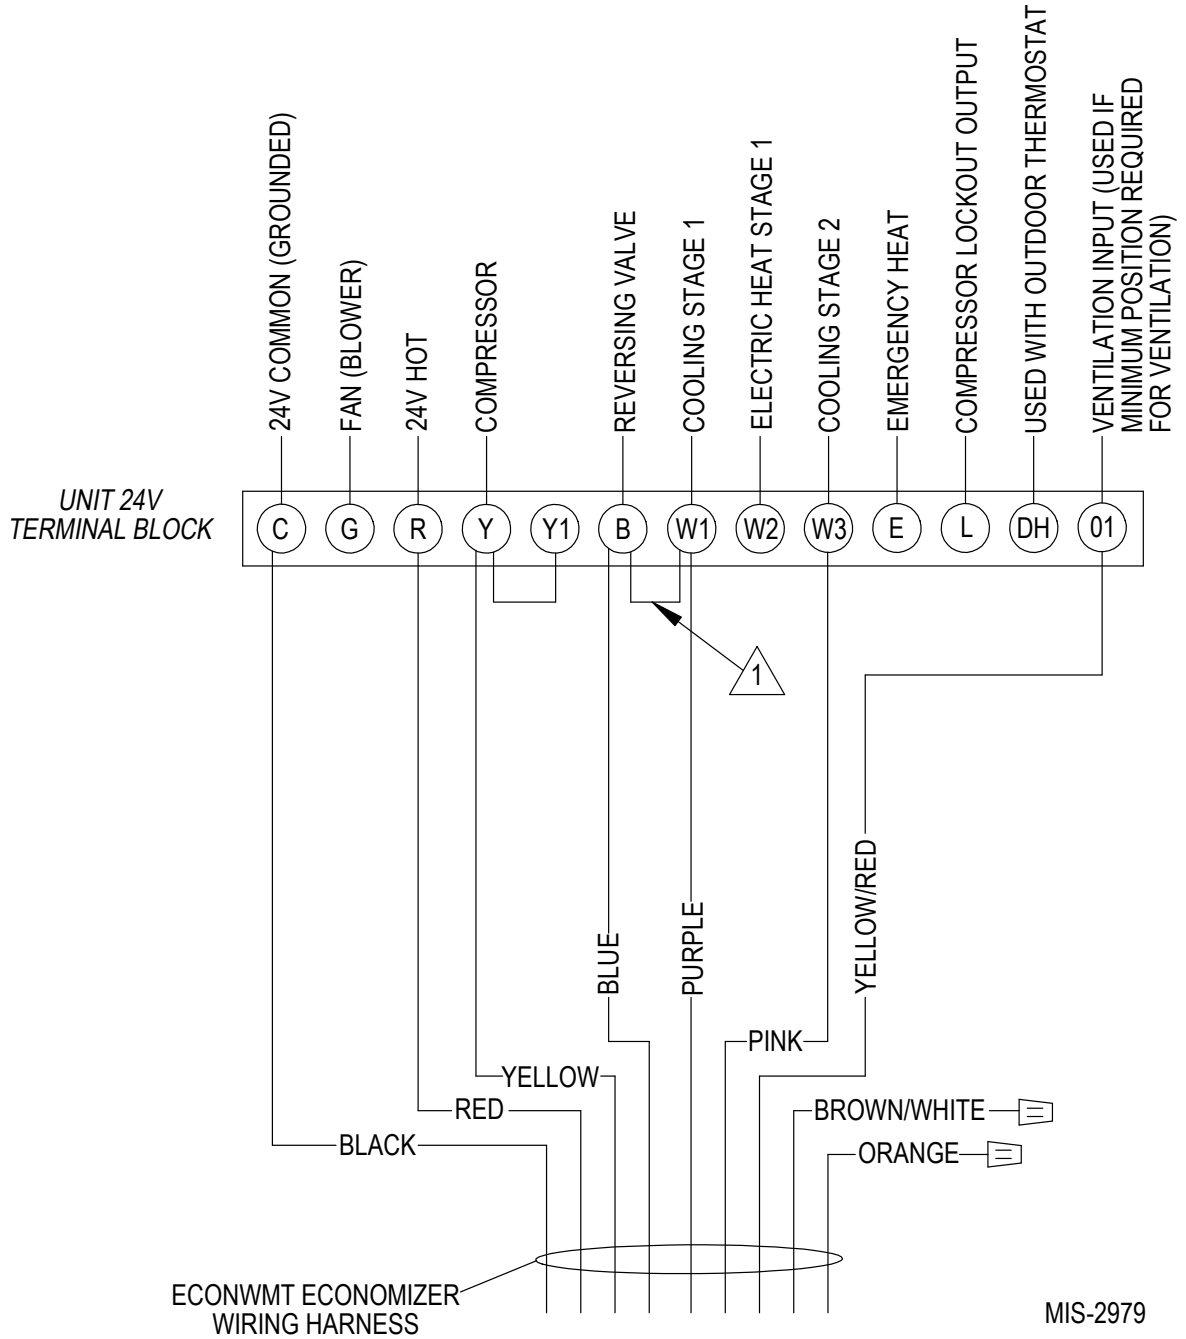

 REMOVE FACTORY INSTALLED JUMPER.

# START UP

---

## THESE UNITS REQUIRE R-410A REFRIGERANT AND POLYOL ESTER OIL.

### GENERAL:

1. Use separate service equipment to avoid cross contamination of oil and refrigerants.
2. Use recovery equipment rated for R-410A refrigerant.
3. Use manifold gauges rated for R-410A (800 psi/250 psi low).
4. R-410A is a binary blend of HFC-32 and HFC-125.
5. R-410A is nearly azeotropic - similar to R-22 and R-12. Although nearly azeotropic, charge with liquid refrigerant.
6. R-410A operates at 40-70% higher pressure than R-22, and systems designed for R-22 cannot withstand this higher pressure.
7. R-410A has an ozone depletion potential of zero, but must be reclaimed due to its global warming potential.
8. R-410A compressors use Polyol Ester oil.
9. Polyol Ester oil is hygroscopic; it will rapidly absorb moisture and strongly hold this moisture in the oil.
10. A liquid line dryer must be used - even a deep vacuum will not separate moisture from the oil.
11. Limit atmospheric exposure to 15 minutes.
12. If compressor removal is necessary, always plug compressor immediately after removal. Purge with small amount of nitrogen when inserting plugs.

### TOPPING OFF SYSTEM CHARGE

If a leak has occurred in the system, Solair recommends reclaiming, evacuating (see criteria above), and charging to the nameplate charge. If done correctly, topping off the system charge can be done without problems.

With R-410A, there are no significant changes in the refrigerant composition during multiple leaks and recharges. R-410A refrigerant is close to being an azeotropic blend (it behaves like a pure compound or single component refrigerant). The remaining refrigerant charge, in the system, may be used after leaks have occurred and then “top-off” the charge by utilizing the charging charts on the inner control panel cover as a guideline.

REMEMBER: When adding R-410A refrigerant, it must come out of the charging cylinder/tank as a liquid to avoid any fractionation, and to insure optimal system performance. Refer to instructions for the cylinder that is being utilized for proper method of liquid extraction.



### SAFETY PRACTICES:

1. Never mix R-410A with other refrigerants.
2. Use gloves and safety glasses, Polyol Ester oils can be irritating to the skin, and liquid refrigerant will freeze the skin.
3. Never use air and R-410A to leak check; the mixture may become flammable.
4. Do not inhale R-410A – the vapor attacks the nervous system, creating dizziness, loss of coordination and slurred speech. Cardiac irregularities, unconsciousness and ultimate death can result from breathing this concentration.
5. Do not burn R-410A. This decomposition produces hazardous vapors. Evacuate the area if exposed.
6. Use only cylinders rated DOT4BA/4BW 400.
7. Never fill cylinders over 80% of total capacity.
8. Store cylinders in a cool area, out of direct sunlight.
9. Never heat cylinders above 125°F.
10. Never trap liquid R-410A in manifold sets, gauge lines or cylinders. R-410A expands significantly at warmer temperatures. Once a cylinder or line is full of liquid, any further rise in temperature will cause it to burst.

---

# START UP (Continued)

## IMPORTANT INSTALLER NOTE

For improved start up performance wash the indoor coil with a dish washing detergent.

## HIGH & LOW PRESSURE SWITCH

All J\*\*H wall mounted air conditioner series models are supplied with a remote reset for the high and low pressure switch. If tripped, this pressure switch may be reset by turning the thermostat off then back on again.

## THREE PHASE SCROLL COMPRESSOR START UP INFORMATION

Scroll compressors, like several other types of compressors, will only compress in one rotational direction. Direction of rotation is not an issue with single phase compressors since they will always start and run in the proper direction.

However, three phase compressors will rotate in either direction depending upon phasing of the power. Since there is a 50-50 chance of connecting power in such a way as to cause rotation in the reverse direction, verification of proper rotation must be made. Verification of proper rotation direction is made by observing that suction pressure drops and discharge pressure rises when the compressor is energized. Reverse rotation also results in an elevated sound level over that with correct rotation, as well as substantially reduced current draw compared to tabulated values.

Verification of **proper rotation** must be made at the time the equipment is put into service. If improper rotation is corrected at this time, there will be no negative impact on the durability of the compressor. However, reverse operation for over one hour may have a negative impact on the bearing due to oil pump out.

*NOTE: If compressor is allowed to run in reverse rotation for several minutes, the compressor's internal protector will trip.*

All three phase ZP compressors are wired identically internally. As a result, once the correct phasing is determined for a specific system or installation, connecting properly phased power leads to the same Fusite terminal should maintain proper rotation direction.

The direction of rotation of the compressor may be changed by reversing any two line connections to the unit.

## PHASE MONITOR

All units with three phase scroll compressors are equipped with a 3 phase line monitor to prevent compressor damage due to phase reversal.

The phase monitor in this unit is equipped with two LEDs. If the Y signal is present at the phase monitor and phases are correct the green LED will light.

If phases are reversed, the red fault LED will be lit and compressor operation is inhibited.

If a fault condition occurs, reverse two of the supply leads to the unit. ***Do not reverse any of the unit factory wires as damage may occur.***

## CONDENSER FAN OPERATION

*Applies to J42, J48 and J60 models only.* The condenser fan motor on 230/208 volt, one and three phase, 60 HZ units is a two-speed motor that comes factory wired on high speed for peak performance. If ambient conditions permit, it can be reconnected to low speed (red wire) for lower sound level. See wiring diagram.

## SERVICE HINTS

1. Caution owner/operator to maintain clean air filters at all times. Also, not to needlessly close off supply and return air registers. This reduces airflow through the system, which shortens equipment service life as well as increasing operating costs.
2. Check all power fuses or circuit breakers to be sure they are the correct rating.
3. Periodic cleaning of the outdoor coil to permit full and unrestricted airflow circulation is essential.

## SEQUENCE OF OPERATION

**COOLING** – Circuit R-Y makes at thermostat pulling in compressor contactor, starting the compressor and outdoor motor. The G (indoor motor) circuit is automatically completed on any call for cooling operation or can be energized by manual fan switch on subbase for constant air circulation.

**HEATING** – A 24V solenoid coil on reversing valve controls heating cycle operation. Two thermostat options, one allowing “Auto” changeover from cycle to cycle and the other constantly energizing solenoid coil during heating season, and thus eliminating pressure equalization noise except during defrost, are to be used. On “Auto” option a circuit is completed from R-W1 and R-Y on each heating “on” cycle, energizing reversing valve solenoid and pulling in compressor contactor starting compressor and outdoor motor. R-G also make starting indoor blower motor. Heat pump heating cycle now in operation. The second option has no “Auto” changeover position, but instead energizes the reversing valve solenoid constantly whenever the system switch on subbase is placed in “Heat” position, the “B” terminal being constantly energized from R. A Thermostat demand for heat completes R-Y circuit, pulling in compressor contactor starting compressor and outdoor motor. R-G also make starting indoor blower motor.

## PRESSURE SERVICE PORTS

High and low pressure service ports are installed on all units so that the system operating pressures can be observed. Pressure tables can be found later in the manual covering all models. It is imperative to match the correct pressure table to the unit by model number. See Tables 7 & 8.

## DEFROST CYCLE

The defrost cycle is controlled by temperature and time on the solid state heat pump control.

When the outdoor temperature is in the lower 40°F temperature range or colder, the outdoor coil temperature is 32°F or below. This coil temperature is sensed by the coil temperature sensor mounted near the bottom of the outdoor coil. Once coil temperature reaches 30°F or below, the coil temperature sensor sends a signal to the control logic of the heat pump control and the defrost timer will start accumulating run time.

After 30, 60 or 90 minutes of heat pump operation at 30°F or below, the heat pump control will place the system in the defrost mode.

During the defrost mode, the refrigerant cycle switches back to the cooling cycle, the outdoor motor stops, electric heaters are energized, and hot gas passing through the outdoor coil melts any accumulated frost. When the temperature rises to approximately 57°F, the coil temperature sensor will send a signal to the heat pump control which will return the system to heating operations automatically.

If some abnormal or temporary condition such as a high wind causes the heat pump to have a prolonged defrost cycle, the heat pump control will restore the system to heating operation automatically after 8 minutes.

The heat pump defrost control board has an option of 30, 60 or 90-minute setting. By default, this unit is shipped from the factory with the defrost time on the 60 minute pin. If circumstances require a change to another time, remove the wire from the 60-minute terminal and reconnect to the desired terminal. Refer to Figure 8.

There is a cycle speed up jumper on the control. This can be used for testing purposes to reduce the time between defrost cycle operation without waiting for time to elapse.

Use a small screwdriver or other metallic object, or another ¼ inch QC, to short between the *SPEEDUP* terminals to accelerate the HPC timer and initiate defrost.

Be careful not to touch any other terminals with the instrument used to short the *SPEEDUP* terminals. It may take up to 10 seconds with the *SPEEDUP* terminals shorted for the speedup to be completed and the defrost cycle to start.

***As soon as the defrost cycle kicks in remove the shorting instrument from the SPEEDUP terminals.*** Otherwise the timing will remain accelerated and run through the 1-minute minimum defrost length sequence in a matter of seconds and will automatically terminate the defrost sequence.

There is an initiate defrost jumper (sen jump) on the control that can be used at any outdoor ambient during the heating cycle to simulate a 0° coil temperature.

This can be used to check defrost operation of the unit without waiting for the outdoor ambient to fall into the defrost region.

By placing a jumper across the *SEN JMP* terminals (a ¼ inch QC terminal works best) the defrost sensor mounted on the outdoor coil is shunted out & will activate the timing circuit. This permits the defrost cycle to be checked out in warmer weather conditions without the outdoor temperature having to fall into the defrost region.

In order to terminate the defrost test the *SEN JMP* jumper must be removed. If left in place too long, the compressor could stop due to the high pressure control opening because of high pressure condition created by operating in the cooling mode with outdoor fan off. Pressure will rise fairly fast as there is likely no actual frost on the outdoor coil in this artificial test condition.


There is also a 5-minute compressor time delay function built into the HPC. This is to protect the compressor from short cycling conditions. The board's LED will have a fast blink rate when in the compressor time delay. In some instances, it is helpful to the service technician to override or speed up this timing period, and shorting out the *SPEEDUP* terminals for a few seconds can do this.

**Low Pressure Switch Bypass Operation** - The control has a selectable (SW1) low pressure switch bypass set up to ignore the low pressure switch input during the first (30, 60, 120 or 180 seconds) of “Y” operation.

After this period expires, the control will then monitor the low pressure switch input normally to make sure that the switch is closed during “Y” operation.

**High Pressure Switch Operation** - The control has a built-in lockout system that allows the unit to have the high pressure switch trip up to two times in one hour and only encounter a “soft” lockout. A “soft” lockout shuts the compressor off and waits for the pressure switch to reset, which at that point then allows the compressor to be restarted as long as the 5-minute short cycle timer has run out. If the high pressure switch trips a third time within one hour, the unit is in “hard” lockout indicating something is certainly wrong and it will not restart itself.

**FIGURE 8  
DEFROST CONTROL BOARD**

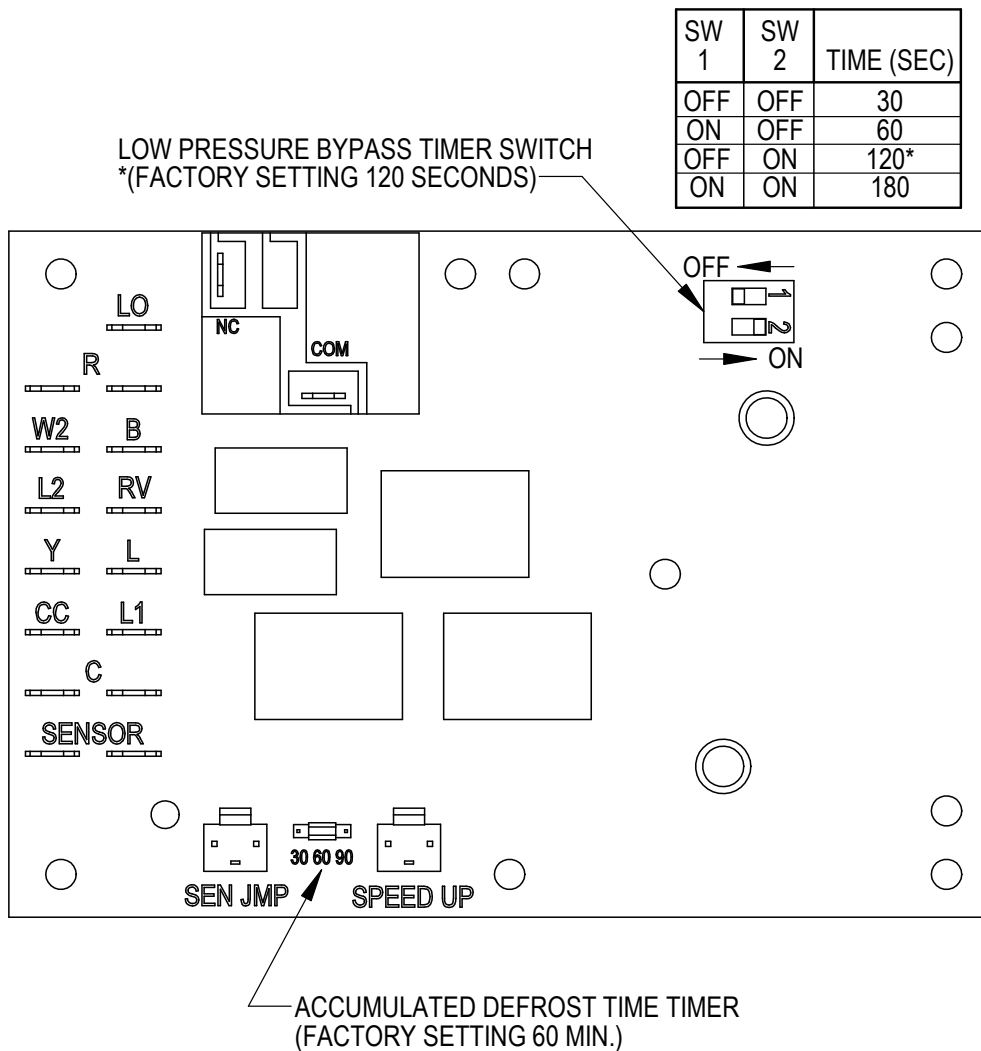

MIS-2668 A

# TROUBLESHOOTING

## SOLID STATE HEAT PUMP CONTROL TROUBLESHOOTING PROCEDURE

- NOTE:** A thorough understanding of the defrost cycle sequence is essential. Review that section earlier in this manual prior to troubleshooting the control. Turn on AC power supply to unit.
- Turn thermostat blower switch to “fan on” – the indoor blower should start. (If it doesn’t, troubleshoot indoor unit and correct problem.)
- Turn thermostat blower to “auto” position. Indoor blower should stop. **NOTE:** Many models have a 1-minute blower time delay on “off” command; wait for this to time-out.
- Set system switch to “heat” or “cool”. Adjust thermostat to call for heat or cool. The indoor blower, compressor and outdoor fan should start.

*NOTE: If there was no power to 24 volt transformer, the compressor and outdoor fan motor will not start for 5 minutes. This is because of the compressor short cycle protection.*

### LED BLINK CODES

| <u>BLINK</u> | <u>FUNCTION</u>   |
|--------------|---|
| Slow         | Normal function (1.0 sec on/1.0 sec off)                      |
| Fast         | ASCD (Compressor Delay) timer active (0.1 sec on/0.1 sec off) |
| 1            | Low pressure switch failure                                   |
| 2            | High pressure switch failure/“Soft” Lockout                   |
| 3            | Defrost mode active   |
| 4            | High pressure switch failure/“Hard” Lockout                   |

**TABLE 4  
TROUBLESHOOTING**

| Symptom   | Description, Check & Possible Cause  | What & How to Check/Repair  |
|---|--|---|
| Compressor will not start (heating or cooling)                            | <b>1. Check for LED illumination.</b><br>Is there an LED illuminated on the board (flashing)?  | Yes = go to Step #2; No = go to Step #3   |
|   | <b>2. Check for error codes.</b><br>Is the LED flashing a code?                                | Yes = go to Step #4; No = go to Step #8   |
|   | <b>3. Check for power at board.</b><br>Is there 24 volts AC between R and C?                   | Yes = go to Step #13; No = go to Step #9  |
|   | <b>4. Check codes.</b><br>What code is blinking?   | Code "1", go to Step #6; Code "2", go to Step #7; Fast Blink, go to Step #5   |
|   | <b>5. Compressor delay active.</b><br>Wait for 5 minute delay or jump board's "speed up pins". | Check for proper operation; if still needed, go back to Step #1   |
|   | <b>6. Low pressure fault.</b>  | Check wiring circuit and unit pressures.  |
|   | <b>7. High pressure fault.</b>   | Check wiring circuit and unit pressures.  |
|   | <b>8. Check for Compressor input signal.</b><br>Is there 24 volts AC between Y and C?          | Yes = go to Step #10; No = go to Step #11   |
|   | <b>9. No power to board.</b>   | The unit either does not have unit voltage, the transformer is bad or the unit wiring is incorrect.   |
|   | <b>10. Check for Compressor output signal.</b><br>Is there 24 volts AC between CC and C?       | Yes = go to Step #12; No = go to Step #13   |
|   | <b>11. No "Y" compressor input signal.</b>   | Check thermostat wiring, incorrect phase of unit (see section on Phase Monitor) and finally unit wiring.  |
|   | <b>12. No "CC" compressor output signal.</b>   | Check compressor contactor for proper operation and finally check compressor.   |
|   | <b>13. Faulty board.</b>   | Replace defrost board.  |
| Fan outdoor motor does not run (cooling or heating except during defrost) | Heat pump control defective  | Check across fan relay on heat pump control. (Com-NC)<br>Replace heat pump control.   |
|   | Motor defective  | Check for open or shorted motor winding. Replace motor.   |
|   | Motor capacitor defective  | Check capacitor rating. Check for open or shorted capacitor. Replace capacitor.   |
| Reversing valve does not energize (heating only)                          | Heat pump control defective  | Check for 24 V between RV-C and B-C.<br>1. Check circuit control wiring.<br>2. Replace heat pump control.   |
|   | Reversing valve solenoid coil defective  | Check for open or shorted coil.<br>Replace solenoid coil.   |
| Unit will not go into defrost (heating only)                              | Temperature sensor or heat pump control defective  | Disconnect temperature sensor from board and jumper across "SPEEDUP" terminals and "SEN JMP" terminals. This should cause the unit to go through a defrost cycle within one minute.<br>1. If unit goes through defrost cycle, replace temperature sensor.<br>2. If unit does not go through defrost cycle, replace heat pump control. |
| Unit will not come out of defrost (heating only)                          | Temperature sensor or heat pump control defective  | Jumper across "SPEEDUP" terminal. This should cause the unit to come out of defrost within one minute.<br>1. If unit goes through defrost cycle, replace temperature sensor.<br>2. If unit does not go through defrost cycle, replace heat pump control.  |

## CHECKING TEMPERATURE SENSOR OUTSIDE UNIT CIRCUIT

1. Disconnect temperature sensor from board and from outdoor coil.
2. Use an ohmmeter and measure the resistance of the sensor. Also use ohmmeter to check for short or open.
3. Check resistance reading to chart of resistance. Use sensor ambient temperature. (Tolerance of part is  $\pm 10\%$ .)
4. If sensor resistance reads very low, then sensor is shorted and will not allow proper operation of the heat pump control.
5. If sensor is out of tolerance, shorted, open or reads very low ohms then it should be replaced.

### TEMPERATURE F VS. RESISTANCE R OF TEMPERATURE SENSOR

| F     | R      | F    | R     | F    | R     | F     | R    |
|-------|--------|------|-------|------|-------|-------|------|
| -25.0 | 196871 | 13.0 | 56985 | 53.0 | 19374 | 89.0  | 7507 |
| -24.0 | 190099 | 14.0 | 55284 | 52.0 | 18867 | 90.0  | 7334 |
| -23.0 | 183585 | 15.0 | 53640 | 53.0 | 18375 | 91.0  | 7165 |
| -22.0 | 177318 | 16.0 | 52051 | 54.0 | 17989 | 92.0  | 7000 |
| -21.0 | 171289 | 17.0 | 50514 | 55.0 | 17434 | 93.0  | 6840 |
| -20.0 | 165487 | 18.0 | 49028 | 56.0 | 16984 | 94.0  | 6683 |
| -19.0 | 159904 | 19.0 | 47590 | 57.0 | 16547 | 95.0  | 6531 |
| -18.0 | 154529 | 20.0 | 46200 | 58.0 | 16122 | 96.0  | 6383 |
| -17.0 | 149355 | 21.0 | 44855 | 59.0 | 15710 | 97.0  | 6239 |
| -16.0 | 144374 | 22.0 | 43554 | 60.0 | 15310 | 98.0  | 6098 |
| -15.0 | 139576 | 23.0 | 42295 | 61.0 | 14921 | 99.0  | 5961 |
| -14.0 | 134956 | 24.0 | 41077 | 62.0 | 14544 | 100.0 | 5827 |
| -13.0 | 130506 | 25.0 | 39898 | 63.0 | 14177 | 101.0 | 5697 |
| -12.0 | 126219 | 26.0 | 38757 | 64.0 | 13820 | 102.0 | 5570 |
| -11.0 | 122089 | 27.0 | 37652 | 65.0 | 13474 | 103.0 | 5446 |
| -10.0 | 118108 | 28.0 | 36583 | 66.0 | 13137 | 104.0 | 5326 |
| -9.0  | 114272 | 29.0 | 35548 | 67.0 | 12810 | 105.0 | 5208 |
| -8.0  | 110575 | 30.0 | 34545 | 68.0 | 12492 | 106.0 | 5094 |
| -7.0  | 107010 | 31.0 | 33574 | 69.0 | 12183 | 107.0 | 4982 |
| -6.0  | 103574 | 32.0 | 32634 | 70.0 | 11883 | 108.0 | 4873 |
| -5.0  | 100260 | 33.0 | 31723 | 71.0 | 11591 | 109.0 | 4767 |
| -4.0  | 97064  | 34.0 | 30840 | 72.0 | 11307 | 110.0 | 4663 |
| -3.0  | 93981  | 35.0 | 29986 | 73.0 | 11031 | 111.0 | 4562 |
| -2.0  | 91008  | 36.0 | 29157 | 74.0 | 10762 | 112.0 | 4464 |
| -1.0  | 88139  | 37.0 | 28355 | 75.0 | 10501 | 113.0 | 4367 |
| 0.0   | 85371  | 38.0 | 27577 | 76.0 | 10247 | 114.0 | 4274 |
| 1.0   | 82699  | 39.0 | 26823 | 77.0 | 10000 | 115.0 | 4182 |
| 2.0   | 80121  | 40.0 | 26092 | 78.0 | 9760  | 116.0 | 4093 |
| 3.0   | 77632  | 41.0 | 25383 | 79.0 | 9526  | 117.0 | 4006 |
| 4.0   | 75230  | 42.0 | 24696 | 80.0 | 9299  | 118.0 | 3921 |
| 5.0   | 72910  | 43.0 | 24030 | 81.0 | 9077  | 119.0 | 3838 |
| 6.0   | 70670  | 44.0 | 23384 | 82.0 | 8862  | 120.0 | 3757 |
| 7.0   | 68507  | 45.0 | 22758 | 83.0 | 8653  | 121.0 | 3678 |
| 8.0   | 66418  | 46.0 | 22150 | 84.0 | 8449  | 122.0 | 3601 |
| 9.0   | 64399  | 47.0 | 21561 | 85.0 | 8250  | 123.0 | 3526 |
| 10.0  | 62449  | 48.0 | 20989 | 86.0 | 8057  | 124.0 | 3452 |
| 11.0  | 60565  | 49.0 | 20435 | 87.0 | 7869  |       |      |
| 12.0  | 58745  | 50.0 | 19896 | 88.0 | 7686  |       |      |


# TROUBLESHOOTING

## FAN BLADE SETTING DIMENSIONS

Shown in Figure 9 is the correct fan blade setting for proper air delivery across the outdoor coil. Refer to Table 5 for unit specific dimension.

Any service work requiring removal or adjustment in the fan and/or motor area will require that the dimensions below be checked and blade adjusted in or out on the motor shaft accordingly.

**FIGURE 9  
FAN BLADE SETTING**

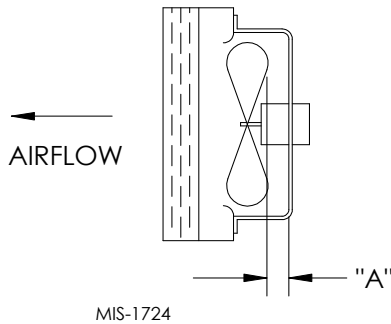

**TABLE 5  
FAN BLADE DIMENSION**

| Model                | Dimension A |
|----------------------|-------------|
| J18H<br>J24H         | 1.00"       |
| J30H<br>J36H         | 1.25"       |
| J42H<br>J48H<br>J60H | 1.75"       |

## REMOVAL OF FAN SHROUD

1. Disconnect all power to the unit.
2. Remove the screws holding both grilles, one on each side of unit, and remove grilles.
3. Remove screws holding fan shroud to condenser and bottom. Nine (9) screws.
4. Unwire condenser fan motor.
5. Slide complete motor, fan blade, and shroud assembly out the left side of the unit.
6. Service motor/fan as needed.
7. Reverse steps to reinstall.

## R-410A

### REFRIGERANT CHARGE

AHRI capacity and efficiency ratings are based on testing done with the unit charged to the serial plate charge. This unit has been charged to the serial plate charge. The following pressure tables and sub-cooling or superheat charts show nominal pressures and temperatures for the unit. Many different problems can affect the pressure and temperatures. These should only be used by certified technicians as a guide for evaluating proper charge. They shall not be used to adjust charge. If charge is in doubt, reclaim, evacuate and recharge the unit to the serial plate charge.

Optimum unit performance will occur with a refrigerant charge resulting in a suction line temperature (6" from compressor) as shown in Table 6.

**TABLE 6  
REFRIGERANT CHARGE**

| Model | Rated Airflow | 95°F OD Temperature | 82°F OD Temperature |
|-------|---------------|---------------------|---------------------|
| J18H  | 600           | 57 - 61             | 62 - 66             |
| J24H  | 800           | 58 - 62             | 58 - 63             |
| J30H  | 1000          | 58 - 62             | 62 - 66             |
| J36H  | 1100          | 58 - 62             | 57 - 61             |
| J42H  | 1400          | 61 - 65             | 65 - 69             |
| J48H  | 1550          | 60 - 64             | 63 - 67             |
| J60H  | 1650          | 60 - 64             | 65 - 69             |

The suction line temperatures in Table 6 above are based upon 80°F dry bulb / 67°F wet bulb (50% R.H.) temperature and rated airflow across the evaporator during cooling cycle.



**TABLE 7  
COOLING PRESSURE TABLE**

Air Temperature Entering Outdoor Coil °F

| Model | Return Air Temperature   | Pressure              | 75         | 80         | 85         | 90         | 95         | 100        | 105        | 110        | 115        | 120        |
|-------|--------------------------|-----------------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|
| J18H  | 75 deg. DB<br>62 deg. WB | Low Side<br>High Side | 132<br>292 | 134<br>311 | 137<br>332 | 138<br>353 | 140<br>376 | 142<br>400 | 144<br>424 | 146<br>450 | 148<br>477 | 150<br>505 |
|       | 80 deg. DB<br>67 deg. WB | Low Side<br>High Side | 141<br>299 | 143<br>319 | 146<br>340 | 148<br>362 | 150<br>386 | 152<br>410 | 154<br>435 | 156<br>462 | 158<br>489 | 160<br>518 |
|       | 85 deg. DB<br>72 deg. WB | Low Side<br>High Side | 146<br>309 | 148<br>330 | 151<br>352 | 153<br>375 | 155<br>400 | 157<br>424 | 159<br>450 | 161<br>478 | 164<br>506 | 166<br>536 |
| J24H  | 75 deg. DB<br>62 deg. WB | Low Side<br>High Side | 124<br>329 | 126<br>351 | 128<br>373 | 131<br>398 | 133<br>423 | 135<br>449 | 137<br>475 | 138<br>503 | 140<br>531 | 142<br>561 |
|       | 80 deg. DB<br>67 deg. WB | Low Side<br>High Side | 133<br>337 | 135<br>360 | 137<br>383 | 140<br>408 | 142<br>434 | 144<br>460 | 146<br>487 | 148<br>516 | 150<br>545 | 152<br>575 |
|       | 85 deg. DB<br>72 deg. WB | Low Side<br>High Side | 138<br>349 | 140<br>373 | 142<br>396 | 145<br>422 | 147<br>449 | 149<br>476 | 151<br>504 | 153<br>534 | 155<br>564 | 157<br>595 |
| J30H  | 75 deg. DB<br>62 deg. WB | Low Side<br>High Side | 125<br>326 | 128<br>350 | 131<br>373 | 133<br>398 | 136<br>423 | 137<br>448 | 139<br>472 | 141<br>496 | 143<br>522 | 145<br>547 |
|       | 80 deg. DB<br>67 deg. WB | Low Side<br>High Side | 134<br>334 | 137<br>359 | 140<br>383 | 142<br>408 | 145<br>434 | 147<br>459 | 149<br>484 | 151<br>509 | 153<br>535 | 155<br>561 |
|       | 85 deg. DB<br>72 deg. WB | Low Side<br>High Side | 139<br>346 | 142<br>372 | 145<br>396 | 147<br>422 | 150<br>449 | 152<br>475 | 154<br>501 | 156<br>527 | 158<br>554 | 160<br>581 |
| J36H  | 75 deg. DB<br>62 deg. WB | Low Side<br>High Side | 122<br>329 | 124<br>351 | 126<br>375 | 128<br>399 | 130<br>424 | 132<br>449 | 135<br>476 | 137<br>503 | 138<br>530 | 141<br>559 |
|       | 80 deg. DB<br>67 deg. WB | Low Side<br>High Side | 131<br>337 | 133<br>360 | 135<br>385 | 137<br>409 | 139<br>435 | 141<br>461 | 144<br>488 | 146<br>516 | 148<br>544 | 151<br>573 |
|       | 85 deg. DB<br>72 deg. WB | Low Side<br>High Side | 136<br>349 | 138<br>373 | 140<br>398 | 142<br>423 | 144<br>450 | 146<br>477 | 149<br>505 | 151<br>534 | 153<br>563 | 156<br>593 |
| J42H  | 75 deg. DB<br>62 deg. WB | Low Side<br>High Side | 127<br>354 | 130<br>372 | 132<br>392 | 134<br>413 | 135<br>437 | 136<br>461 | 137<br>488 | 137<br>516 | 137<br>546 | 136<br>578 |
|       | 80 deg. DB<br>67 deg. WB | Low Side<br>High Side | 136<br>363 | 139<br>382 | 141<br>402 | 143<br>424 | 144<br>448 | 145<br>473 | 146<br>500 | 146<br>529 | 146<br>560 | 145<br>593 |
|       | 85 deg. DB<br>72 deg. WB | Low Side<br>High Side | 141<br>376 | 144<br>395 | 146<br>416 | 148<br>439 | 149<br>464 | 150<br>490 | 151<br>518 | 151<br>548 | 151<br>580 | 150<br>614 |
| J48H  | 75 deg. DB<br>62 deg. WB | Low Side<br>High Side | 129<br>352 | 132<br>374 | 134<br>398 | 136<br>422 | 137<br>449 | 139<br>476 | 141<br>505 | 143<br>535 | 145<br>566 | 146<br>600 |
|       | 80 deg. DB<br>67 deg. WB | Low Side<br>High Side | 138<br>361 | 141<br>384 | 143<br>408 | 145<br>433 | 147<br>460 | 149<br>488 | 151<br>518 | 153<br>549 | 155<br>581 | 156<br>615 |
|       | 85 deg. DB<br>72 deg. WB | Low Side<br>High Side | 143<br>374 | 146<br>397 | 148<br>422 | 150<br>448 | 152<br>476 | 154<br>505 | 156<br>536 | 158<br>568 | 160<br>601 | 161<br>637 |
| J60H  | 75 deg. DB<br>62 deg. WB | Low Side<br>High Side | 126<br>332 | 128<br>352 | 131<br>373 | 133<br>397 | 135<br>421 | 137<br>448 | 139<br>476 | 141<br>505 | 143<br>536 | 145<br>568 |
|       | 80 deg. DB<br>67 deg. WB | Low Side<br>High Side | 135<br>341 | 137<br>361 | 140<br>383 | 142<br>407 | 144<br>432 | 147<br>459 | 149<br>488 | 151<br>518 | 153<br>550 | 155<br>583 |
|       | 85 deg. DB<br>72 deg. WB | Low Side<br>High Side | 140<br>353 | 142<br>374 | 145<br>396 | 147<br>421 | 149<br>447 | 152<br>475 | 154<br>505 | 156<br>536 | 158<br>569 | 160<br>603 |

Low side pressure ± 4 PSIG      High side pressure ± 10 PSIG

Tables are based upon rated CFM (airflow) across the evaporator coil. If there is any doubt as to correct operating charge being in the system, the charge should be removed, system evacuated and recharged to serial plate charge weight.

*NOTE: Pressure table based on high speed condenser fan operation. If condensing pressures appear elevated check condenser fan wiring. See "Condenser Fan Operation".*

**TABLE 8  
HEATING PRESSURES – (ALL TEMPERATURES °F)**

| Model | Return Air Temperature | Pressure  | 0   | 5   | 10  | 15  | 20  | 25  | 30  | 35  | 40  | 45  | 50  | 55  | 60  |
|-------|------------------------|-----------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| J18H  | 70 Deg.                | Low Side  | 48  | 52  | 56  | 61  | 66  | 72  | 79  | 87  | 95  | 104 | 114 | 124 | 135 |
|       |                        | High Side | 290 | 285 | 282 | 282 | 285 | 290 | 297 | 307 | 319 | 334 | 352 | 372 | 394 |
| J24H  | 70 Deg.                | Low Side  | 57  | 55  | 55  | 57  | 59  | 64  | 70  | 77  | 86  | 96  | 108 | 121 | 135 |
|       |                        | High Side | 292 | 296 | 301 | 307 | 314 | 323 | 332 | 342 | 354 | 367 | 380 | 395 | 411 |
| J30H  | 70 Deg.                | Low Side  | 53  | 53  | 55  | 58  | 61  | 66  | 72  | 80  | 88  | 97  | 108 | 119 | 132 |
|       |                        | High Side | 254 | 266 | 278 | 290 | 301 | 312 | 322 | 332 | 342 | 351 | 360 | 369 | 377 |
| J36H  | 70 Deg.                | Low Side  | 47  | 49  | 51  | 55  | 59  | 64  | 70  | 77  | 85  | 93  | 103 | 113 | 124 |
|       |                        | High Side | 281 | 282 | 283 | 287 | 292 | 300 | 308 | 319 | 331 | 345 | 361 | 379 | 398 |
| J42H  | 70 Deg.                | Low Side  | 50  | 50  | 52  | 54  | 58  | 62  | 68  | 75  | 84  | 93  | 104 | 115 | 128 |
|       |                        | High Side | 299 | 300 | 303 | 308 | 314 | 322 | 331 | 342 | 355 | 370 | 386 | 404 | 423 |
| J48H  | 70 Deg.                | Low Side  | 42  | 45  | 49  | 54  | 59  | 64  | 70  | 77  | 84  | 92  | 100 | 109 | 118 |
|       |                        | High Side | 268 | 270 | 274 | 278 | 284 | 291 | 298 | 307 | 317 | 327 | 339 | 352 | 366 |
| J60H  | 70 Deg.                | Low Side  | 39  | 43  | 47  | 52  | 58  | 63  | 70  | 76  | 84  | 92  | 100 | 109 | 118 |
|       |                        | High Side | 294 | 296 | 300 | 305 | 311 | 319 | 328 | 338 | 349 | 362 | 376 | 391 | 408 |

TABLE 9

**Electrical Specifications — J\*\*H Series**

| Models   | Rated Volts, HZ and Phase | No. of Field Power Circuits                    | Single Circuit                    |   |                            |                              | Multiple Circuit              |                      |   |                      |                            |                   |                       |                      |
|--|---------------------------|--|-----------------------------------|---|----------------------------|------------------------------|-------------------------------|----------------------|---|----------------------|----------------------------|-------------------|-----------------------|----------------------|
|  |                           |  | Minimum Circuit Ampacity<br>①     | Maximum External Fuse or Circuit Breaker<br>② | Field Power Wire Size<br>③ | Ground Wire Size<br>③        | Minimum Circuit Ampacity<br>① |                      | Maximum Circuit Exterior Fuse or Circuit Breaker<br>② |                      | Field Power Wire Size<br>③ |                   | Ground Wire Size<br>③ |                      |
|  |                           |  |                                   |   |                            |                              | Ckt. A                        | Ckt. B               | Ckt. A  | Ckt. B               | Ckt. A                     | Ckt. B            | Ckt. A                | Ckt. B               |
| J18H2-A00, A0Z<br>-A04<br>-A08                           | 230/208-60-1              | 1<br>1<br>1                                    | 16<br>37<br>58                    | 20<br>40<br>60                                | 12<br>8<br>6               | 12<br>10<br>10               |                               |                      |   |                      |                            |                   |                       |                      |
| J24H2-A00, A0Z<br>-A04<br>-A08                           | 230/208-60-1              | 1<br>1<br>1 or 2                               | 24<br>44<br>65                    | 25<br>50<br>70                                | 10<br>8<br>6               | 10<br>10<br>8                | 44                            | 21                   | 45  | 25                   | 8                          | 10                | 10                    | 10                   |
| J24H2-B00, B0Z<br>-B06                                   | 230/208-60-3              | 1<br>1   | 17<br>35                          | 20<br>40                                      | 12<br>8                    | 12<br>10                     |                               |                      |   |                      |                            |                   |                       |                      |
| J24H2-C00, C0Z<br>-C06                                   | 460-60-3                  | 1<br>1   | 11<br>21                          | 15<br>25                                      | 14<br>10                   | 14<br>10                     |                               |                      |   |                      |                            |                   |                       |                      |
| J30H2-A00, A0Z*<br>-A05*<br>-A10*                        | 230/208-60-1              | 1<br>1<br>1 or 2                               | 24<br>50<br>76                    | 35<br>50<br>80                                | 8<br>8<br>4                | 10<br>10<br>8                | 50                            | 26                   | 50  | 30                   | 8                          | 10                | 10                    | 10                   |
| J30H2-B00, B0Z*<br>-B06<br>-B09*                         | 230/208-60-3              | 1<br>1<br>1                                    | 18<br>36<br>45                    | 25<br>40<br>45                                | 10<br>8<br>8               | 10<br>10<br>10               |                               |                      |   |                      |                            |                   |                       |                      |
| J30H2-C00, C0Z*<br>-C06<br>-C09*<br>③-C15                | 460-60-3                  | 1<br>1<br>1<br>1                               | 11<br>20<br>25<br>26              | 15<br>20<br>25<br>30                          | 14<br>12<br>10<br>10       | 14<br>12<br>10<br>10         |                               |                      |   |                      |                            |                   |                       |                      |
| J36H2-A00, A0Z*<br>-A05<br>-A10*<br>-A15                 | 230/208-60-1              | 1<br>1<br>1 or 2<br>1 or 2                     | 29<br>55<br>81<br>84              | 40<br>60<br>90<br>90                          | 8<br>6<br>4<br>4           | 10<br>10<br>8<br>8           | 55<br>55                      | 26<br>52             | 60<br>60  | 30<br>60             | 6<br>6                     | 10<br>6           | 10<br>10              | 10<br>10             |
| J36H2-B00, B0Z*<br>-B06<br>-B09*<br>③-B15                | 230/208-60-3              | 1<br>1<br>1<br>1                               | 23<br>41<br>50<br>51              | 30<br>45<br>50<br>60                          | 10<br>8<br>8<br>8          | 10<br>10<br>10<br>10         |                               |                      |   |                      |                            |                   |                       |                      |
| J36H2-C00, C0Z*<br>-C06<br>-C09*<br>③-C15                | 460-60-3                  | 1<br>1<br>1<br>1                               | 12<br>21<br>25<br>26              | 15<br>25<br>25<br>30                          | 14<br>10<br>10<br>10       | 14<br>10<br>10<br>10         |                               |                      |   |                      |                            |                   |                       |                      |
| J42H2-A00, A0Z<br>-A04<br>-A05<br>-A10<br>-A15<br>④-A15  | 230/208-60-1              | 1<br>1<br>1 or 2<br>1 or 2<br>1 or 2           | 36<br>57<br>62<br>88<br>88        | 50<br>60<br>70<br>90<br>90                    | 8<br>6<br>6<br>3<br>3      | 10<br>10<br>8<br>8<br>8      | 36<br>36<br>36                | 26<br>52<br>52       | 50<br>50<br>50  | 30<br>60<br>60       | 8<br>8<br>8                | 10<br>6<br>6      | 10<br>10<br>10        | 10<br>10<br>10       |
| J42H2-B00, B0Z<br>-B06<br>-B09<br>③-B15                  | 230/208-60-3              | 1<br>1<br>1<br>1                               | 26<br>44<br>53<br>53              | 35<br>50<br>60<br>60                          | 8<br>8<br>6<br>6           | 10<br>10<br>10<br>10         |                               |                      |   |                      |                            |                   |                       |                      |
| J42H2-C00, C0Z<br>-C06<br>-C09<br>③-C15                  | 460-60-3                  | 1<br>1<br>1<br>1                               | 13<br>22<br>26<br>26              | 15<br>25<br>30<br>30                          | 14<br>10<br>10<br>10       | 14<br>10<br>10<br>10         |                               |                      |   |                      |                            |                   |                       |                      |
| J48H2-A00, A0Z<br>-A04<br>-A05<br>-A10<br>④-A15<br>④-A20 | 230/208-60-1              | 1<br>1<br>1 or 2<br>1 or 2<br>1 or 2<br>1 or 2 | 37<br>58<br>63<br>89<br>89<br>111 | 50<br>60<br>70<br>90<br>90<br>125             | 8<br>6<br>6<br>3<br>3<br>2 | 10<br>10<br>8<br>8<br>8<br>6 | 37<br>37<br>37<br>59          | 26<br>52<br>52<br>52 | 50<br>50<br>50<br>60                                  | 30<br>60<br>60<br>60 | 8<br>8<br>8<br>6           | 10<br>6<br>6<br>6 | 10<br>10<br>10<br>10  | 10<br>10<br>10<br>10 |
| J48H2-B00, B0Z<br>-B06<br>-B09<br>③-B15<br>③-B18         | 230/208-60-3              | 1<br>1<br>1<br>1<br>1 or 2                     | 29<br>47<br>56<br>56<br>62        | 35<br>50<br>60<br>60<br>70                    | 8<br>8<br>6<br>6<br>6      | 10<br>10<br>10<br>10<br>8    | 34                            | 28                   | 40  | 30                   | 8                          | 10                | 10                    | 10                   |
| J48H2-C00, C0Z<br>-C09<br>③-C15                          | 460-60-3                  | 1<br>1<br>1                                    | 14<br>27<br>27                    | 20<br>30<br>30                                | 12<br>10<br>10             | 12<br>10<br>10               |                               |                      |   |                      |                            |                   |                       |                      |
| J60H2-A00, A0Z<br>-A05<br>-A10<br>④-A15<br>④-A20         | 230/208-60-1              | 1<br>1 or 2<br>1 or 2<br>1 or 2<br>1 or 2      | 41<br>67<br>93<br>93<br>111       | 60<br>80<br>100<br>100<br>125                 | 8<br>4<br>3<br>3<br>2      | 10<br>8<br>8<br>8<br>6       | 41<br>41<br>41<br>59          | 26<br>52<br>52<br>52 | 60<br>60<br>60<br>60                                  | 30<br>60<br>60<br>60 | 8<br>8<br>8<br>6           | 10<br>6<br>6<br>6 | 10<br>10<br>10<br>10  | 10<br>10<br>10<br>10 |
| J60H2-B00, B0Z<br>-B09<br>③-B15<br>③-B18                 | 230/208-60-3              | 1<br>1<br>1<br>1 or 2                          | 28<br>55<br>55<br>62              | 40<br>60<br>60<br>70                          | 8<br>6<br>6<br>6           | 10<br>10<br>10<br>10         | 34                            | 28                   | 40  | 30                   | 8                          | 10                | 10                    | 10                   |
| J60H2-C00, C0Z<br>-C09<br>③-C15                          | 460-60-3                  | 1<br>1<br>1                                    | 16<br>28<br>28                    | 20<br>30<br>30                                | 12<br>10<br>10             | 12<br>10<br>10               |                               |                      |   |                      |                            |                   |                       |                      |

① These "Minimum Circuit Ampacity" values are to be used for sizing the field power conductors. Refer to the National Electrical code (latest version), Article 310 for power conductor sizing.  
**CAUTION:** When more than one field power circuit is run through one conduit, the conductors must be derated. Pay special attention to note 8 of Table 310 regarding Ampacity Adjustment Factors when more than three (3) current carrying conductors are in a raceway.  
 ② Maximum size of the time delay fuse or HACR type circuit breaker for protection of field wiring conductors.  
 ③ Maximum KW that can operate with the heat pump on is 9KW. Full heat available during emergency heat mode.  
 ④ Maximum KW that can operate with the heat pump on is 10KW. Full heat available during emergency heat mode.  
 ⑤ Based on 75°copper wire. All wiring must conform to the National Electrical Code and all local codes.  
 \* Available factory-built only with top outlet supply as an option.  
**IMPORTANT:** While this electrical data is presented as a guide, it is important to electrically connect properly sized fuses and conductor wires in accordance with the National Electrical Code and all local codes.

**TABLE 10  
RECOMMENDED AIRFLOW**

| Model | Rated CFM* | Rated ESP* | Recommended Airflow Range | Factory Speed Connection |
|-------|------------|------------|---------------------------|--------------------------|
| J18H  | 600 ①      | .30        | 575 - 725                 | High                     |
| J24H  | 800        | .20        | 700 - 950                 | High                     |
| J30H  | 1000       | .40        | 930 - 1300                | High                     |
| J36H  | 1100       | .30        | 930 - 1350                | High                     |
| J42H  | 1400       | .30        | 1600 - 1150               | High                     |
| J48H  | 1550       | .20        | 1750 - 1285               | High                     |
| J60H  | 1650       | .30        | 1950 - 1375               | High                     |

\* Rated CFM and ESP on high speed tap.

① Rated CFM and ESP on low speed tap.

**TABLE 11  
INDOOR BLOWER PERFORMANCE**

| ESP in H <sub>2</sub> O | J18H, J24H |          | J18H      |          | J30H, H36H |          |           |          | J42H, J48H |          |           |          | J60H       |          |           |          |
|-------------------------|------------|----------|-----------|----------|------------|----------|-----------|----------|------------|----------|-----------|----------|------------|----------|-----------|----------|
|                         | High Speed |          | Low Speed |          | High Speed |          | Low Speed |          | High Speed |          | Low Speed |          | High Speed |          | Low Speed |          |
|                         | Dry Coil   | Wet Coil | Dry Coil  | Wet Coil | Dry Coil   | Wet Coil | Dry Coil  | Wet Coil | Dry Coil   | Wet Coil | Dry Coil  | Wet Coil | Dry Coil   | Wet Coil | Dry Coil  | Wet Coil |
| .0                      | 1020       | 975      | 750       | 700      | 1395       | 1315     | 950       | 935      | 1885       | 1800     | 1650      | 1600     | 2200       | 2000     | 1600      | 1450     |
| .1                      | 960        | 905      | 735       | 675      | 1340       | 1270     | 930       | 915      | 1770       | 1665     | 1550      | 1500     | 2100       | 1900     | 1525      | 1375     |
| .2                      | 865        | 800      | 710       | 650      | 1285       | 1190     | 910       | 885      | 1635       | 1540     | 1450      | 1400     | 2000       | 1800     | —         | —        |
| .3                      | 820        | 735      | 660       | 600      | 1205       | 1100     | 855       | 830      | 1500       | 1400     | 1350      | 1300     | 1875       | 1700     | —         | —        |
| .4                      | 735        | 650      | 605       | 550      | 1110       | 1000     | 800       | 755      | 1370       | 1285     | 1300      | 1175     | 1775       | 1600     | —         | —        |
| .5                      | 615        | 535      | 540       | 490      | 1005       | 870      | —         | —        | 1250       | 1150     | —         | —        | 1650       | 1475     | —         | —        |

**TABLES 12  
MAXIMUM ESP OF OPERATION  
ELECTRIC HEAT ONLY**

| Model |     | ESP |
|-------|-----|-----|
| J18H  | A00 | .50 |
| J24H  | A04 | .50 |
|       | A08 | .40 |
| J24H  | B00 | .50 |
|       | B06 | .50 |
| J24H  | C00 | .50 |
|       | C06 | .50 |

| Model |     | Front Outlet |            | Top Outlet |            |
|-------|-----|--------------|------------|------------|------------|
|       |     | Low Speed    | High Speed | Low Speed  | High Speed |
| J30H  | A00 | .50          | .50        | .50        | .50        |
| J36H  | A05 | .40          | .50        | .40        | .50        |
|       | A10 | .35          | .40        | .25        | .40        |
|       | A15 | .35          | .40        | NA         | NA         |
| J30H  | B00 | .50          | .50        | .50        | .50        |
| J36H  | B06 | .40          | .50        | NA         | NA         |
|       | B09 | .35          | .45        | .30        | .40        |
|       | B15 | .35          | .45        | NA         | NA         |
| J30H  | C00 | .50          | .50        | .50        | .50        |
| J36H  | C06 | .50          | .50        | NA         | NA         |
|       | C09 | .30          | .40        | .35        | .45        |
|       | C15 | .30          | .40        | NA         | NA         |

| Model<br>Speed KW | J42H       |           | J48H       |           | J60H       |           |
|-------------------|------------|-----------|------------|-----------|------------|-----------|
|                   | High Speed | Low Speed | High Speed | Low Speed | High Speed | Low Speed |
| -A00              | .50        | .50       | .50        | .50       | .50        | .40       |
| -A04              | ----       | ----      | .50        | .50       | ----       | ----      |
| -A05              | .50        | .50       | .50        | .50       | .50        | .25       |
| -A10              | .50        | .45       | .50        | .45       | .50        | .25       |
| -A15              | .50        | .45       | .50        | .45       | .50        | .25       |
| -A20              | ----       | ----      | .50        | .45       | .50        | .25       |
| -B00              | .50        | .50       | .50        | .50       | .50        | .40       |
| -B09              | .50        | .45       | .50        | .45       | .50        | .30       |
| -B15              | .50        | .45       | .50        | .45       | .50        | .30       |
| -B18              | ----       | ----      | .50        | .45       | .50        | .30       |
| -C00              | .50        | .50       | .50        | .50       | .50        | .40       |
| -C09              | .50        | .40       | .50        | .40       | .50        | .35       |
| -C15              | .50        | .40       | .50        | .40       | .50        | .35       |

**TABLE 13  
ELECTRIC HEAT**

| Models | 240V-1 |       | 208V-1 |       | 240V-3 |       | 208V-3 |       | 460V-3 |       |      |
|--------|--------|-------|--------|-------|--------|-------|--------|-------|--------|-------|------|
|        | KW     | Amps  | BTUH   | Amps  | BTUH   | Amps  | BTUH   | Amps  | BTUH   | Amps  | BTUH |
| 4      | 16.7   | 13650 | 14.4   | 10240 |        |       |        |       |        |       |      |
| 5      | 20.8   | 17065 | 18.1   | 12800 |        |       |        |       |        |       |      |
| 6      |        |       |        |       | 14.4   | 20500 | 12.5   | 15360 | 7.2    | 20500 |      |
| 8      | 33.3   | 27300 | 28.8   | 20475 |        |       |        |       |        |       |      |
| 9      |        |       |        |       | 21.7   | 30600 | 18.7   | 23030 | 10.8   | 30700 |      |
| 10     | 41.6   | 34130 | 36.2   | 25600 |        |       |        |       |        |       |      |
| 12     |        |       |        |       |        |       |        |       | 14.4   | 40950 |      |
| 15     | 62.5   | 51250 | 54.0   | 38400 | 36.2   | 51200 | 31.2   | 38400 | 18.0   | 51200 |      |
| 18     |        |       |        |       | 43.3   | 61430 | 37.5   | 46100 |        |       |      |
| 20     | 83.2   | 68260 | 72.1   | 51200 |        |       |        |       |        |       |      |

**TABLE 14  
OPTIONAL ACCESSORIES**

| Part Number  | J18H2-A     | J24H2-A | J24H2-B | J24H2-C | J30H2-A | J30H2-B | J30H2-C | J36H2-A | J36H2-B | J36H2-C | J42H2-A | J42H2-B | J42H2-C | J48H2-A | J48H2-B | J48H2-C | J60H2-A | J60H2-B | J60H2-C |   |
|--|-------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---|
| <b>HEATER KITS</b>   | EHWH02A-A04 | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | EHWH02A-A08 | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | EHW24H-A04  |         | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | EHW24H-A08  |         | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | EHW24H-B06  |         |         |         | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | EHWH30-A05  |         |         |         |         | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | EHWH30-A10  |         |         |         |         | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | EHWH36-A05  |         |         |         |         |         |         |         | X       |         |         |         |         |         |         |         |         |         |         |   |
|  | EHWH36-A10  |         |         |         |         |         |         |         | X       |         |         |         |         |         |         |         |         |         |         |   |
|  | EHWH36-A15  |         |         |         |         |         |         |         | X       |         |         |         |         |         |         |         |         |         |         |   |
|  | EHWH03-B06  |         |         |         |         |         | X       |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | EHW36H-B06  |         |         |         |         |         |         |         |         | X       |         |         |         |         |         |         |         |         |         |   |
|  | EHWH03-B09  |         |         |         |         |         | X       |         |         | X       |         |         |         |         |         |         |         |         |         |   |
|  | EHW30H-B15  |         |         |         |         |         |         |         |         | X       |         |         |         |         |         |         |         |         |         |   |
|  | EHWC03A-C06 |         |         |         |         |         |         | X       |         |         | X       |         |         |         |         |         |         |         |         |   |
|  | EHWH42-A05  |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |         |         |         |   |
|  | EHWH42-A10  |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |         |         |         |   |
|  | EHWH42-A15  |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |         |         |         |   |
|  | EHWH-04-A20 |         |         |         |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |   |
|  | EHWH05-B06  |         |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |         |         |   |
|  | EHWH05-B09  |         |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |         | X       |   |
|  | EHWH05-B15  |         |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |         | X       |   |
|  | EHWH42-C06  |         |         |         |         |         |         |         |         |         |         |         |         | X       |         |         |         |         |         |   |
|  | EHWH05A-C09 |         |         |         |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         | X |
|  | EHWH05A-C15 |         |         |         |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         | X |
|  | EHWH04-A15  |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         | X       |   |
|  | EHWH04-A10  |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         | X       |   |
| EHW05H-B18   |             |         |         |         |         |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |   |
| <b>CIRCUIT BREAKER (WMCB) &amp; PULL DISCONNECT (WMPD)</b> | WMCB-02A    | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | WMCB-02B    |         |         | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | WMCB-03A    |         | X       |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |   |
|  | WMCB-03B    |         |         |         |         |         | X       |         | X       |         |         |         |         |         |         |         |         |         |         |   |
|  | WMCB-06A    |         |         |         |         | X       |         | X       |         |         |         |         |         |         |         |         |         |         |         |   |
|  | WMCB-05B    |         |         |         |         |         |         |         |         |         | X       |         |         |         | X       |         |         |         |         |   |
|  | WMCB-07B    |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         | X       |         |   |
|  | WMCB-08A    |         |         |         |         |         |         |         |         |         | X       |         |         | X       |         |         |         |         |         |   |
|  | WMCB-09A    |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         |         | X       |         |   |
|  | WMPD-01C    |         |         |         | X       |         | X       |         |         | X       |         |         | X       |         |         | X       |         |         |         | X |

**TABLE 15  
VENT & CONTROL OPTIONS**

| <b>Part Number</b> | <b>Description</b>                       | <b>J18, J24</b> | <b>J30, J36</b> | <b>J42, J48, J60</b> |
|--------------------|--|-----------------|-----------------|----------------------|
| BFAD-2             | Barometric Fresh Air Damper - Standard   | X               |                 |                      |
| ECONWMS-E2B        | Economizer - Standard Versions, Enthalpy | X               |                 |                      |
| ECONWMT-E2B        | Economizer - Equipment Bldg., Enthalpy   | X               |                 |                      |
| ECONWMT-T2B        | Economizer - Equipment Bldg., DB Temp.   | X               |                 |                      |
| BFAD-3             | Barometric Fresh Air Damper - Standard   |                 | X               |                      |
| ECONWMS-E3B        | Economizer - Standard Versions, Enthalpy |                 | X               |                      |
| ECONWMT-E3B        | Economizer - Equipment Bldg., Enthalpy   |                 | X               |                      |
| ECONWMT-T3B        | Economizer - Equipment Bldg., DB Temp.   |                 | X               |                      |
| BFAD-5             | Barometric Fresh Air Damper - Standard   |                 |                 | X                    |
| ECONWMS-E5B        | Economizer - Standard Versions, Enthalpy |                 |                 | X                    |
| ECONWMT-E5B        | Economizer - Equipment Bldg., Enthalpy   |                 |                 | X                    |
| ECONWMT-T5B        | Economizer - Equipment Bldg., DB Temp.   |                 |                 | X                    |