

---

# INSTALLATION INSTRUCTIONS

---

## Circuit Breaker Kits

Models:

WMCBC-08A	WMCBC-04B	WMCBC-08B
WMCBC-07A	WMCBC-06F	WMCBC-05A
WMCBC-05B	WMCBC-09A	WMCBC-03B
WMCBC-06C	WMCBC-06B	



*Climate Control Solutions*

Bard Manufacturing Company, Inc.  
Bryan, Ohio 43506  
[www.bardhvac.com](http://www.bardhvac.com)

Manual: 2100-735C  
Supersedes: 2100-735B  
Date: 7-27-22

# CONTENTS

---

**General Information .....3**

Description .....3

Nomenclature .....3

**Installation .....4**

Installation of Circuit Breaker .....4

**Figures**

Figure 1 Circuit Breaker Installation .....4

Figure 2 Serial Plate Label .....5

**Table**

Table 1 Applicable Kits for Listed Models .....3

# GENERAL INFORMATION


## Description

The WMCBC Kits are field-installable circuit breaker kits suitable for upgrading "00" kW Bard wall-mount heat pumps and air conditioners (-A, -B, -C, -E and -F electrical versions) to the "0Z" kW option. See Table 1 for applicable kits for listed models.

**TABLE 1**  
**Applicable Kits for Listed Models**

	W42AC-A	W42HC-A	W42A/HC-B	W42A/HC-C	W42A/HC-E	W42A/HC-F	W42A/HCDA	W42A/HCDB	W42A/HCDC	W48A/HC-A	W48A/HC-B	W48A/HC-C	W48A/HC-E	W48A/HC-F	W48A/HCDA	W48A/HCDB	W48A/HCDC	W60A/HC-A	W60A/HC-B	W60A/HC-C	W60A/HC-E	W60A/HC-F	W60A/HCDA	W60A/HCDB	W60A/HCDC	W72AC-A	W72AC-B	W72AC-C	W72AC-F	W72ACDA	W72ACDB	W72ACDC	W3SAC-A	W3SAC-B	W3SAC-C	W4SAC-A	W4SAC-B	W4SAC-C	W5SAC-A	W5SAC-B	W5SAC-C							
WMCBC-08A	X						X			X					X																																	
WMCBC-07A		X																																														
WMCBC-05B			X					X			X					X																																
WMCBC-06C				X					X			X					X								X																							
WMCBC-04B					X								X																																			
WMCBC-06F						X								X																																		
WMCBC-09A																		X						X																								
WMCBC-06B																			X		X				X																							
WMCBC-08B																												X																				
WMCBC-05A																																																
WMCBC-03B																																																

## Nomenclature

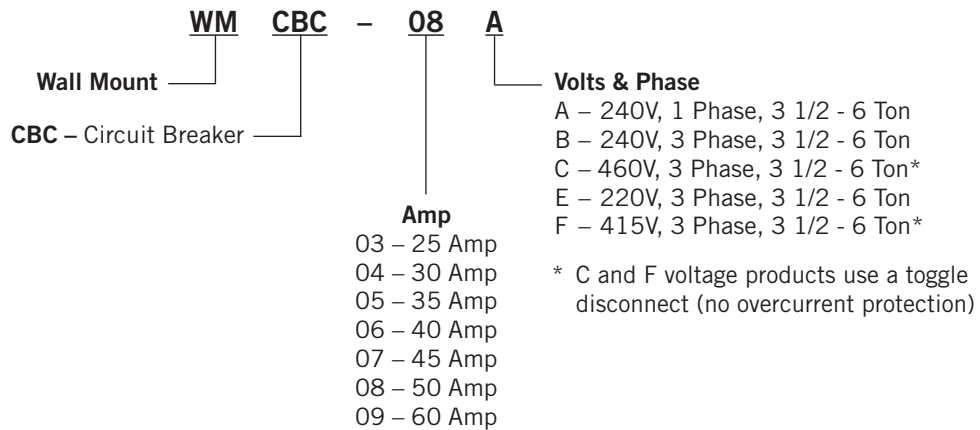


# INSTALLATION

## Installation of Circuit Breaker


1. Disconnect all power to unit. Remove control panel inner and outer covers.
2. Before installation, check unit serial plate to make sure the circuit breaker kit that is intended to be installed is listed as a kit suitable for use with the unit.
3. Mount circuit breaker assembly in position as shown in Figure 1 with screws provided.
4. Connect red compressor supply lead to L1 of terminal block. Connect black compressor supply lead to L2 of terminal block. If 3-phase unit, connect yellow supply lead to L3 of terminal block. See Figure 1 and wiring diagram (included with kit).
5. Connect field wiring to circuit breakers.
6. Attach adhesive wiring diagram directly above unit wiring diagram on inner control panel cover.
7. Recheck wiring. Break out appropriate circuit breaker tabs on inner control panel cover to allow trip lever to protrude.
8. Resupply power to the unit and check for proper operation.
9. Remark serial plate with self adhesive label attached to the front of this manual. See Figure 2 on page 5.

**FIGURE 1**  
**Circuit Breaker Installation**

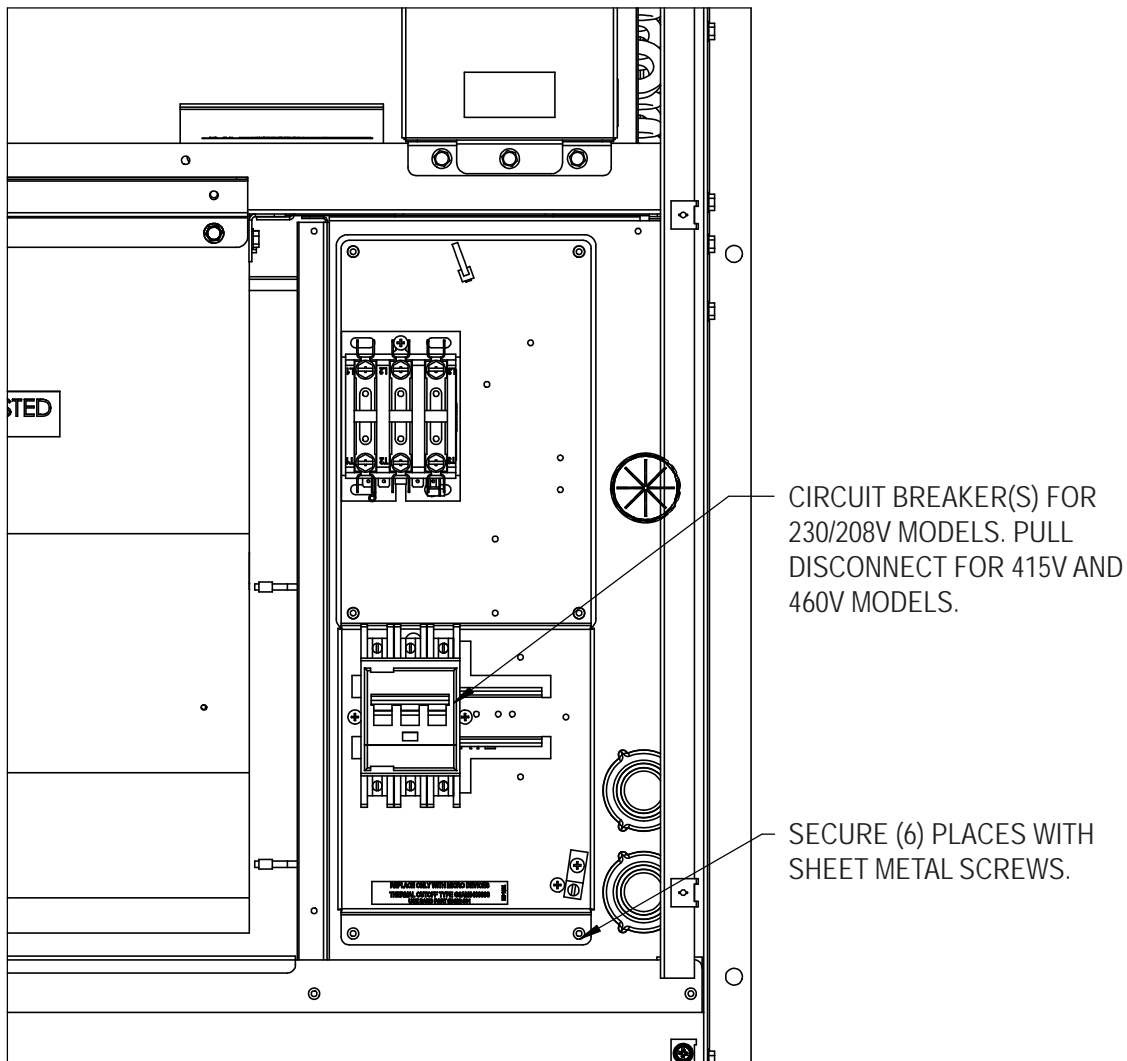

MIS-4141

**FIGURE 2**  
**Serial Plate Label**

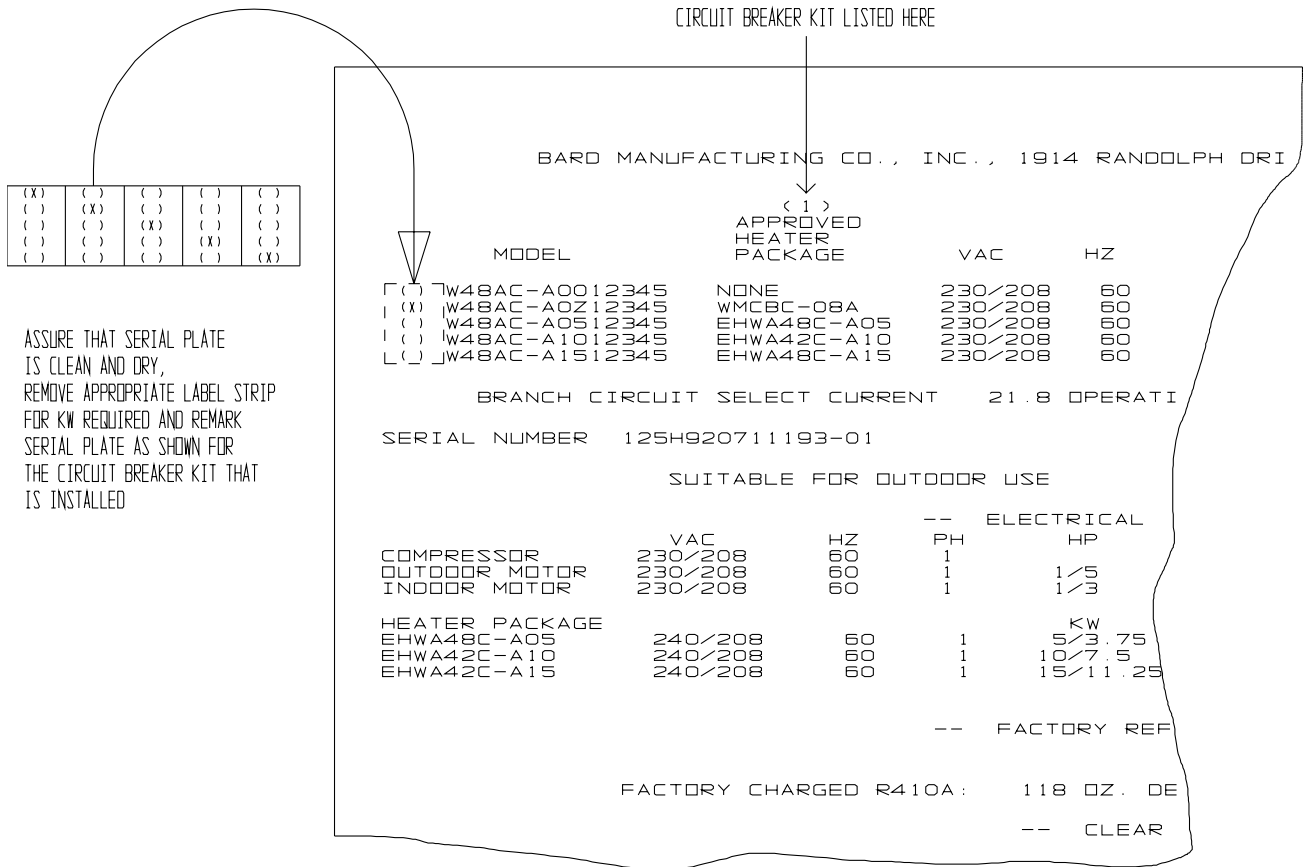

MIS-4142